



WithersRavenel
Our People. Your Success.



Storm Drainage Calculations

Broadmoor

Town of Rolesville

Pulte Home Company, LLC

Prepared For:
Pulte Home Company, LLC
1225 Crescent Green Drive, Suite 250
Cary, NC 27518
Kelly Race
(919) 606-0878

Prepared By:
WithersRavenel
115 MacKenan Drive
Cary, NC 27511
(919) 469-3340
License No.: F-1479

WithersRavenel Project No. 23-0045

November 01, 2024



Terrence Cook, PE

Table of Contents

Storm Drainage Narrative 1

Appendices

1. SCM 1: 10-YR Storm Drainage Chart
2. SCM 1: 10-YR HGL Profiles
3. SCM 1: 4"/Hour Gutter Spread Chart
4. SCM 2: 10-YR Storm Drainage Chart
5. SCM 2: 10-YR HGL Profiles
6. SCM 2: 4"/Hour Gutter Spread Chart
7. SCM 3: 10-YR Storm Drainage Chart
8. SCM 3: 10-YR HGL Profiles
9. SCM 3: 4"/Hour Gutter Spread Chart
10. SCM 4: 10-YR Storm Drainage Chart
11. SCM 4: 10-YR HGL Profiles
12. SCM 4: 4"/Hour Gutter Spread Chart
13. Storm Drainage Area Map

Storm Drainage Narrative

Broadmoor is located at 1321 Rolesville Road in Rolesville, NC. The site in its existing conditions is undeveloped, mostly wooded with HSG 'B', 'C' & 'D' soils. The proposed development consists of 253 lots and associated roads and infrastructure. A 10-yr HGL analysis and 4"/hr gutter spread analysis have been performed for all the storm drainage associated with the project. These calculations are attached to this narrative.

1. SCM 1: 10-YR Storm Drainage Chart

Pipes

Line No.	Junct Type	Inlet ID	DnStm Ln No	Drng Area (ac)	Tc (min)	i Sys (in/hr)	Runoff Coeff (C)	Total Runoff (cfs)	Capac Full (cfs)	Line Length (ft)	Line Size (in)	n-val Pipe	Line Slope (%)	Invert Up (ft)	Invert Dn (ft)	Gnd/Rim El Up (ft)	Gnd/Rim El Dn (ft)	HGL Up (ft)	HGL Dn (ft)
1	Dp-Grate	DI - 151	Outfall	0.21	12.6	5.57	0.70	11.97	40.94	70.230	30	0.013	1.00	357.70	357.00	361.82	359.29	361.30	361.24
2	Dp-Grate	DI - 152	1	0.23	11.7	5.73	0.70	11.47	30.12	139.010	30	0.013	0.54	358.55	357.80	364.49	361.82	361.48	361.37
3	Dp-Grate	DI - 153	2	0.07	10.1	6.03	0.70	11.09	30.57	224.960	30	0.013	0.56	359.90	358.65	366.59	364.49	361.66	361.53
4	Dp-Grate	DI - 154	3	0.22	9.8	6.09	0.70	10.92	16.99	70.885	24	0.013	0.56	360.80	360.40	367.25	366.59	361.98 j	361.73
5	Comb.	CB - 155	4	0.34	9.1	6.23	0.70	10.21	16.94	142.662	24	0.013	0.56	361.70	360.90	367.67	367.25	362.84	362.02
6	Comb.	CB - 156	5	0.24	8.6	6.34	0.70	8.87	20.64	84.049	24	0.013	0.83	362.50	361.80	368.83	367.67	363.56	362.84
7	Comb.	CB - 157	6	0.12	7.7	6.54	0.70	8.06	22.10	146.583	24	0.013	0.96	364.00	362.60	370.29	368.83	365.01	363.56
8	Dp-Grate	DI - 160	7	0.42	6.5	6.82	0.70	3.87	7.24	115.467	15	0.013	1.26	366.20	364.75	368.73	370.29	366.99	365.40
9	Dp-Grate	DI - 161	8	0.39	5.0	7.25	0.70	1.98	7.02	149.000	15	0.012	1.01	367.80	366.30	370.62	368.73	368.36 j	366.99
10	Comb.	CB - 158	7	0.13	6.8	6.77	0.70	3.93	23.67	73.024	24	0.013	1.10	364.90	364.10	371.02	370.29	365.59 j	365.01
11	Comb.	CB - 162	10	0.45	5.0	7.25	0.70	2.28	7.95	29.000	15	0.013	1.52	366.09	365.65	371.02	371.02	366.69	366.11
12	Comb.	CB - 159	10	0.25	5.0	7.25	0.70	1.27	14.51	75.976	18	0.013	1.91	366.85	365.40	371.78	371.02	367.27	365.70
13	Comb.	CB - 101	Outfall	0.20	9.4	6.17	0.70	15.85	81.11	81.139	36	0.013	1.48	357.20	356.00	364.40	358.33	361.29	361.24
14	Comb.	CB - 102	13	0.03	8.8	6.30	0.70	14.63	46.95	114.463	30	0.013	1.31	359.20	357.70	365.72	364.40	361.52	361.39
15	Comb.	CB - 103	14	0.02	8.7	6.32	0.70	8.68	26.23	22.299	24	0.013	1.35	360.00	359.70	366.53	365.72	361.72	361.72
16	Comb.	CB - 104	15	0.17	8.5	6.36	0.70	8.64	18.78	29.000	24	0.013	0.69	360.30	360.10	366.06	366.53	361.35	361.89
17	Comb.	CB - 105	16	0.09	8.0	6.47	0.70	8.02	21.10	80.421	24	0.013	0.87	361.10	360.40	366.87	366.06	362.11	361.35
18	Comb.	CB - 106	17	0.22	7.7	6.53	0.70	7.68	22.37	40.904	24	0.013	0.98	361.60	361.20	367.20	366.87	362.58	362.11
19	Dp-Grate	DI - 107	18	0.04	7.5	6.59	0.70	4.11	12.60	38.208	18	0.013	1.44	362.65	362.10	367.74	367.20	363.43	362.69
20	Dp-Grate	DI - 108	19	0.64	7.1	6.69	0.70	3.98	6.01	80.712	15	0.013	0.87	363.60	362.90	366.12	367.74	364.41	363.64
21	Dp-Grate	DI - 109	20	0.21	5.0	7.25	0.70	1.07	7.85	108.304	15	0.013	1.48	365.30	363.70	367.82	366.12	365.71 j	364.41
22	Comb.	CB - 114	18	0.23	6.2	6.91	0.70	2.76	6.52	103.000	15	0.013	1.02	363.40	362.35	368.20	367.20	364.07	362.92
23	Comb.	CB - 115	22	0.34	5.0	7.25	0.70	1.73	6.69	102.500	15	0.013	1.07	364.60	363.50	369.23	368.20	365.12 j	364.07

Project File: SCM1.stm

Number of lines: 28

Date: 10/30/2024

NOTES: Intensity = 86.72 / (Inlet time + 15.30) ^ 0.82 -- Return period = 10 Yrs. ; ** Critical depth

Pipes


Line No.	Junct Type	Inlet ID	DnStm Ln No	Drng Area (ac)	Tc (min)	i Sys (in/hr)	Runoff Coeff (C)	Total Runoff (cfs)	Capac Full (cfs)	Line Length (ft)	Line Size (in)	n-val Pipe	Line Slope (%)	Invert Up (ft)	Invert Dn (ft)	Gnd/Rim El Up (ft)	Gnd/Rim El Dn (ft)	HGL Up (ft)	HGL Dn (ft)
24	Comb.	CB - 111	14	0.19	6.0	6.97	0.70	4.88	6.78	59.000	15	0.013	1.10	361.10	360.45	366.32	365.72	362.00 j	361.72
25	Comb.	CB - 112	24	0.38	5.3	7.17	0.70	4.06	6.02	138.206	15	0.013	0.87	362.40	361.20	367.71	366.32	363.22	362.00
26	Comb.	CB - 113	25	0.43	5.0	7.25	0.70	2.18	6.46	29.946	15	0.013	1.00	362.80	362.50	367.78	367.71	363.39 j	363.22
27	Comb.	CB - 116	14	0.33	5.0	7.25	0.70	1.67	8.68	30.442	15	0.013	1.81	361.00	360.45	365.82	365.72	361.70	361.72
28	Comb.	CB - 110	13	0.15	5.0	7.25	0.70	0.76	11.42	8.000	15	0.013	3.13	359.70	359.45	364.39	364.40	361.39	361.39

Project File: SCM1.stm	Number of lines: 28	Date: 10/30/2024
------------------------	---------------------	------------------

NOTES: Intensity = 86.72 / (Inlet time + 15.30) ^ 0.82 -- Return period = 10 Yrs. ; ** Critical depth

2. SCM 1: 10-YR HGL Profiles

Hydraflow Storm Sewers Extension for Autodesk® Civil 3D® Plan

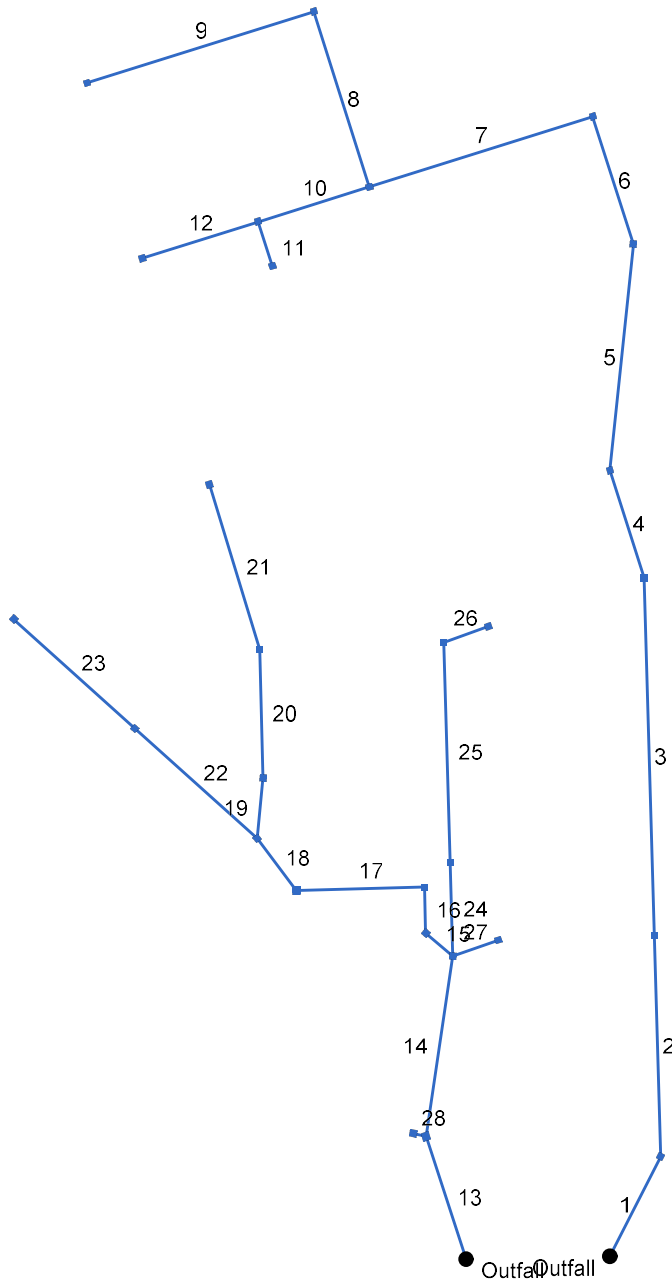


Project File: SCM1.stm


Number of lines: 28

Date: 10/30/2024


Storm Sewer Profile

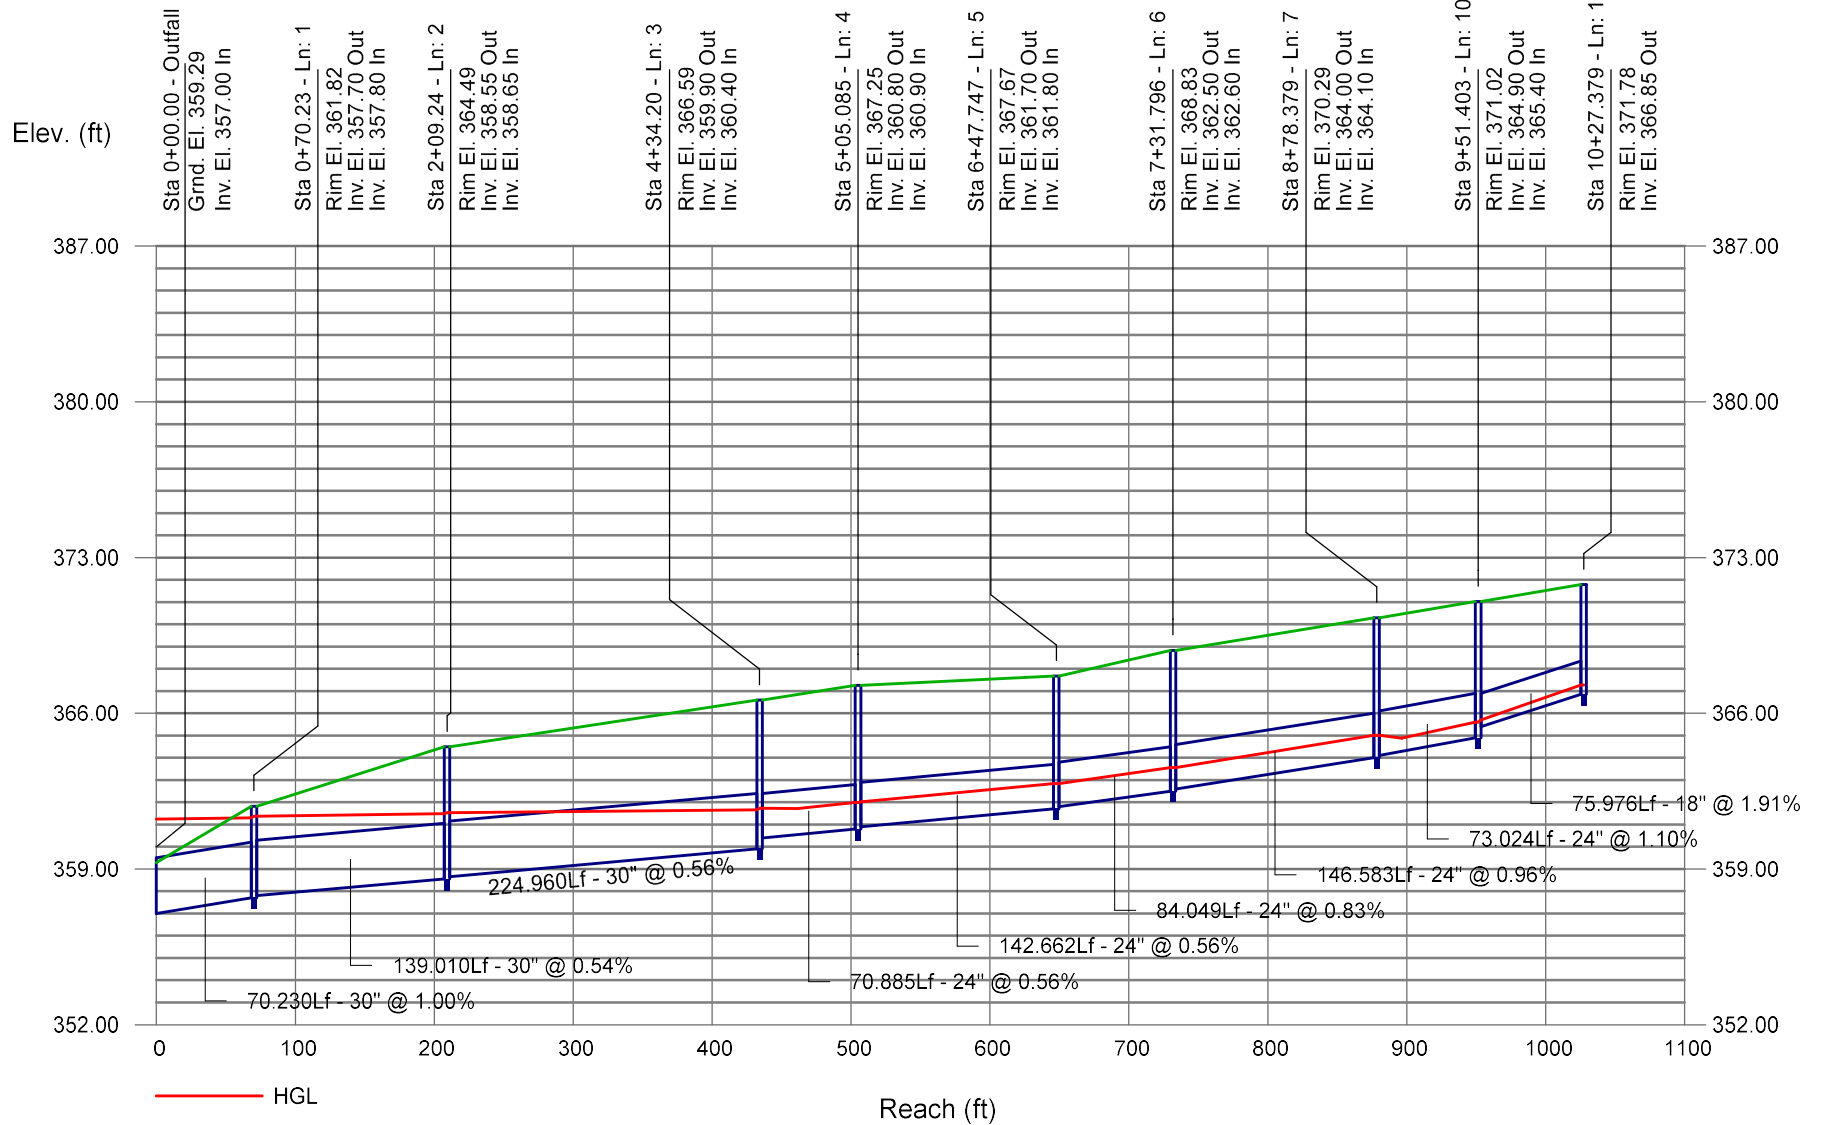


Storm Sewer Profile

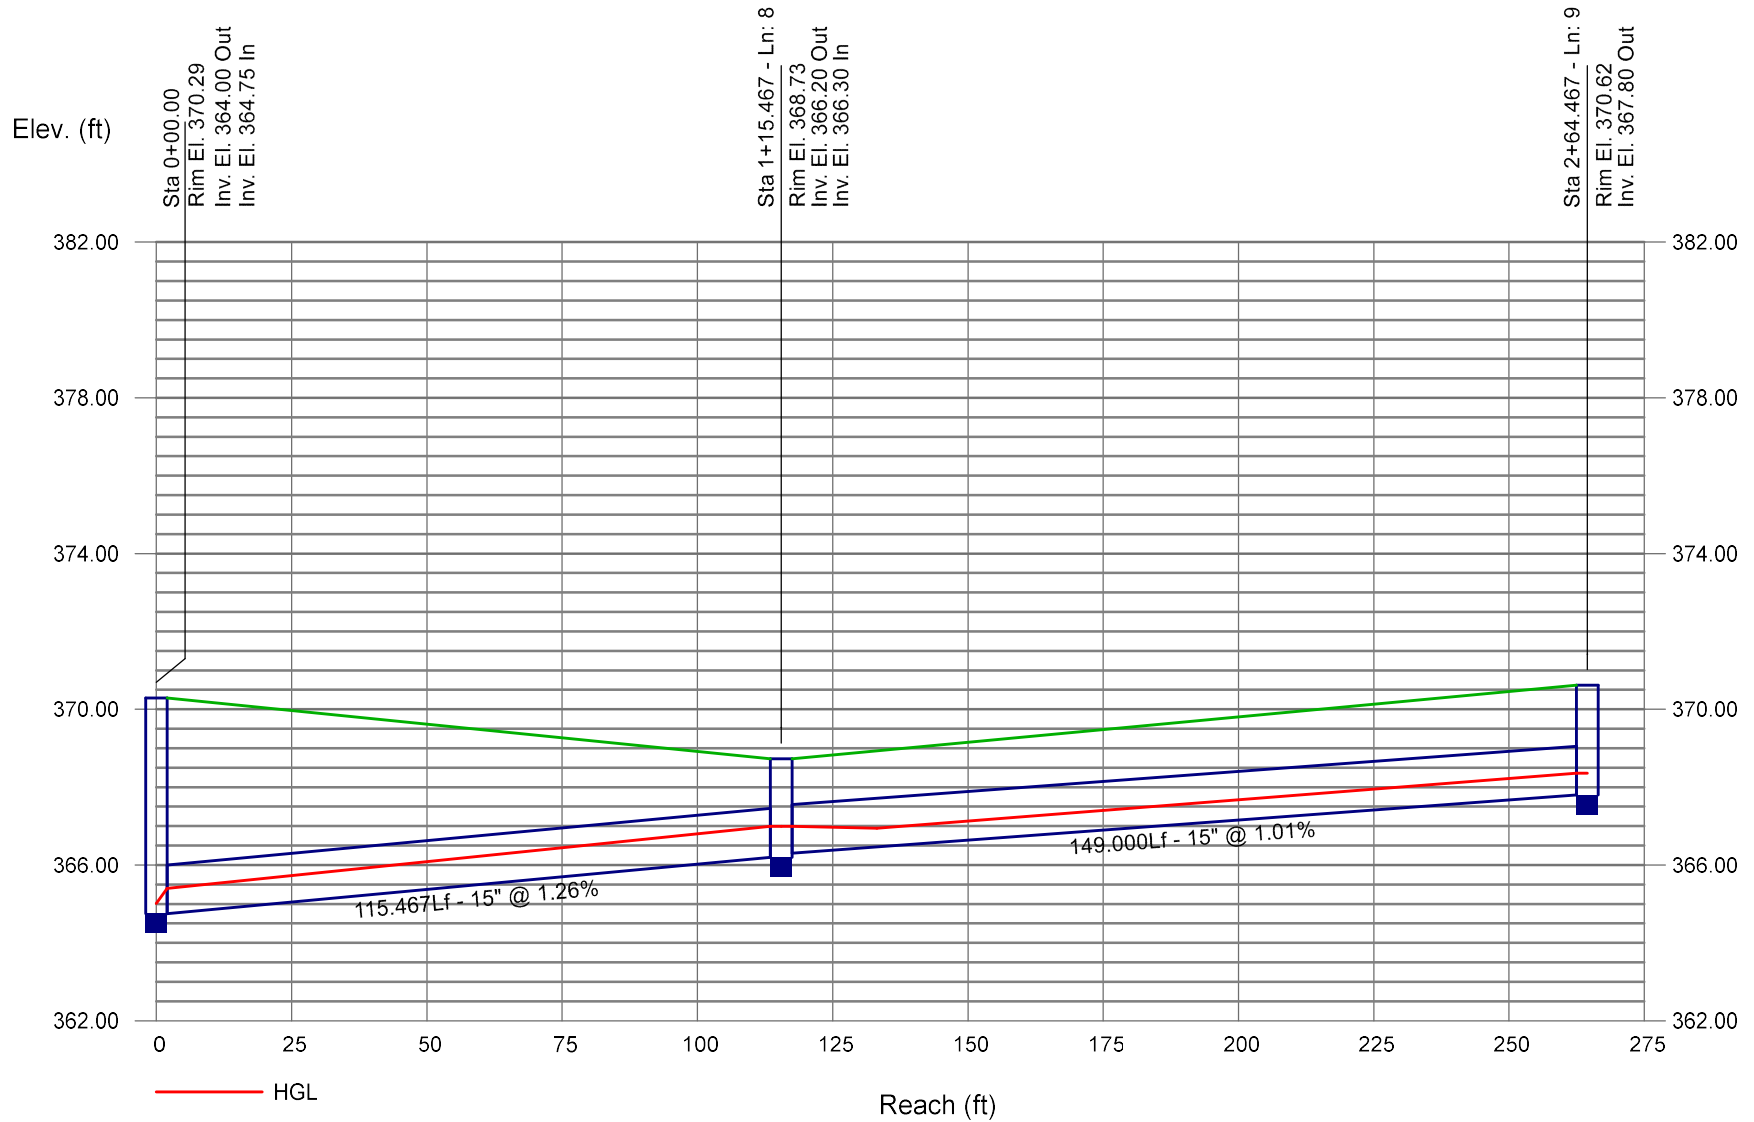


Storm Sewer Profile

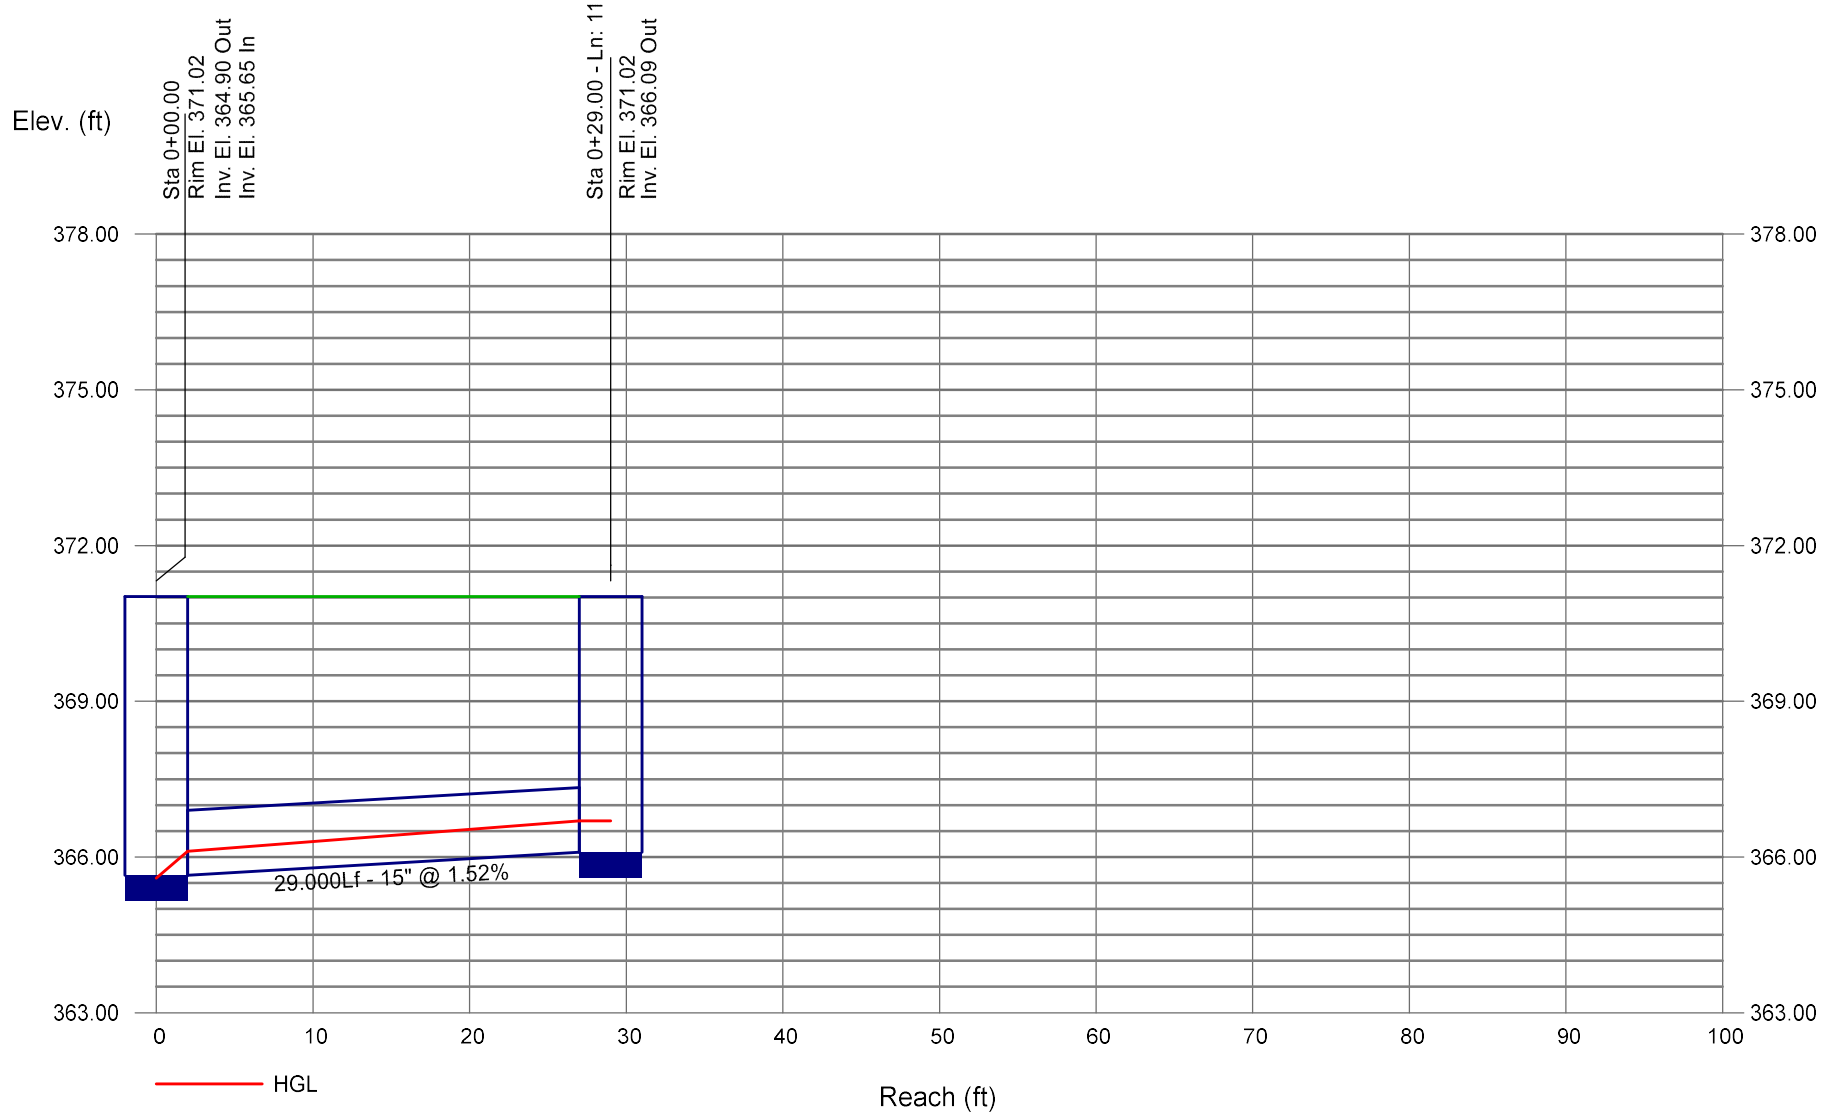


Storm Sewer Profile

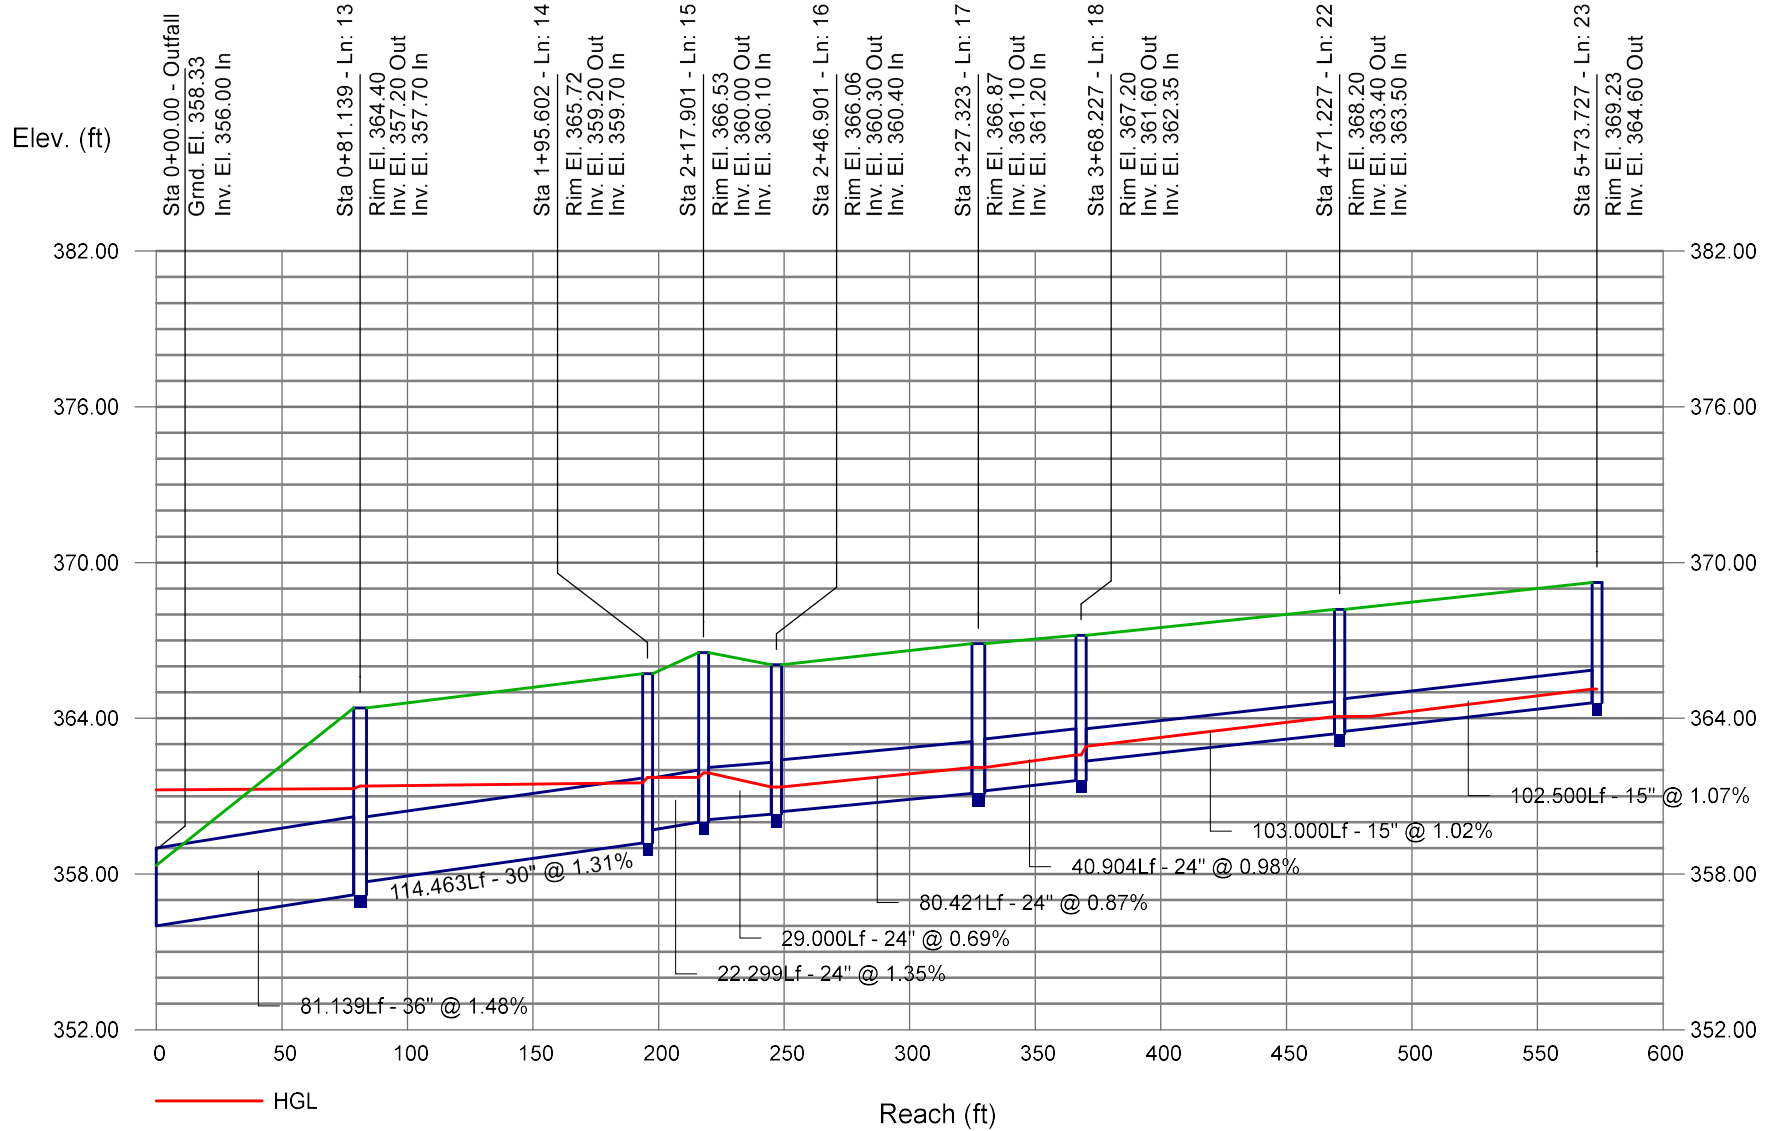


Storm Sewer Profile

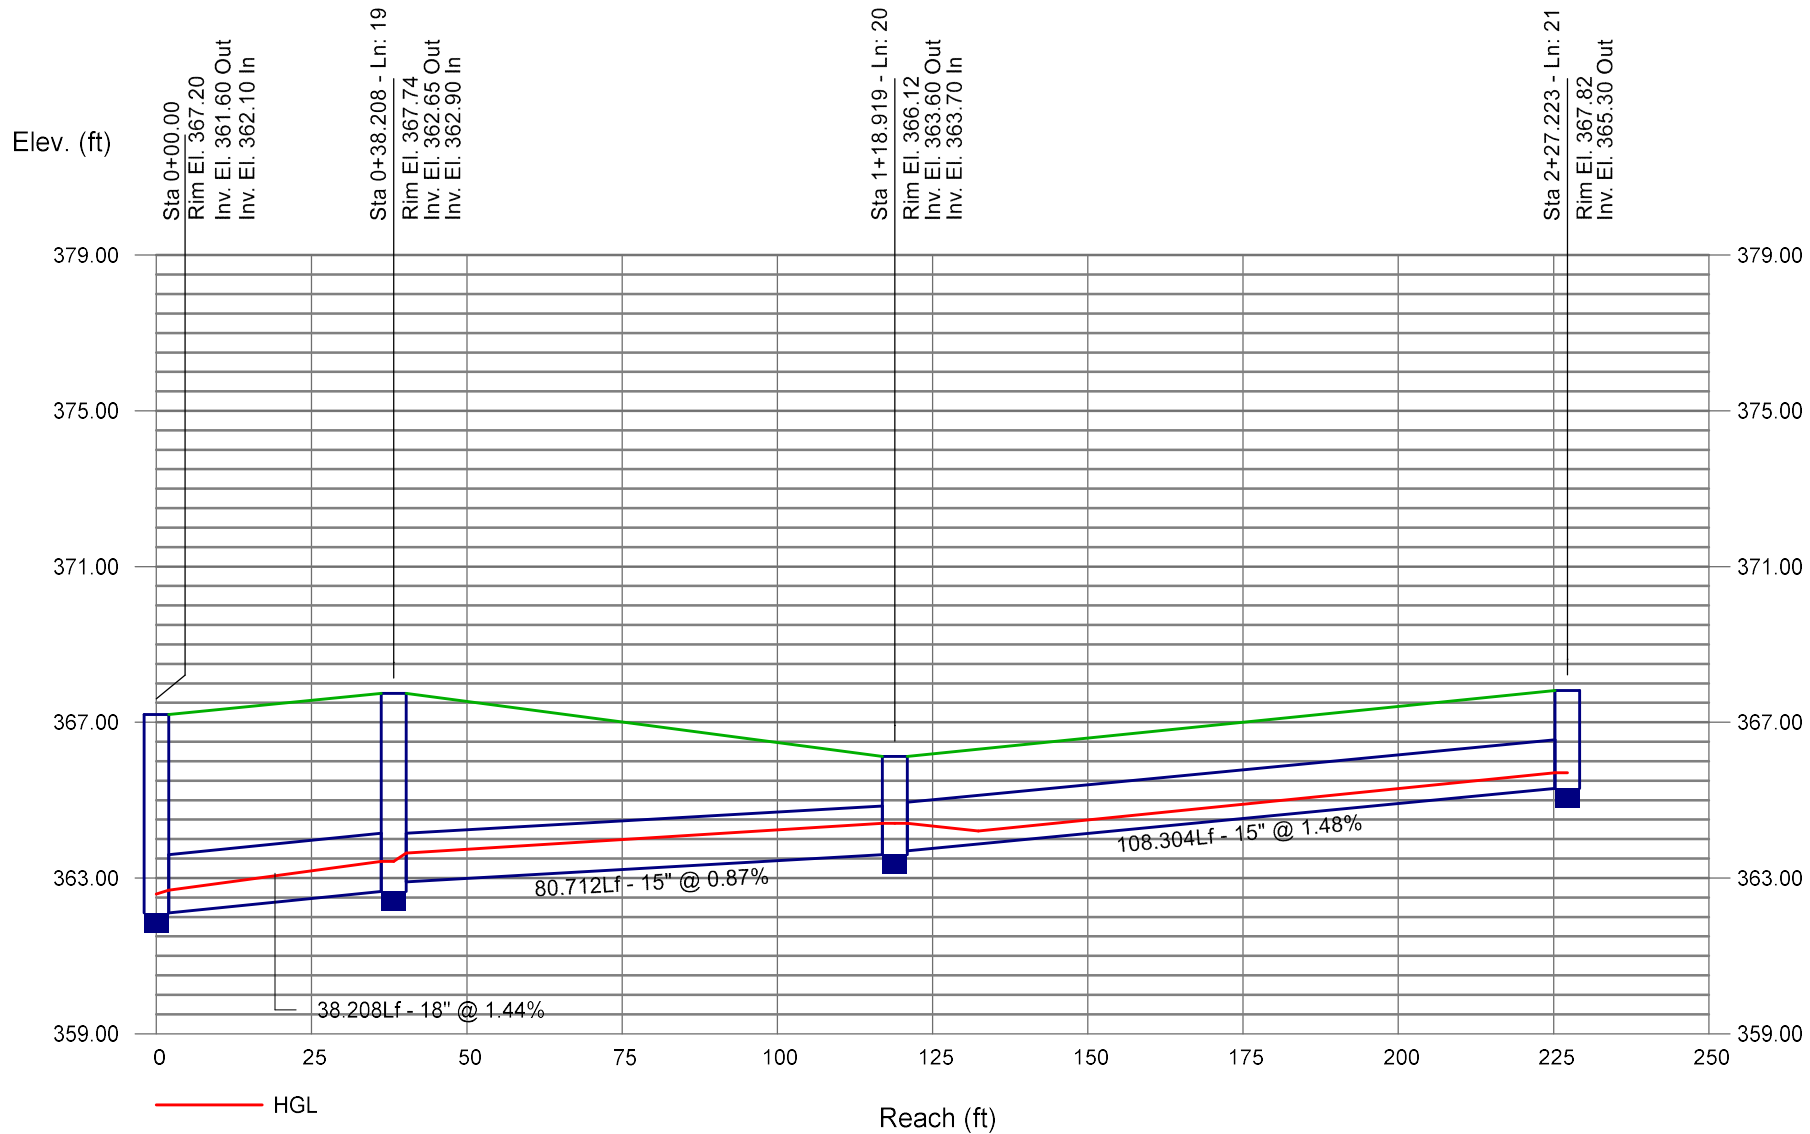


Storm Sewer Profile

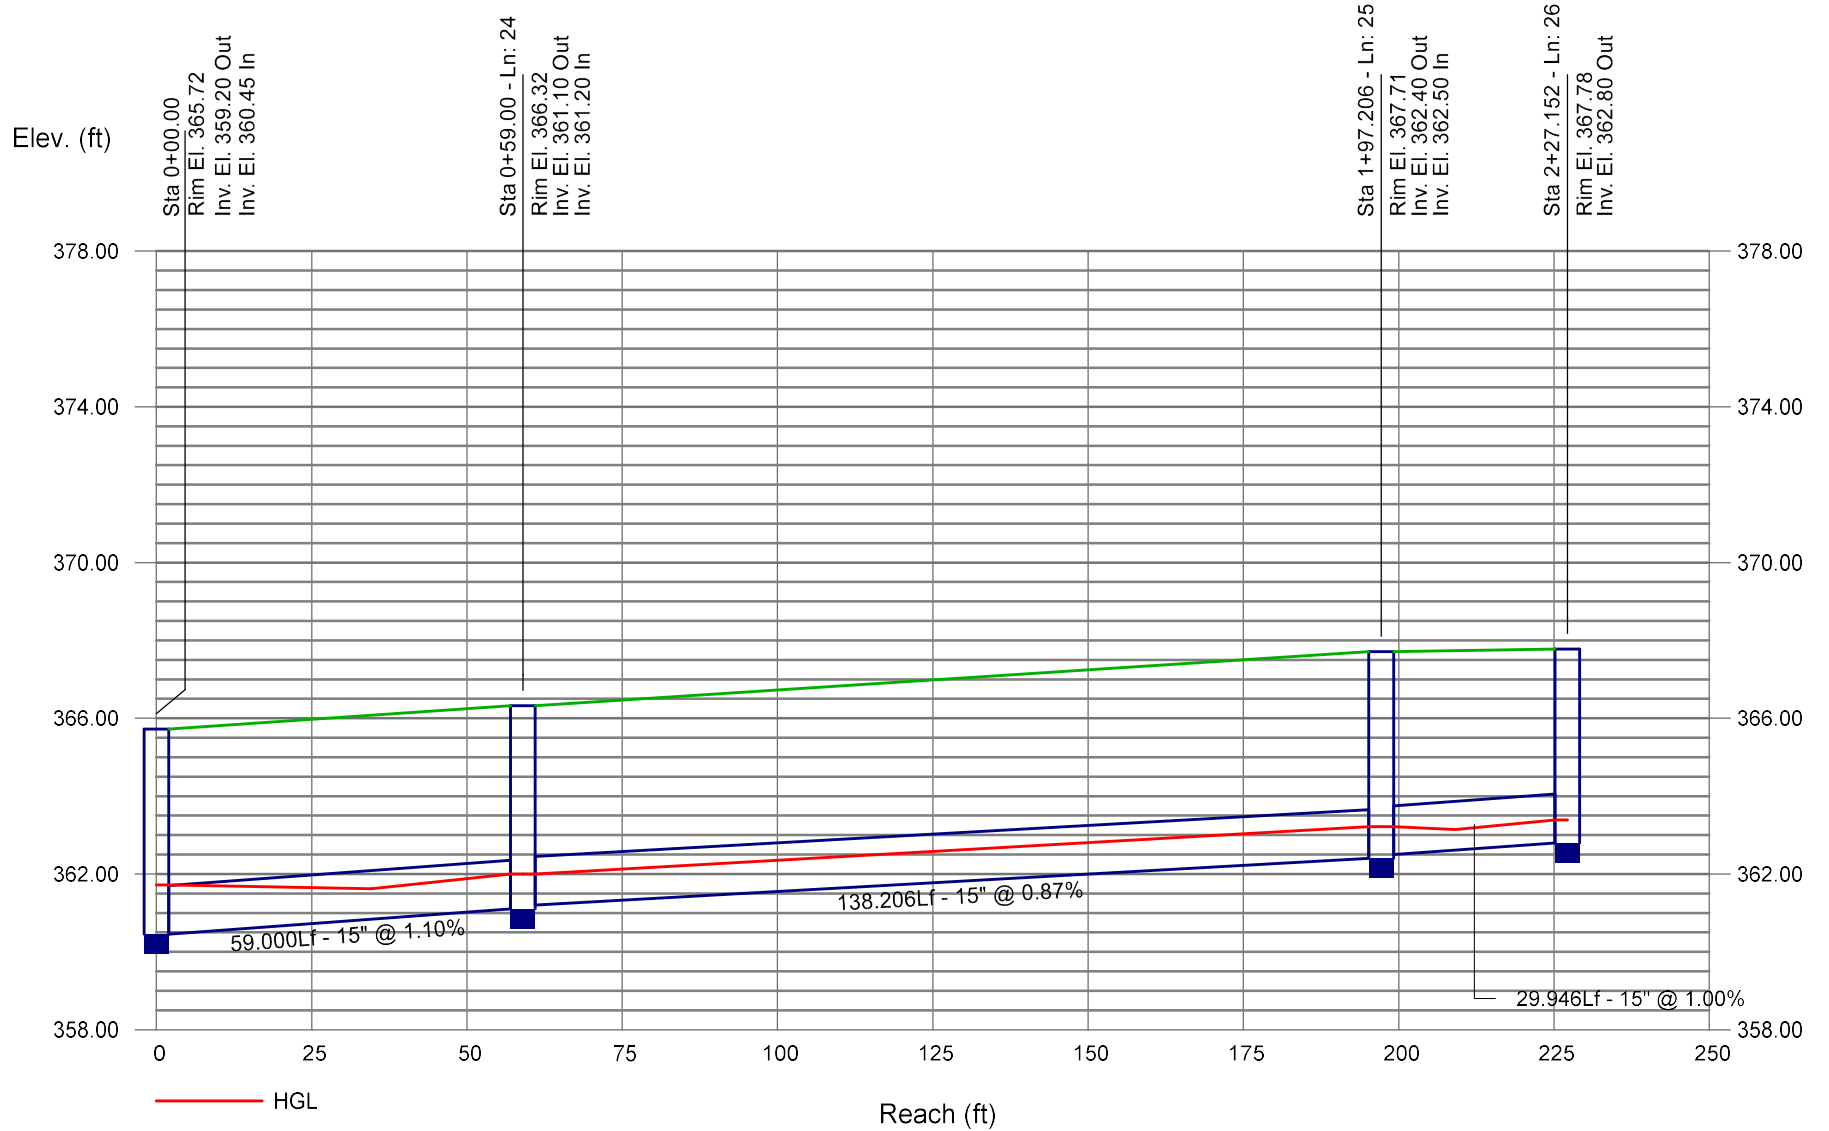

Storm Sewer Profile

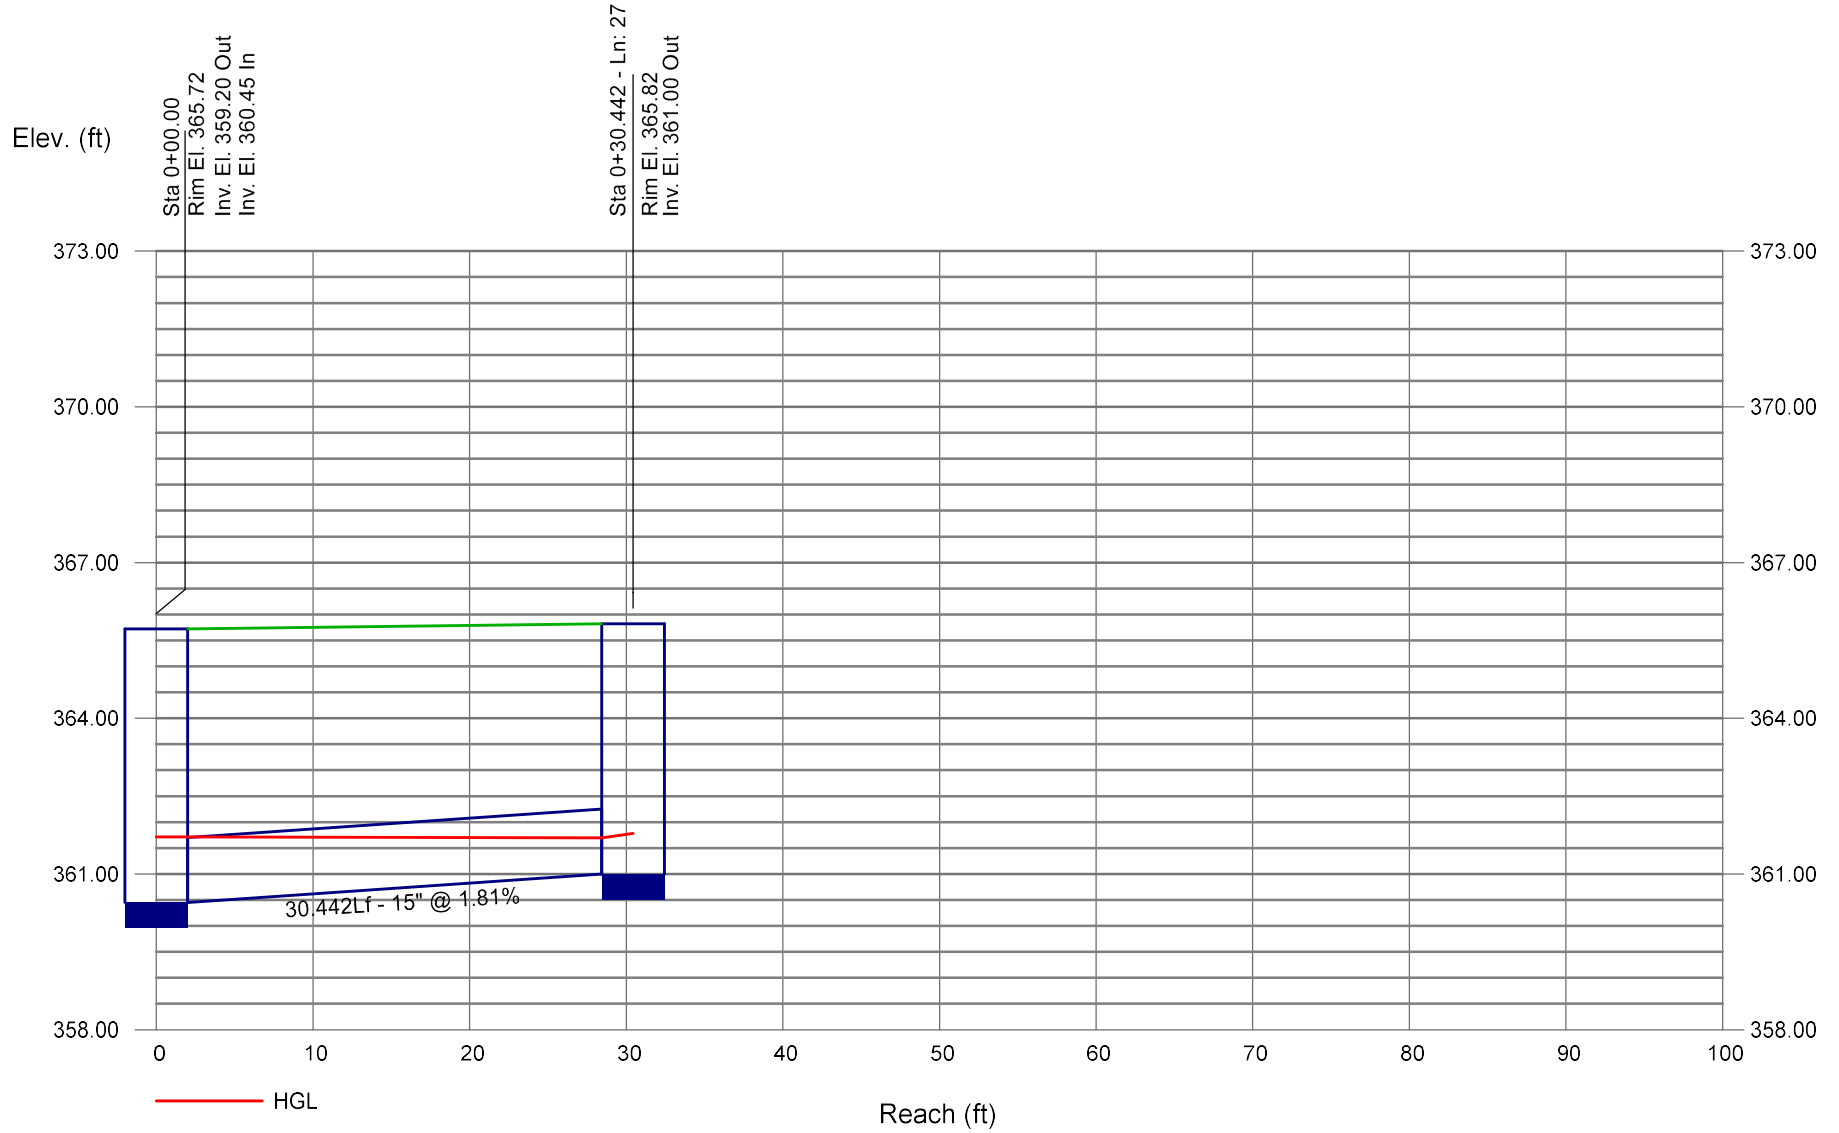

Storm Sewer Profile

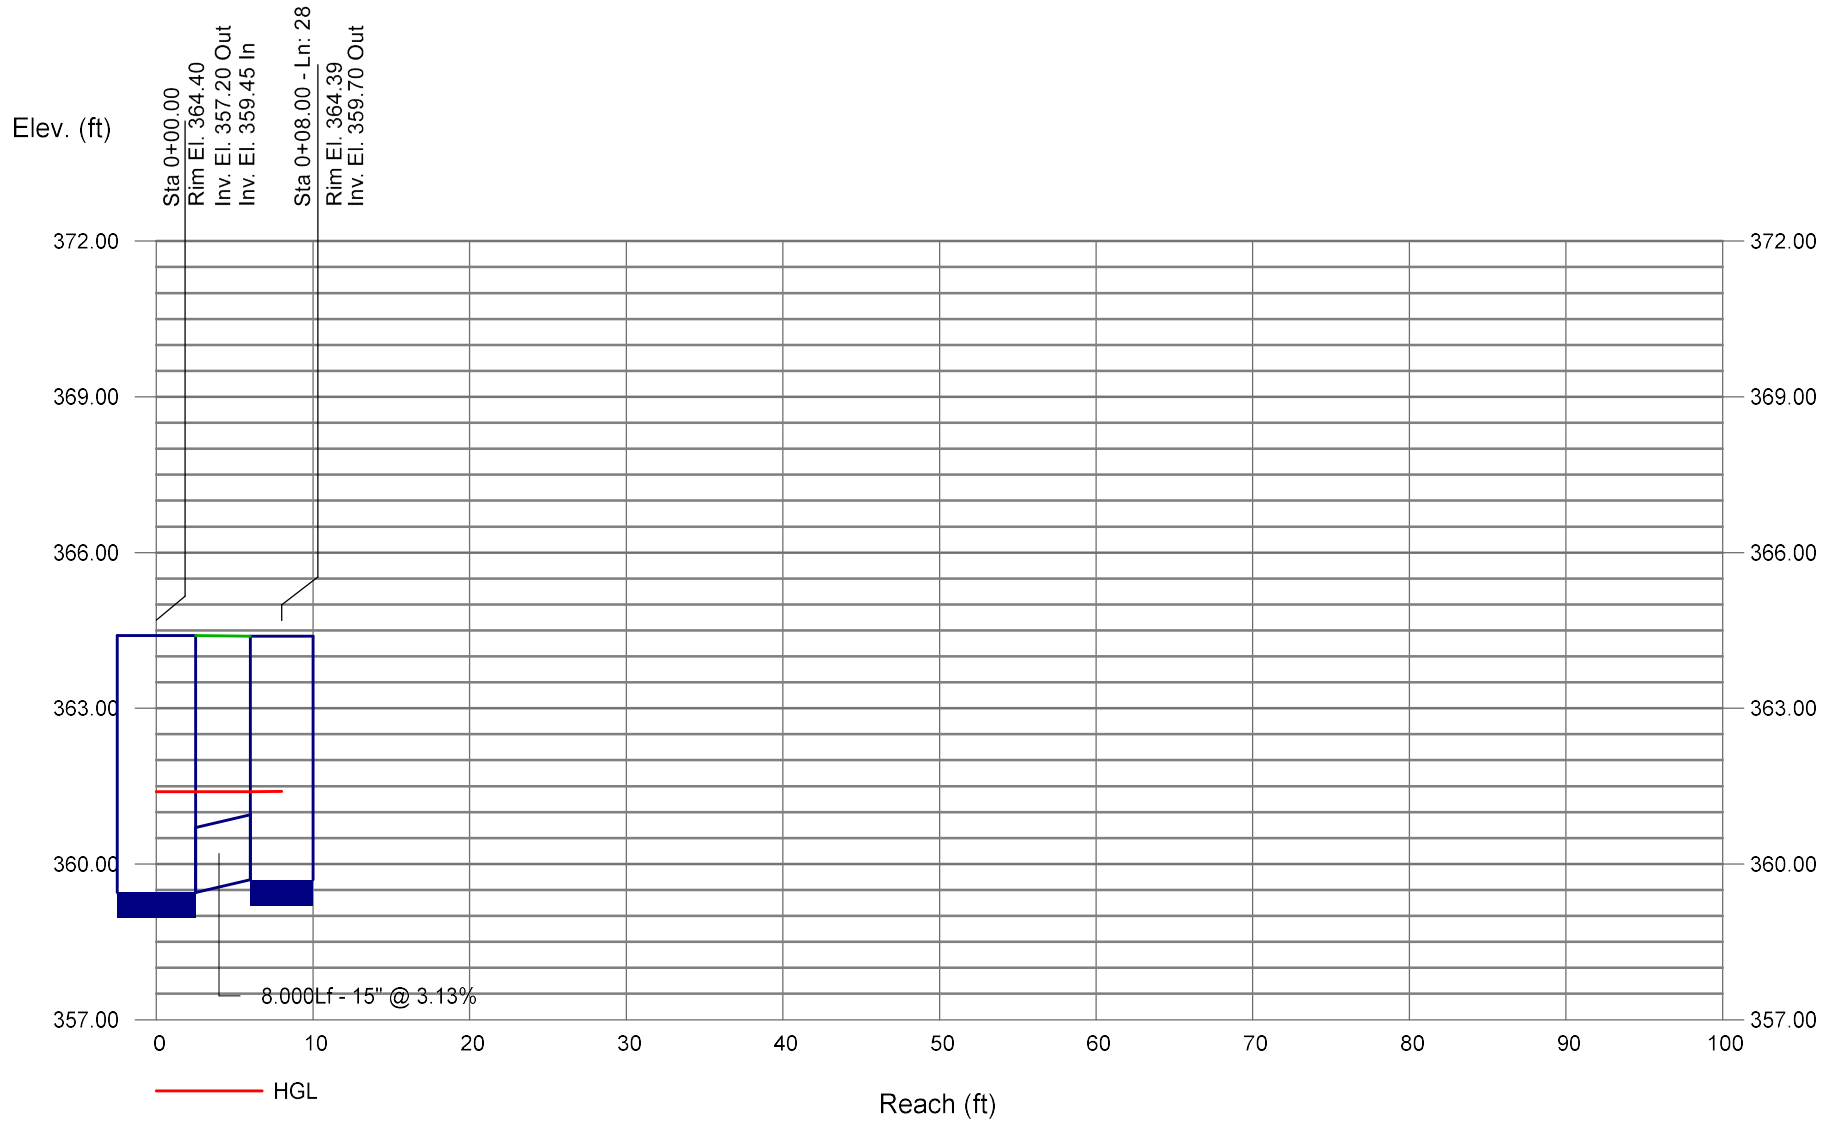

3. SCM 1: 4"/Hour Gutter Spread Chart

Spread

Line No.	Inlet ID	Junct Type	Byp Ln No	Drng Area (ac)	Inlet Time (min)	i Inlet (in/hr)	Runoff Coeff (C)	Incr Q (cfs)	Q Carry (cfs)	Q Capt (cfs)	Q Capt (cfs)	Gutter Spread (ft)
1	DI - 151	Dp-Grate	Sag	0.21	5.0	4.00	0.70	0.59	0.07	0.66	0.66	9.46
2	DI - 152	Dp-Grate	1	0.23	5.0	4.00	0.70	0.64	0.01	0.58	0.58	9.71
3	DI - 153	Dp-Grate	2	0.07	5.0	4.00	0.70	0.20	0.10	0.28	0.28	7.81
4	DI - 154	Dp-Grate	3	0.22	5.0	4.00	0.70	0.62	0.18	0.69	0.69	10.67
5	CB - 155	Comb.	4	0.34	5.0	4.00	0.70	0.95	0.09	0.87	0.87	5.20
6	CB - 156	Comb.	5	0.24	5.0	4.00	0.70	0.67	0.02	0.60	0.60	5.03
7	CB - 157	Comb.	6	0.12	5.0	4.00	0.70	0.34	0.04	0.35	0.35	3.70
8	DI - 160	Dp-Grate	Sag	0.42	5.0	4.00	0.70	1.18	0.19	1.37	1.37	12.88
9	DI - 161	Dp-Grate	8	0.39	5.0	4.00	0.70	1.09	0.00	0.90	0.90	10.67
10	CB - 158	Comb.	7	0.13	5.0	4.00	0.70	0.36	0.10	0.43	0.43	4.14
11	CB - 162	Comb.	25	0.45	5.0	4.00	0.70	1.26	0.00	0.96	0.96	6.58
12	CB - 159	Comb.	10	0.25	5.0	4.00	0.70	0.70	0.00	0.60	0.60	5.06
13	CB - 101	Comb.	28	0.20	5.0	4.00	0.70	0.56	0.27	0.70	0.70	5.49
14	CB - 102	Comb.	28	0.03	5.0	4.00	0.70	0.08	0.15	0.23	0.23	2.87
15	CB - 103	Comb.	Sag	0.02	5.0	4.00	0.70	0.06	0.00	0.06	0.06	0.49
16	CB - 104	Comb.	Sag	0.17	5.0	4.00	0.70	0.48	0.00	0.48	0.48	1.68
17	CB - 105	Comb.	16	0.09	5.0	4.00	0.70	0.25	0.00	0.25	0.25	2.98
18	CB - 106	Comb.	Sag	0.22	5.0	4.00	0.70	0.62	0.00	0.62	0.62	1.92
19	DI - 107	Dp-Grate	20	0.04	5.0	4.00	0.70	0.11	0.00	0.11	0.11	4.95
20	DI - 108	Dp-Grate	Sag	0.64	5.0	4.00	0.70	1.79	0.06	1.85	1.85	14.86
21	DI - 109	Dp-Grate	20	0.21	5.0	4.00	0.70	0.59	0.00	0.53	0.53	8.76
22	CB - 114	Comb.	Sag	0.23	5.0	4.00	0.70	0.64	0.00	0.64	0.64	1.97
23	CB - 115	Comb.	Sag	0.34	5.0	4.00	0.70	0.95	0.00	0.95	0.95	2.09

Project File: SCM1.stm	Number of lines: 28	Date: 10/30/2024
------------------------	---------------------	------------------

NOTES: Intensity = 4.00 / (Inlet time + 0.10) ^ 0.00 -- Return period = 3 Yrs. ; ** Critical depth

Spread

Line No.	Inlet ID	Junct Type	Byp Ln No	Drng Area (ac)	Inlet Time (min)	i Inlet (in/hr)	Runoff Coeff (C)	Incr Q (cfs)	Q Carry (cfs)	Q Capt (cfs)	Q Capt (cfs)	Gutter Spread (ft)
24	CB - 111	Comb.	14	0.19	5.0	4.00	0.70	0.53	0.34	0.72	0.72	5.60
25	CB - 112	Comb.	24	0.38	5.0	4.00	0.70	1.06	0.30	1.02	1.02	6.80
26	CB - 113	Comb.	27	0.43	5.0	4.00	0.70	1.20	0.00	0.93	0.93	6.45
27	CB - 116	Comb.	13	0.33	5.0	4.00	0.70	0.92	0.28	0.93	0.93	6.44
28	CB - 110	Comb.	Sag	0.15	5.0	4.00	0.70	0.42	0.14	0.56	0.56	1.83

Project File: SCM1.stm	Number of lines: 28	Date: 10/30/2024
------------------------	---------------------	------------------

NOTES: Intensity = 4.00 / (Inlet time + 0.10) ^ 0.00 -- Return period = 3 Yrs. ; ** Critical depth

4. SCM 2: 10-YR Storm Drainage Chart

Pipes

Line No.	Junct Type	Inlet ID	DnStm Ln No	Drng Area (ac)	Tc (min)	i Sys (in/hr)	Runoff Coeff (C)	Total Runoff (cfs)	Capac Full (cfs)	Line Length (ft)	Line Size (in)	n-val Pipe	Line Slope (%)	Invert Up (ft)	Invert Dn (ft)	Gnd/Rim El Up (ft)	Gnd/Rim El Dn (ft)	HGL Up (ft)	HGL Dn (ft)
1	Comb.	CB - 201	Outfall	0.38	13.6	5.42	0.60	54.03	98.01	52.684	42	0.013	0.95	357.50	357.00	365.11	361.38	359.80	360.18
2	Comb.	CB - 202	1	0.25	13.5	5.44	0.60	52.93	83.54	29.002	42	0.013	0.69	357.80	357.60	365.10	365.11	360.07	359.80
3	Comb.	CB - 203	2	0.33	13.4	5.45	0.60	29.68	74.27	8.063	36	0.013	1.24	358.40	358.30	365.12	365.10	360.16 j	360.07
4	Comb.	CB - 204	3	0.12	12.6	5.58	0.60	29.30	65.70	200.937	36	0.013	0.97	360.45	358.50	367.36	365.12	362.20	360.16
5	Comb.	CB - 205	4	0.16	12.2	5.64	0.60	28.63	66.51	85.464	36	0.013	0.99	361.40	360.55	368.44	367.36	363.13	362.20
6	Comb.	CB - 206	5	0.15	11.9	5.69	0.60	28.32	37.31	96.667	30	0.013	0.83	362.70	361.90	369.68	368.44	364.51	363.53
7	Comb.	CB - 207	6	0.12	11.7	5.73	0.60	27.55	41.56	87.660	30	0.013	1.03	363.70	362.80	370.80	369.68	365.49	364.51
8	Comb.	CB - 208	7	0.05	11.4	5.78	0.60	27.37	44.11	95.089	30	0.013	1.16	364.90	363.80	371.99	370.80	366.68	365.49
9	Comb.	CB - 209	8	0.32	11.1	5.83	0.60	23.65	32.46	79.814	30	0.013	0.63	365.50	365.00	372.45	371.99	367.15 j	366.68
10	Comb.	CB - 210	9	0.15	11.0	5.85	0.60	22.60	41.71	29.000	30	0.013	1.03	365.90	365.60	372.45	372.45	367.52	367.15
11	Comb.	CB - 211	10	0.13	11.0	5.86	0.60	22.10	71.02	10.003	30	0.013	3.00	366.30	366.00	372.47	372.45	367.90	367.52
12	Comb.	CB - 212	11	0.37	10.6	5.94	0.60	10.65	22.91	87.705	24	0.013	1.03	367.70	366.80	373.38	372.47	368.87	367.90
13	Comb.	CB - 213	12	0.17	9.4	6.17	0.60	9.70	22.24	227.567	24	0.013	0.97	370.00	367.80	376.12	373.38	371.11	368.87
14	Comb.	CB - 214	13	0.17	8.8	6.30	0.60	9.26	16.88	107.703	24	0.013	0.56	370.70	370.10	377.44	376.12	371.79	371.16
15	Comb.	CB - 215	14	0.43	8.4	6.39	0.60	7.59	10.61	107.661	18	0.013	1.02	372.30	371.20	378.76	377.44	373.37	372.14
16	Comb.	CB - 216	15	0.28	8.0	6.48	0.60	6.03	10.53	89.493	18	0.013	1.01	373.30	372.40	379.92	378.76	374.25 j	373.37
17	Comb.	CB - 217	16	0.43	7.8	6.52	0.60	4.97	10.68	29.000	18	0.013	1.03	373.70	373.40	379.92	379.92	374.56	374.25
18	Comb.	CB - 218	17	0.06	7.4	6.61	0.60	3.33	9.37	44.003	18	0.013	0.80	374.15	373.80	380.81	379.92	374.85 j	374.56
19	Comb.	CB - 219	18	0.05	6.9	6.74	0.60	3.16	5.10	88.151	15	0.013	0.62	374.95	374.40	383.30	380.81	375.66	375.11
20	Dp-Grate	DI - 220	19	0.32	6.4	6.85	0.60	3.00	4.86	61.860	15	0.013	0.57	375.40	375.05	378.72	383.30	376.11	375.76
21	Dp-Grate	DI - 221	20	0.41	5.0	7.25	0.60	1.78	5.21	126.067	15	0.012	0.56	376.20	375.50	378.57	378.72	376.73 j	376.25
22	Comb.	CB - 259	14	0.30	5.0	7.25	0.60	1.30	6.46	29.000	15	0.013	1.00	372.40	372.11	377.44	377.44	372.85	372.49
23	Dp-Grate	DI - 252	11	0.04	7.0	6.72	0.60	12.78	18.65	102.986	24	0.013	0.68	367.50	366.80	371.19	372.47	368.78	368.02

Project File: SCM2.stm

Number of lines: 59

Date: 10/30/2024

NOTES: Intensity = 86.72 / (Inlet time + 15.30) ^ 0.82 -- Return period = 10 Yrs. ; ** Critical depth

Pipes

Line No.	Junct Type	Inlet ID	DnStm Ln No	Drng Area (ac)	Tc (min)	i Sys (in/hr)	Runoff Coeff (C)	Total Runoff (cfs)	Capac Full (cfs)	Line Length (ft)	Line Size (in)	n-val Pipe	Line Slope (%)	Invert Up (ft)	Invert Dn (ft)	Gnd/Rim El Up (ft)	Gnd/Rim El Dn (ft)	HGL Up (ft)	HGL Dn (ft)
24	Dp-Grate	DI - 253	23	0.49	6.1	6.94	0.60	7.82	8.41	128.054	15	0.012	1.44	370.10	368.25	372.51	371.19	371.21	369.20
25	Dp-Grate	DI - 254	24	0.65	5.7	7.05	0.60	5.88	6.98	120.501	15	0.012	1.00	371.40	370.20	373.77	372.51	372.38 j	371.21
26	Dp-Grate	DI - 255	25	0.74	5.0	7.25	0.60	3.22	8.69	110.183	15	0.012	1.54	373.20	371.50	376.01	373.77	373.92 j	372.38
27	Comb.	CB - 246	8	0.48	9.9	6.07	0.60	3.93	11.17	45.124	15	0.013	2.99	367.50	366.15	373.16	371.99	368.30	366.68
28	Comb.	CB - 247	27	0.31	9.6	6.12	0.60	2.20	6.57	29.000	15	0.013	1.03	367.90	367.60	373.16	373.16	368.49 j	368.30
29	Comb.	CB - 248	28	0.06	6.7	6.78	0.60	1.18	6.86	177.392	15	0.013	1.13	370.00	368.00	374.93	373.16	370.43 j	368.49
30	Comb.	CB - 249	29	0.06	5.8	7.02	0.60	0.97	5.32	44.247	15	0.013	0.68	370.40	370.10	375.87	374.93	370.79	370.46
31	Comb.	CB - 250	30	0.17	5.0	7.25	0.60	0.74	6.57	29.000	15	0.013	1.03	370.80	370.50	375.87	375.87	371.14	370.79
32	Comb.	CB - 222	2	0.08	12.7	5.56	0.60	15.96	38.37	159.905	30	0.013	0.88	360.20	358.80	366.88	365.10	361.55	360.07
33	Comb.	CB - 223	32	0.12	12.3	5.62	0.60	15.88	31.31	85.806	30	0.013	0.58	360.80	360.30	368.03	366.88	362.14	361.56
34	Comb.	CB - 224	33	0.11	11.9	5.69	0.60	14.54	32.42	80.026	30	0.013	0.62	361.40	360.90	369.10	368.03	362.68	362.14
35	Comb.	CB - 225	34	0.09	11.5	5.76	0.60	14.35	32.41	80.055	30	0.013	0.62	362.00	361.50	370.18	369.10	363.27	362.68
36	Comb.	CB - 226	35	0.05	11.1	5.84	0.70	13.60	29.94	75.072	30	0.013	0.53	362.50	362.10	371.18	370.18	363.74	363.28
37	Comb.	CB - 227	36	0.41	10.9	5.88	0.70	13.50	31.13	43.390	30	0.013	0.58	362.85	362.60	371.79	371.18	364.08	363.75
38	Comb.	CB - 228	37	0.15	10.7	5.90	0.70	11.85	18.78	29.000	24	0.013	0.69	363.55	363.35	371.79	371.79	364.79	364.50
39	Comb.	CB - 229	38	0.28	10.4	5.98	0.70	5.98	14.25	89.567	18	0.013	1.84	365.70	364.05	372.69	371.79	366.64	364.79
40	Dp-Grate	DI - 230	39	0.35	9.2	6.20	0.60	2.98	7.84	125.500	18	0.013	0.56	366.50	365.80	369.29	372.69	367.16	366.64
41	Dp-Grate	DI - 231	40	0.24	7.8	6.51	0.60	1.76	10.32	130.989	15	0.012	2.18	369.60	366.75	372.29	369.29	370.13	367.16
42	Dp-Grate	DI - 232	41	0.21	5.0	7.25	0.60	0.91	7.37	126.000	15	0.012	1.11	371.10	369.70	373.55	372.29	371.47 j	370.13
43	Comb.	CB - 240	39	0.27	5.5	7.10	0.60	2.30	8.44	172.708	15	0.013	1.71	369.00	366.05	374.43	372.69	369.61	366.64
44	Comb.	CB - 241	43	0.27	5.0	7.25	0.60	1.17	6.57	29.000	15	0.013	1.03	369.40	369.10	374.43	374.43	369.83 j	369.61
45	Dp-Grate	DI - 256	23	0.95	6.9	6.73	0.60	5.05	6.66	16.568	15	0.012	0.91	368.40	368.25	370.86	371.19	369.31	369.06
46	Dp-Grate	DI - 257	45	0.30	5.0	7.25	0.60	1.30	6.96	121.239	15	0.012	0.99	369.70	368.50	372.01	370.86	370.15 j	369.31

Project File: SCM2.stm

Number of lines: 59

Date: 10/30/2024

NOTES: Intensity = 86.72 / (Inlet time + 15.30) ^ 0.82 -- Return period = 10 Yrs. ; ** Critical depth

Pipes

Line No.	Junct Type	Inlet ID	DnStm Ln No	Drng Area (ac)	Tc (min)	i Sys (in/hr)	Runoff Coeff (C)	Total Runoff (cfs)	Capac Full (cfs)	Line Length (ft)	Line Size (in)	n-val Pipe	Line Slope (%)	Invert Up (ft)	Invert Dn (ft)	Gnd/Rim El Up (ft)	Gnd/Rim El Dn (ft)	HGL Up (ft)	HGL Dn (ft)
47	Comb.	CB - 235	38	0.03	6.3	6.89	0.70	6.22	17.08	43.798	24	0.013	0.57	363.90	363.65	371.87	371.79	364.78 j	364.79
48	Comb.	CB - 236	47	0.24	5.6	7.07	0.70	6.23	7.85	143.298	18	0.013	0.56	365.20	364.40	370.79	371.87	366.21	365.41
49	Comb.	CB - 237	48	0.49	5.6	7.08	0.70	5.06	8.30	8.000	18	0.013	0.63	365.35	365.30	370.79	370.79	366.21	366.40
50	Comb.	CB - 238	49	0.44	5.4	7.14	0.70	2.65	5.36	29.000	15	0.013	0.69	365.80	365.60	370.79	370.79	366.45	366.22
51	Comb.	CB - 239	50	0.09	5.0	7.25	0.70	0.46	7.17	8.100	15	0.013	1.23	366.30	366.20	370.79	370.79	366.56	366.45
52	Comb.	CB - 234	35	0.15	5.0	7.25	0.70	0.76	6.57	29.010	15	0.013	1.03	365.20	364.90	370.18	370.18	365.54	365.19
53	Comb.	CB - 258	6	0.14	5.0	7.25	0.60	0.61	8.04	29.000	15	0.013	1.55	364.40	363.95	369.68	369.68	364.70 j	364.51
54	Comb.	CB - 233	33	0.33	5.0	7.25	0.60	1.44	6.57	29.000	15	0.013	1.03	363.00	362.70	368.03	368.03	363.47	363.10
55	Dp-Grate	DI - 242	2	0.51	6.9	6.72	0.60	8.51	10.89	125.500	18	0.013	1.08	361.15	359.80	365.97	365.10	362.28	360.80
56	Dp-Grate	DI - 243	55	0.32	6.3	6.88	0.60	3.55	6.93	107.000	15	0.012	0.98	362.45	361.40	367.07	365.97	363.21 j	362.28
57	Dp-Grate	DI - 244	56	0.54	5.0	7.25	0.60	2.35	7.04	153.000	15	0.012	1.01	364.10	362.55	366.33	367.07	364.71 j	363.21
58	Comb.	CB - 260	4	0.17	5.0	7.25	0.60	0.74	6.57	29.000	15	0.013	1.03	362.50	362.20	367.36	367.36	362.84	362.48
59	Dp-Grate	DI - 245	55	0.74	5.0	7.25	0.60	3.22	5.24	107.000	15	0.012	0.56	362.00	361.40	364.40	365.97	362.72	362.28

Project File: SCM2.stm


Number of lines: 59

Date: 10/30/2024

NOTES: Intensity = 86.72 / (Inlet time + 15.30) ^ 0.82 -- Return period = 10 Yrs. ; ** Critical depth

5. SCM 2: 10-YR HGL Profiles

Hydraflow Storm Sewers Extension for Autodesk® Civil 3D® Plan

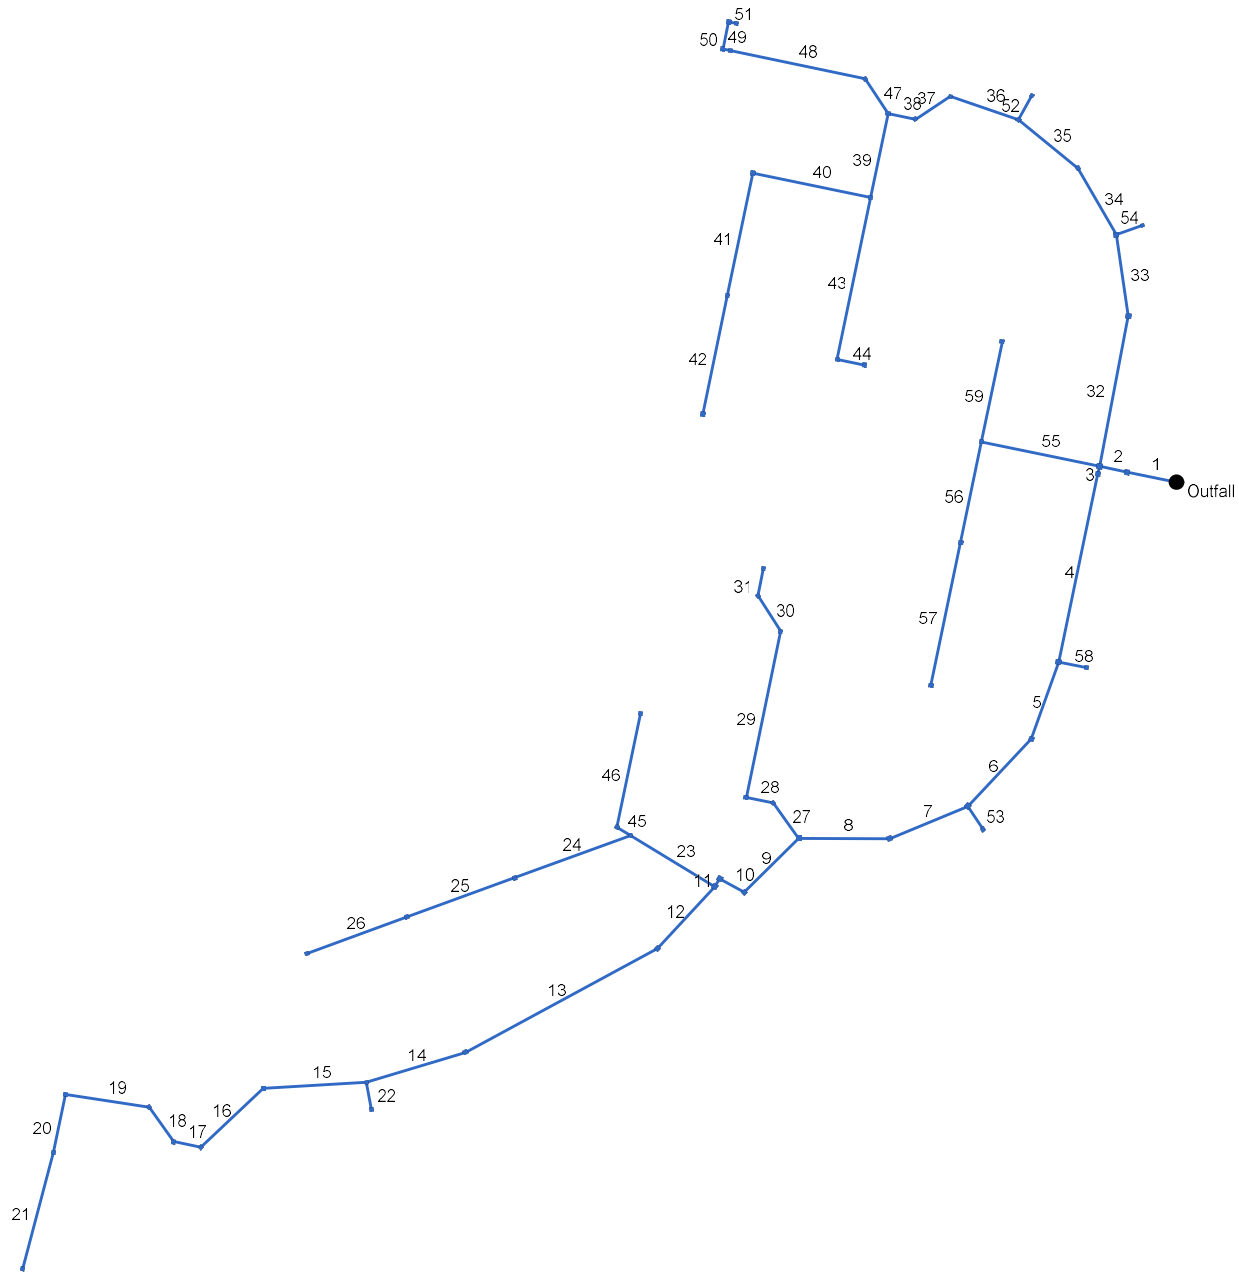


Project File: SCM2.stm


Number of lines: 59

Date: 10/30/2024


Storm Sewer Profile

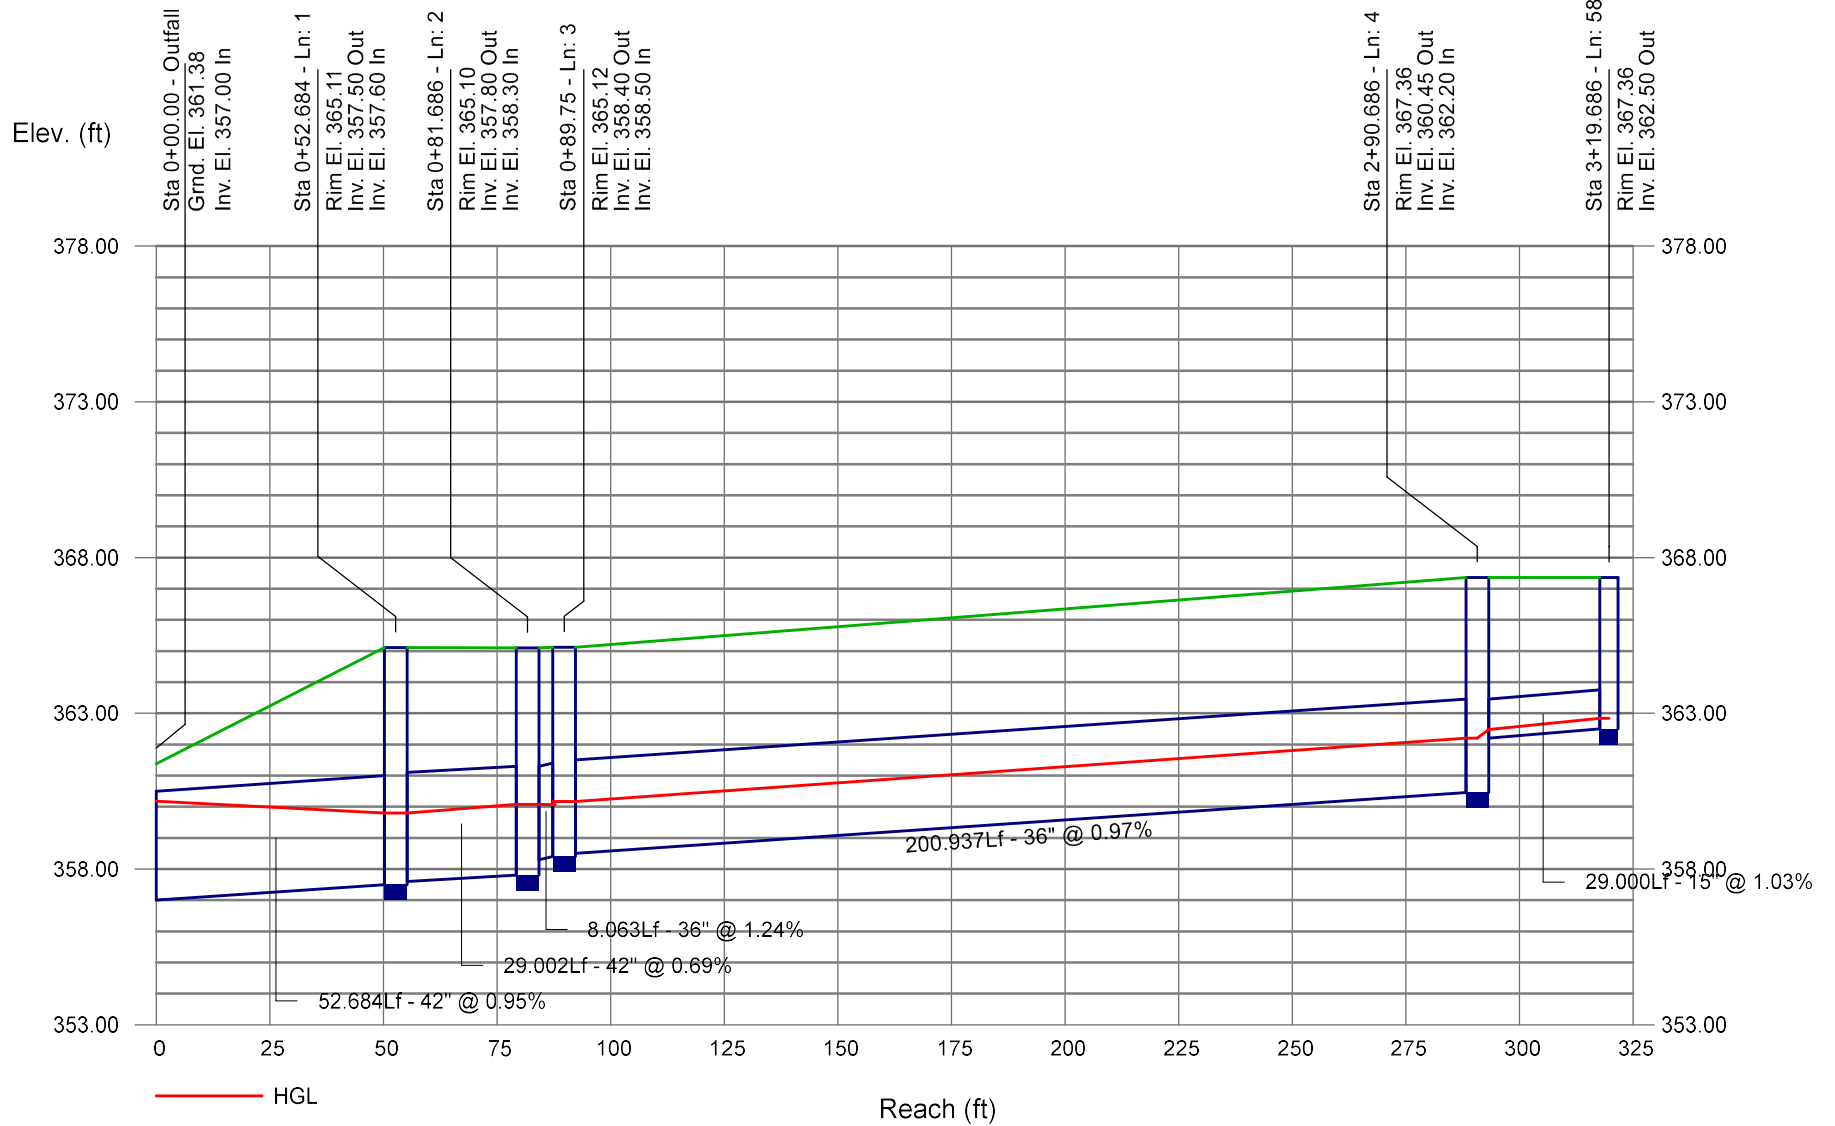


Storm Sewer Profile

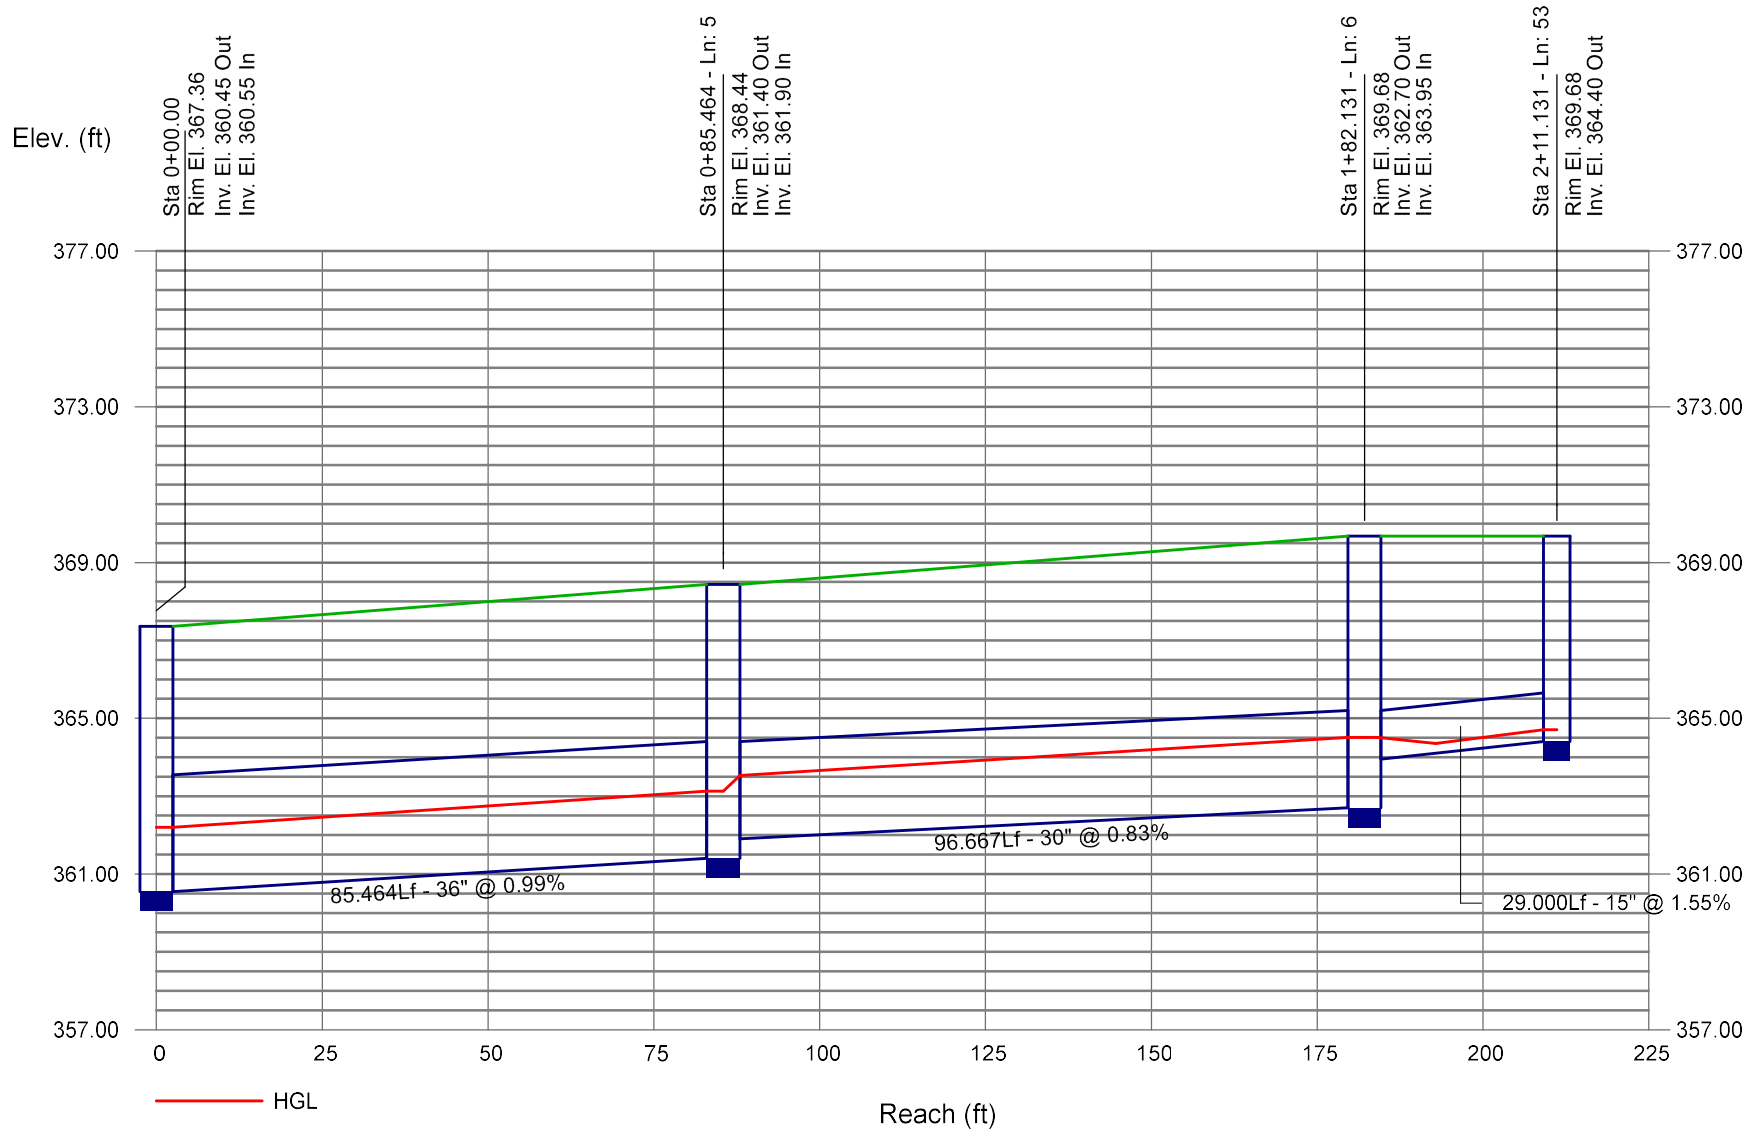


Storm Sewer Profile

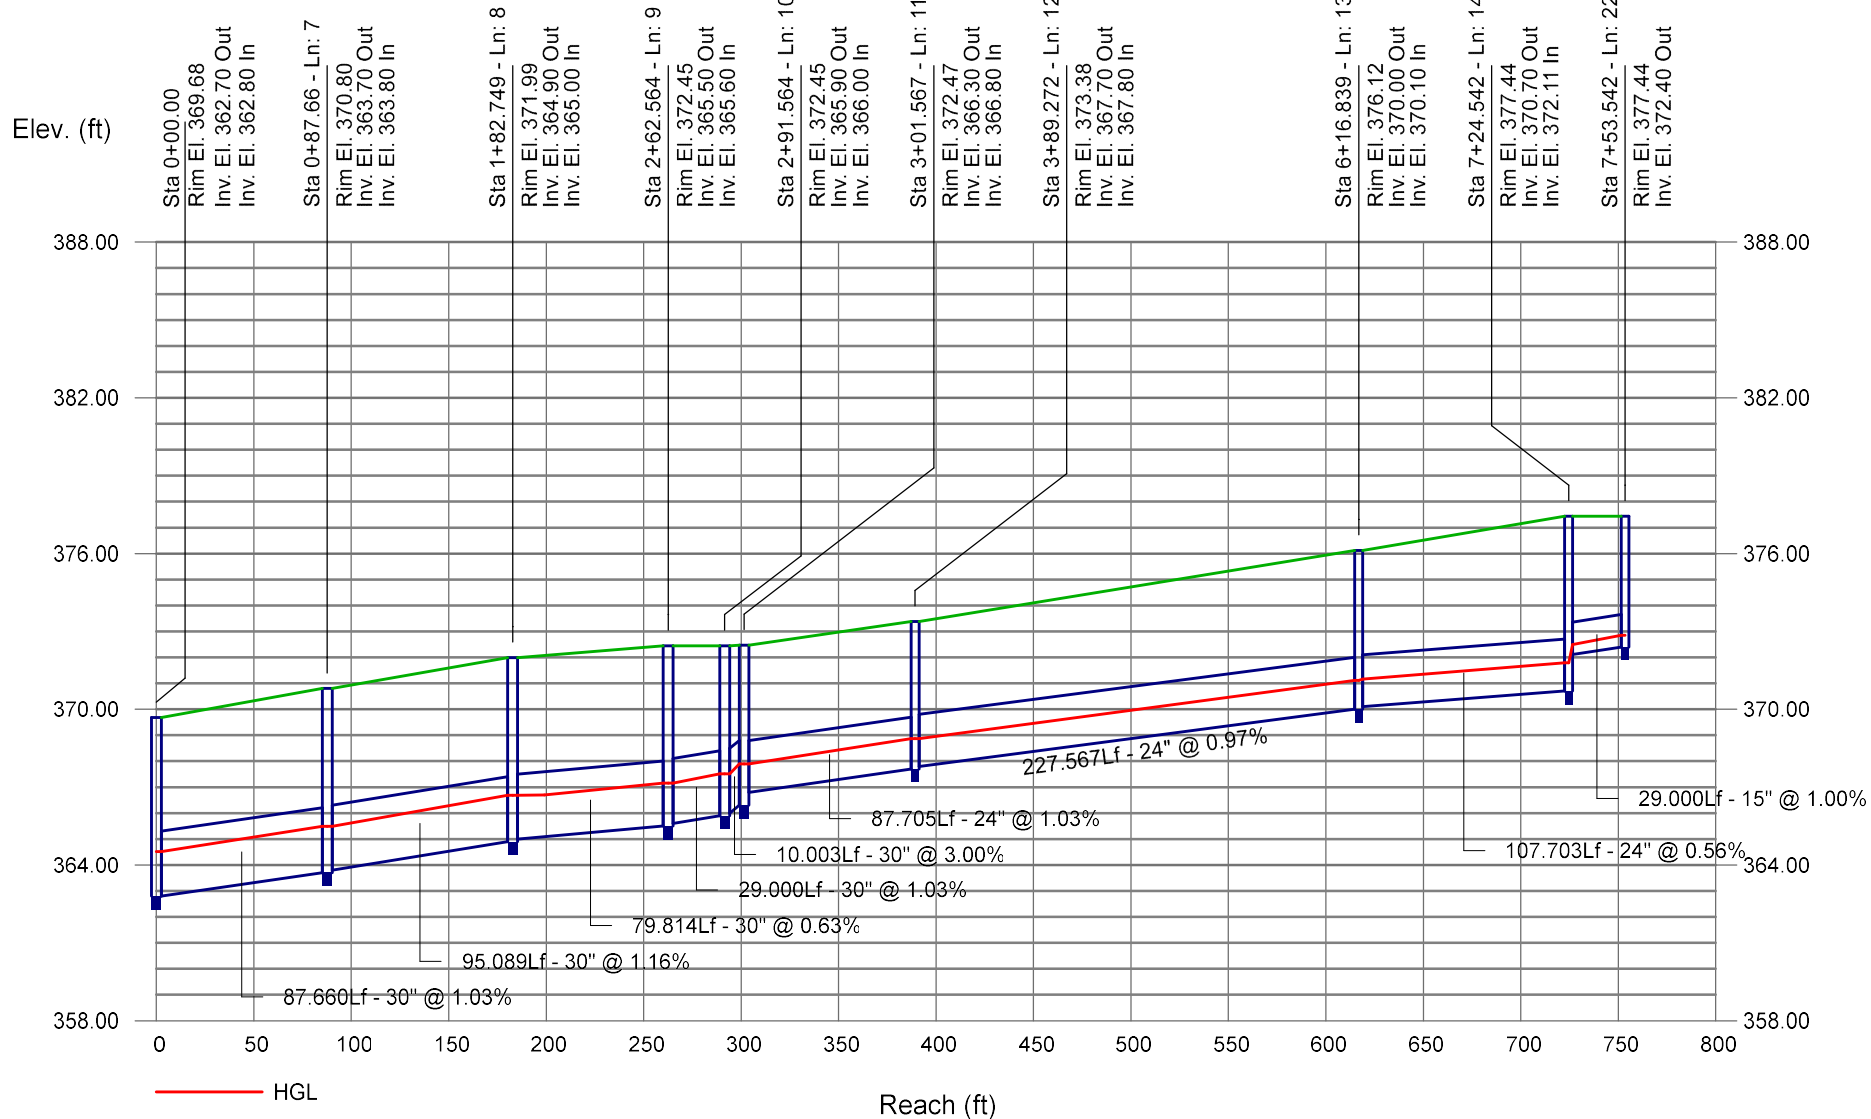


Storm Sewer Profile

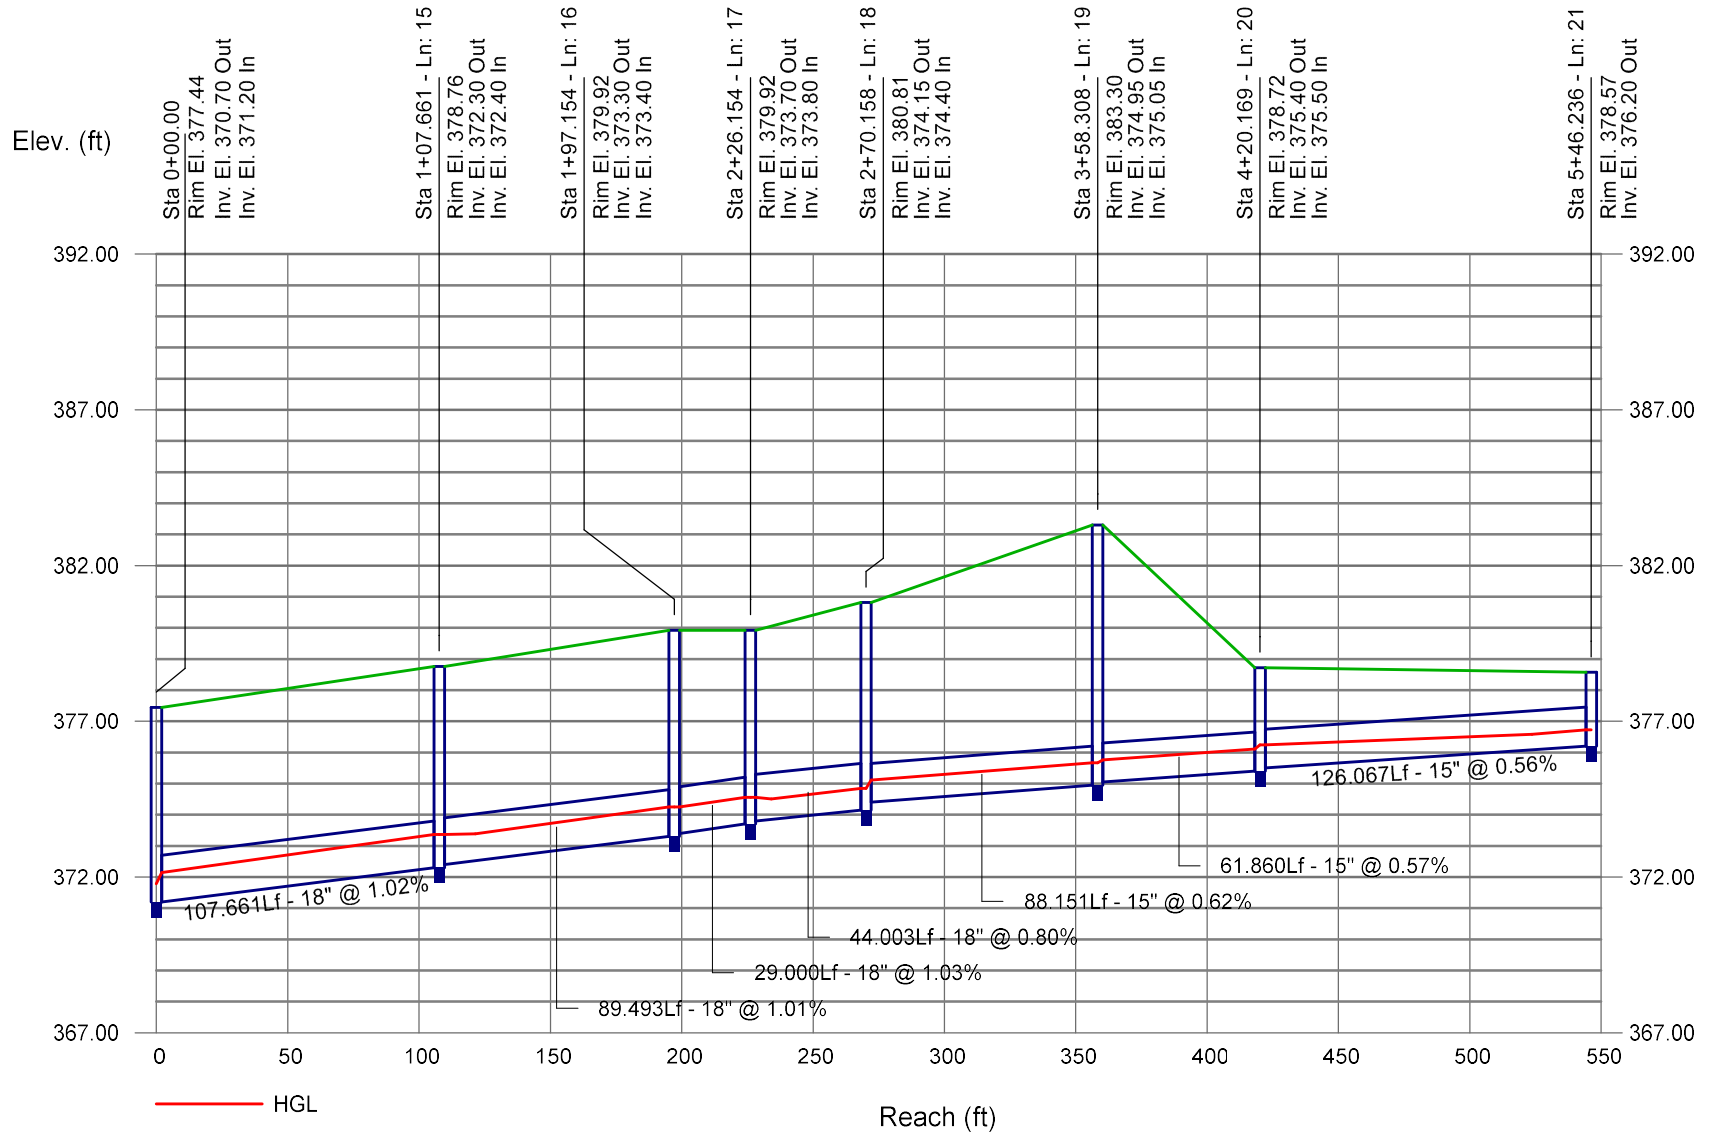


Storm Sewer Profile

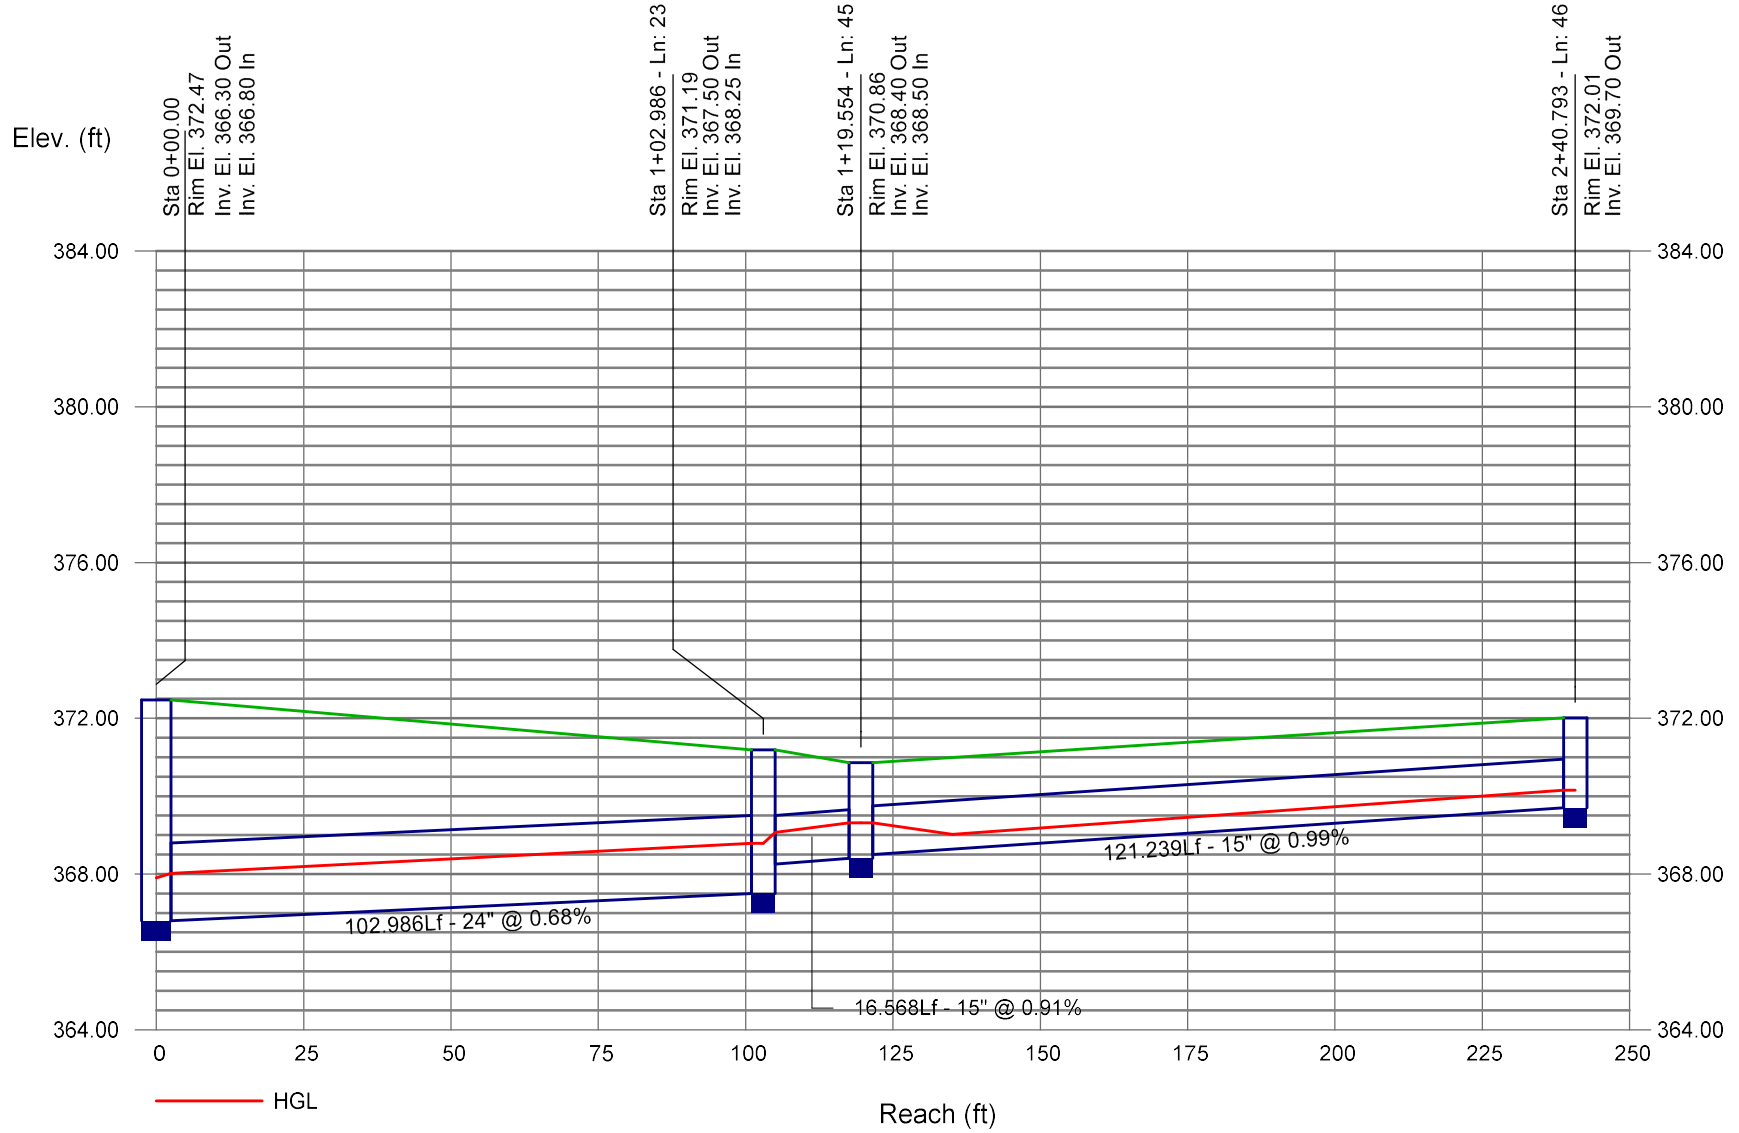


Storm Sewer Profile

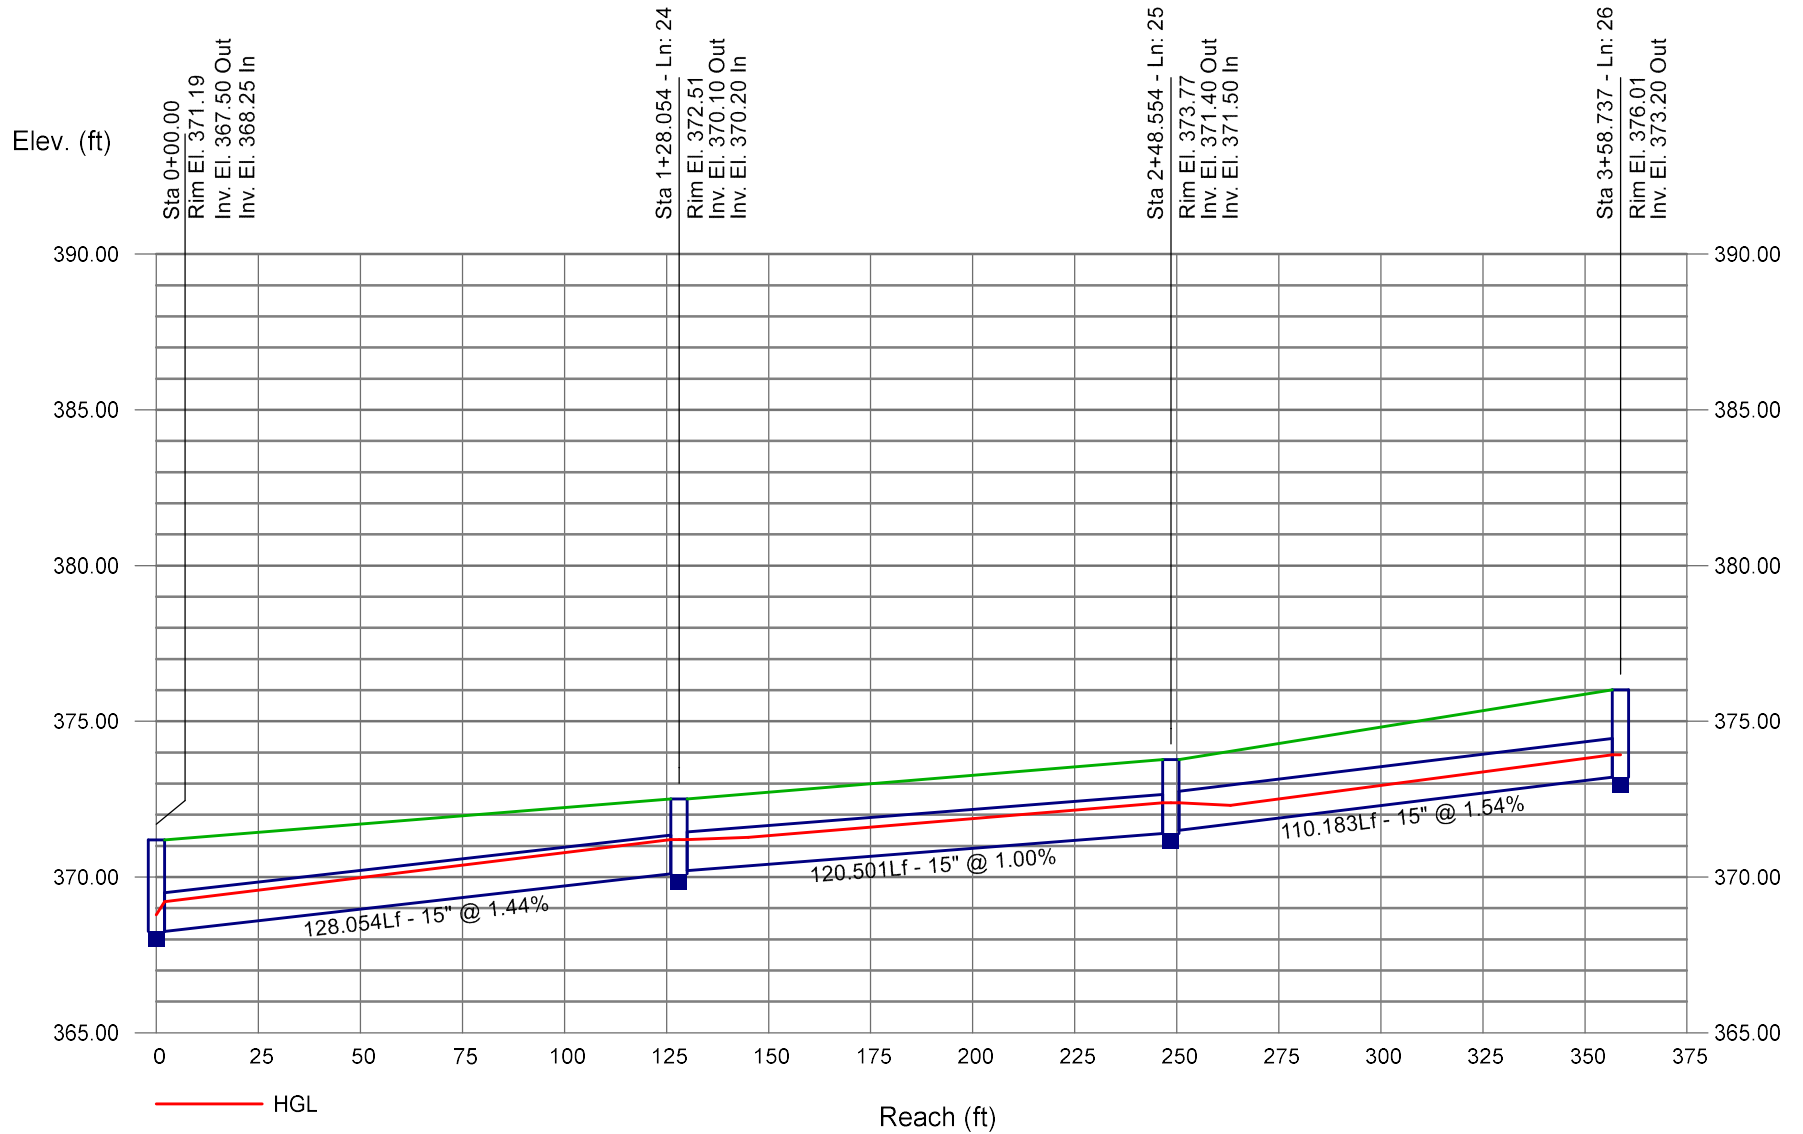


Storm Sewer Profile

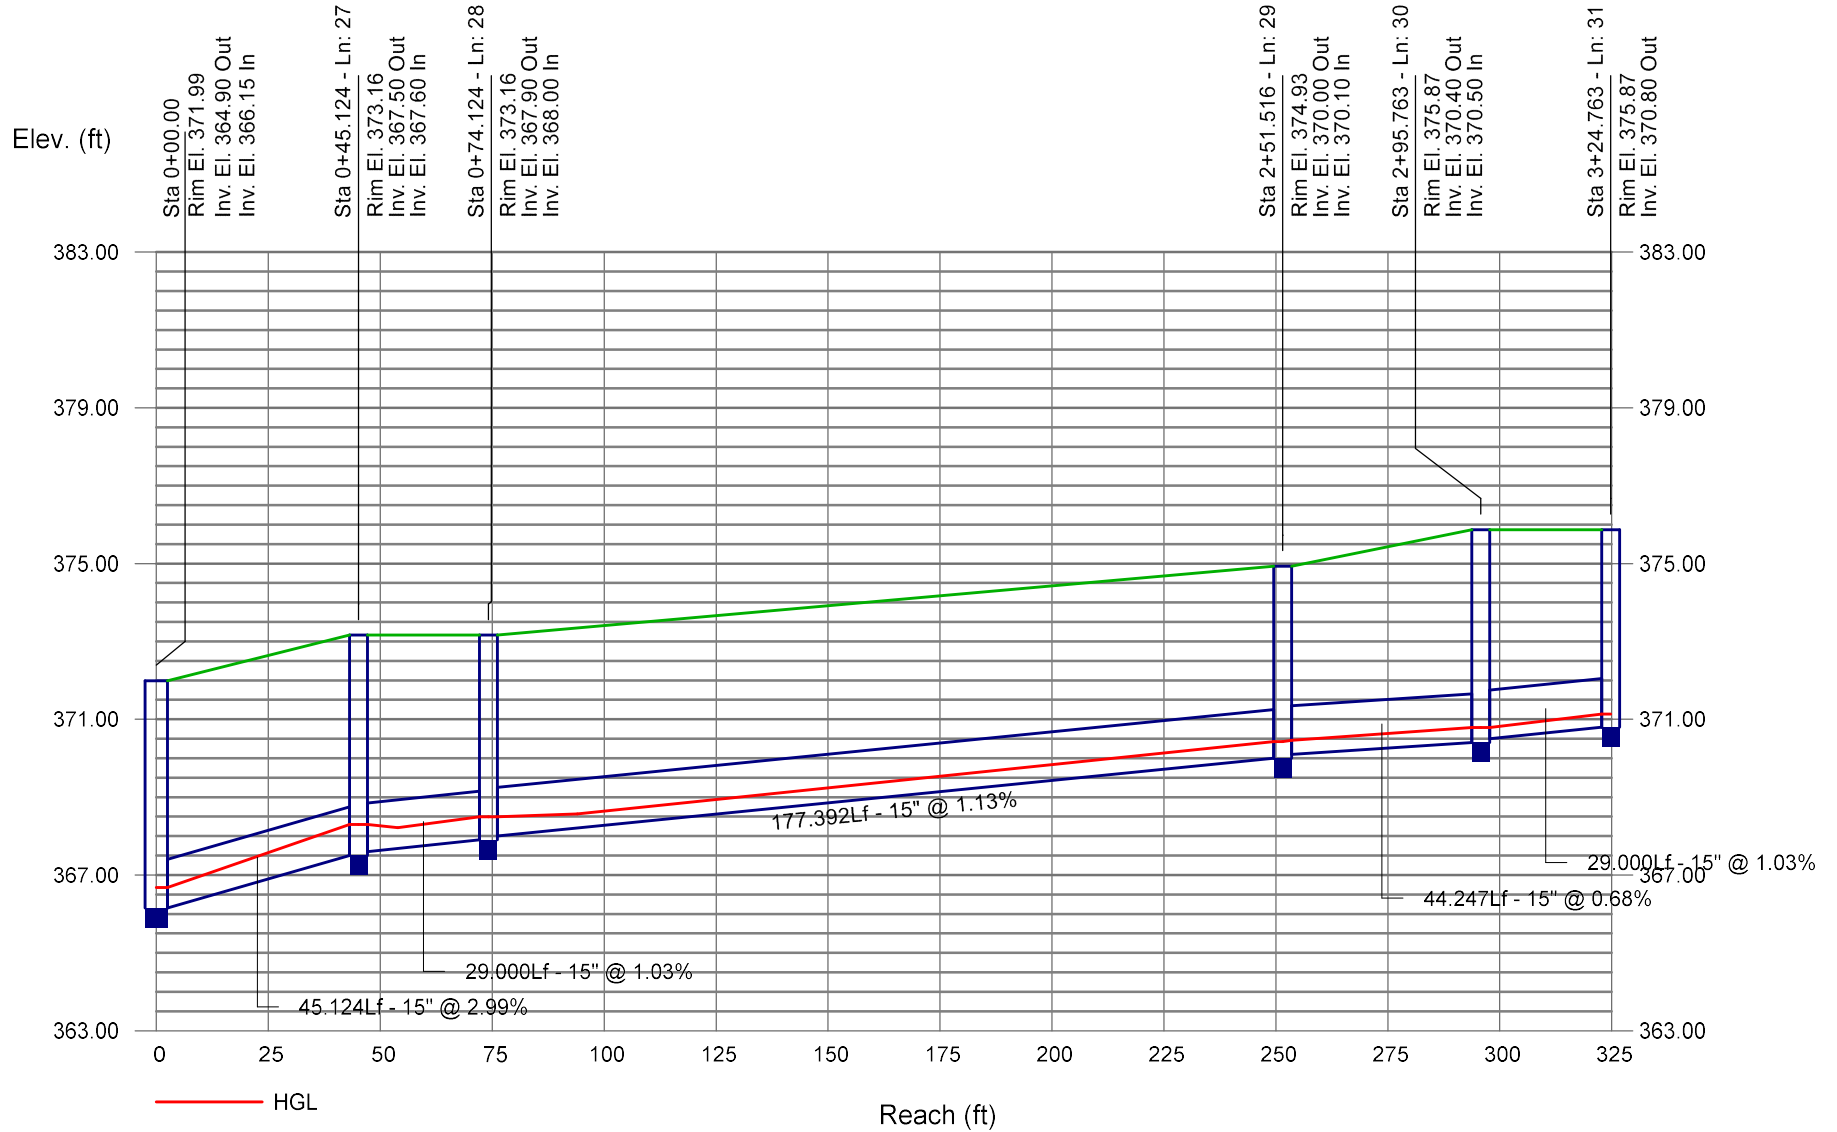


Storm Sewer Profile

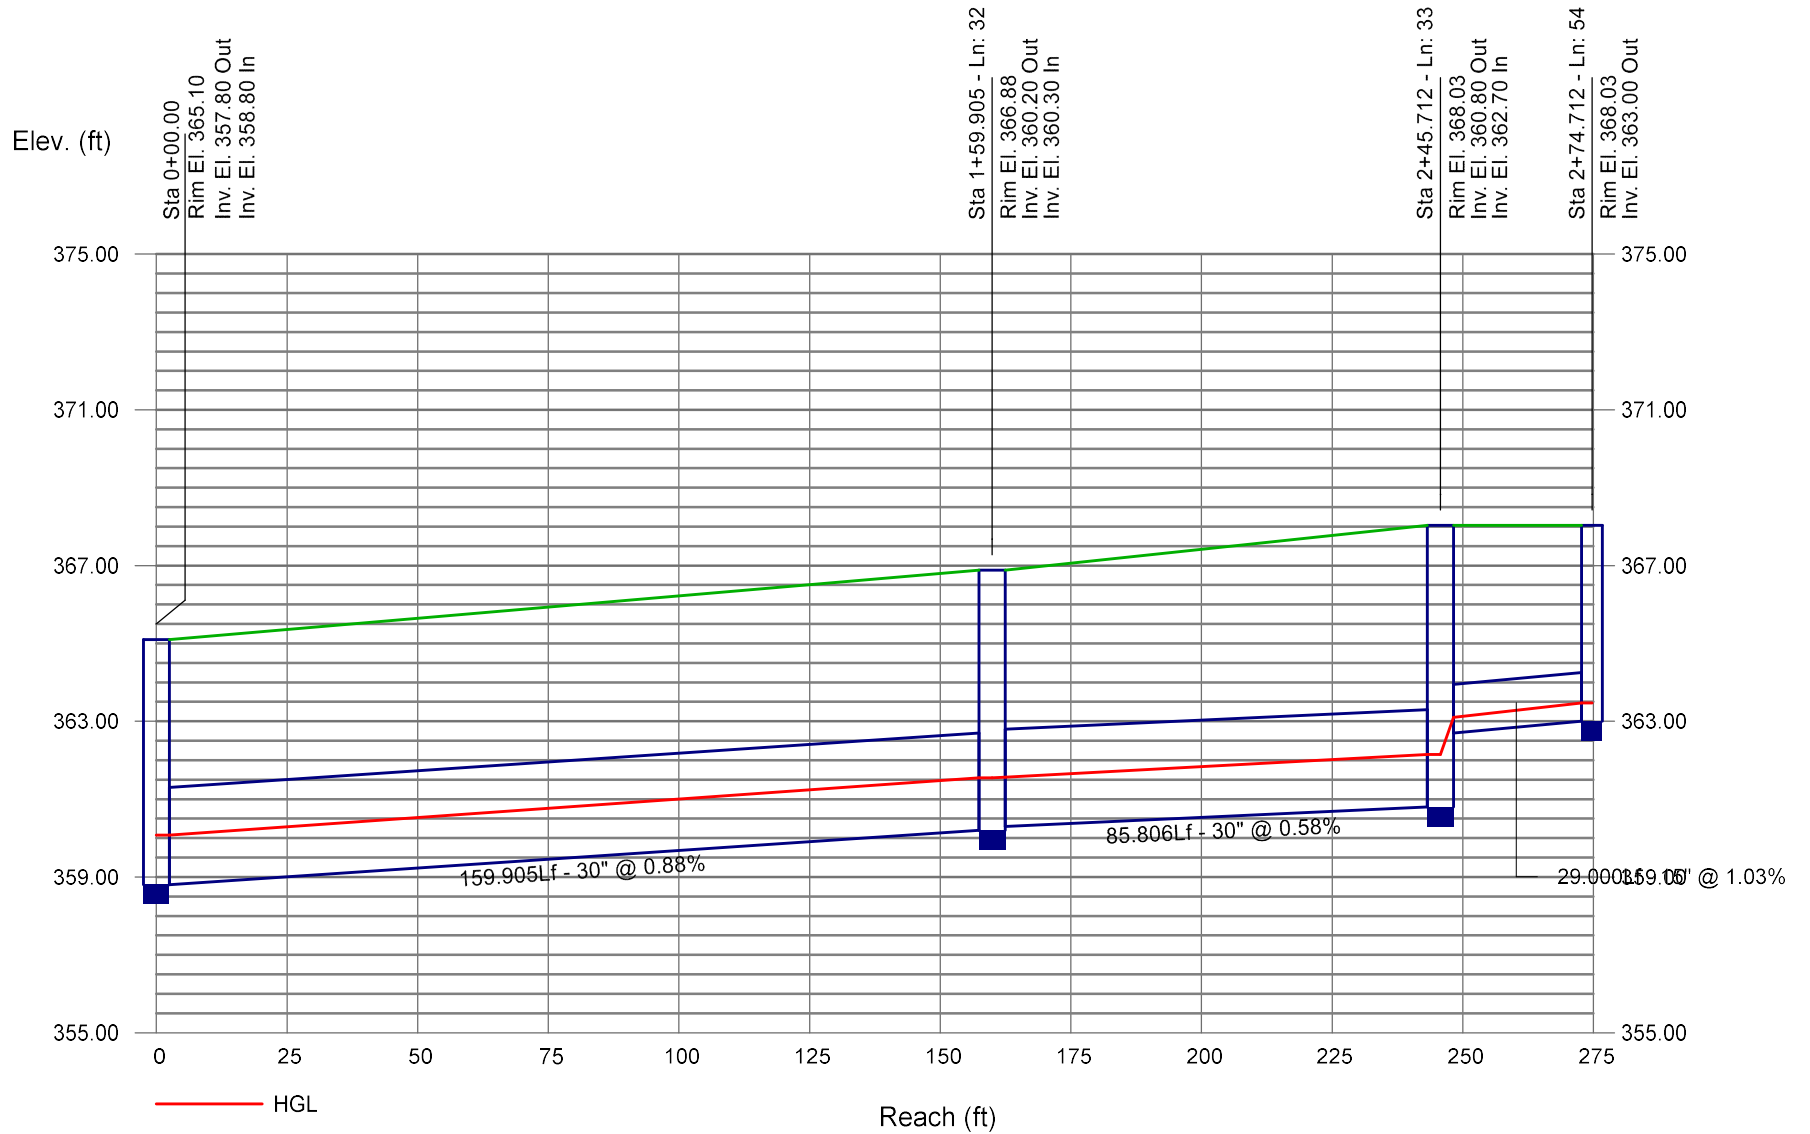


Storm Sewer Profile

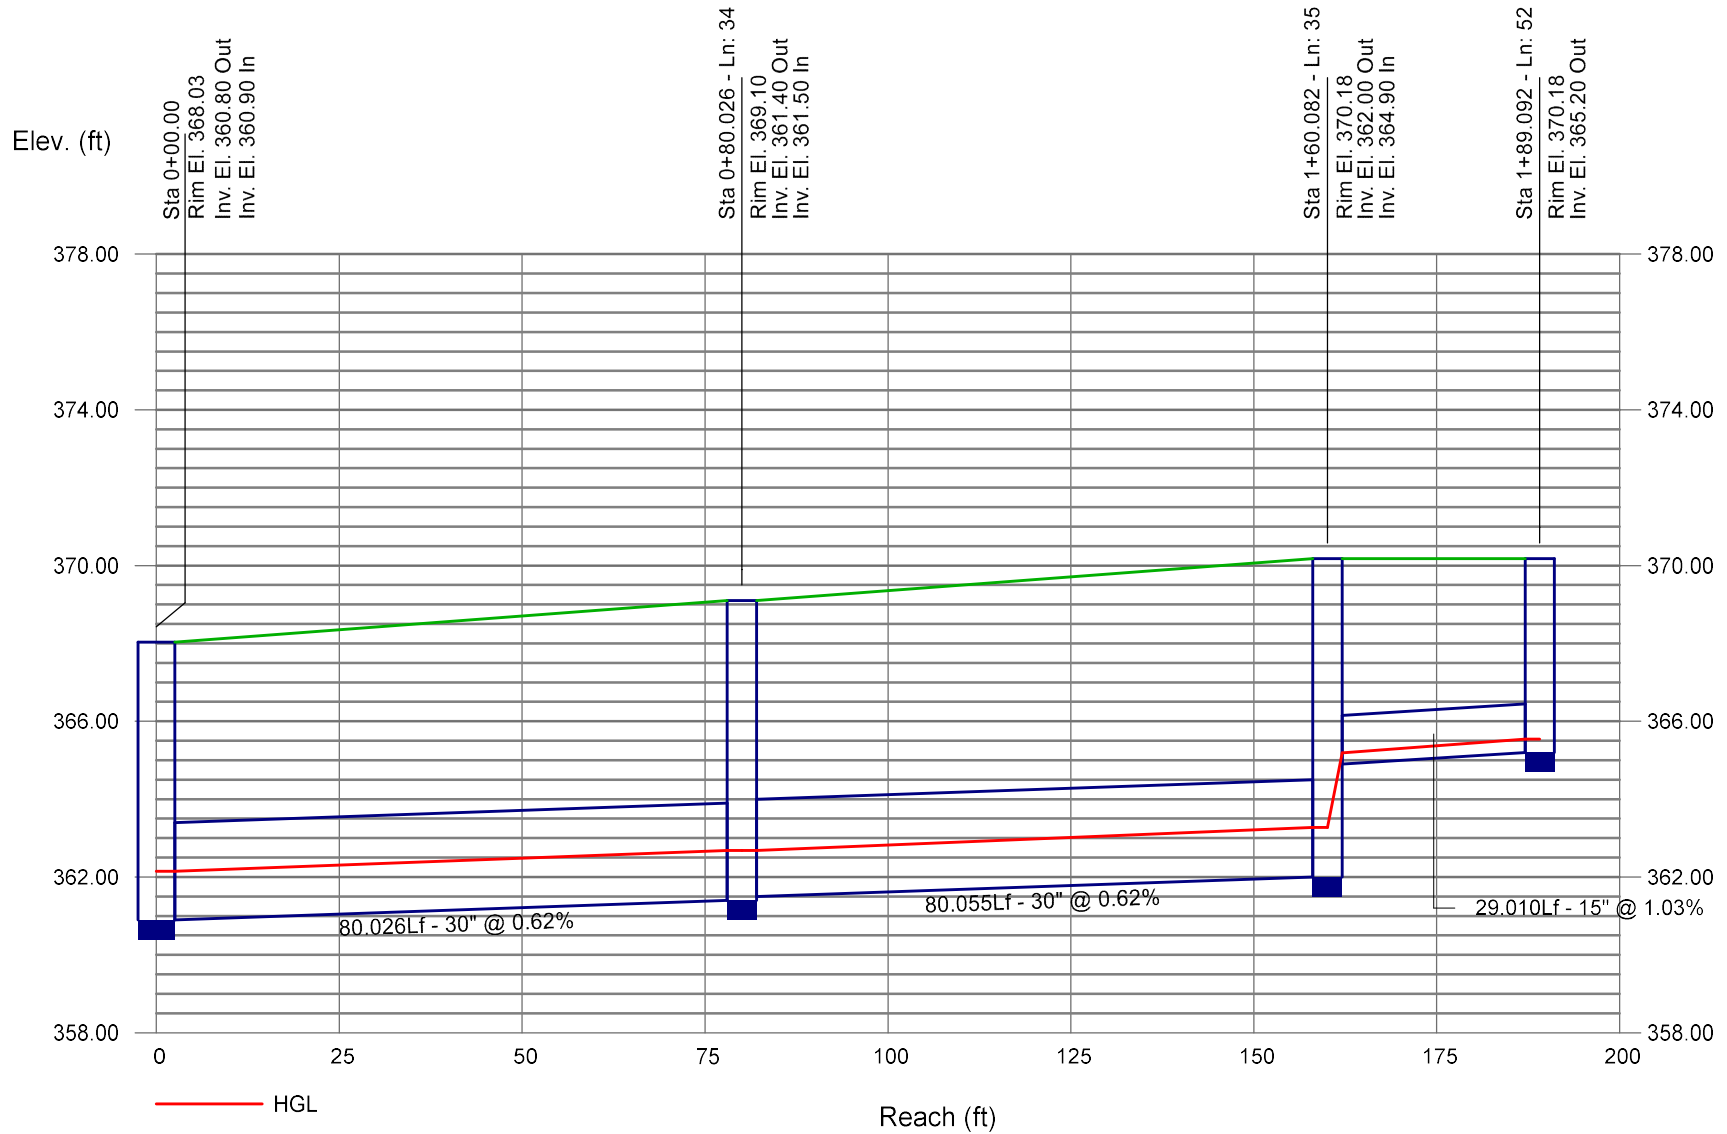


Storm Sewer Profile

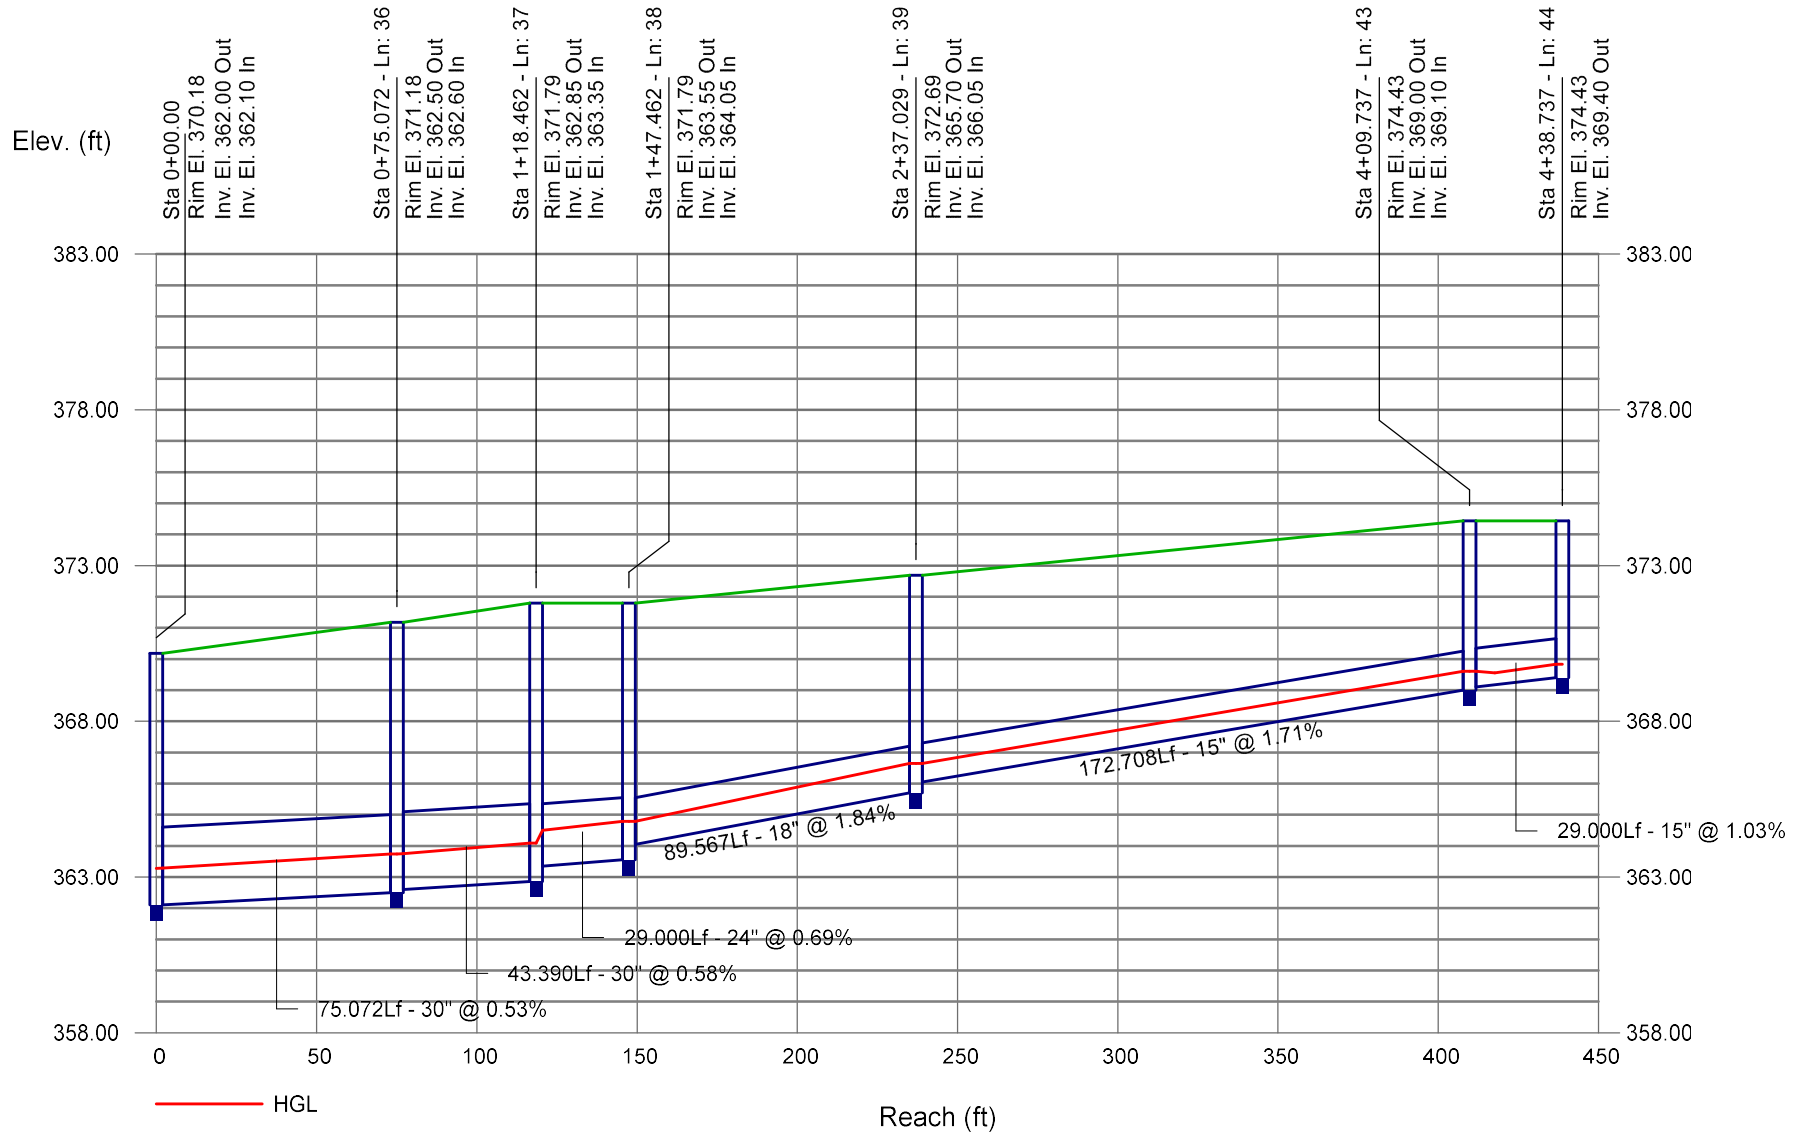


Storm Sewer Profile

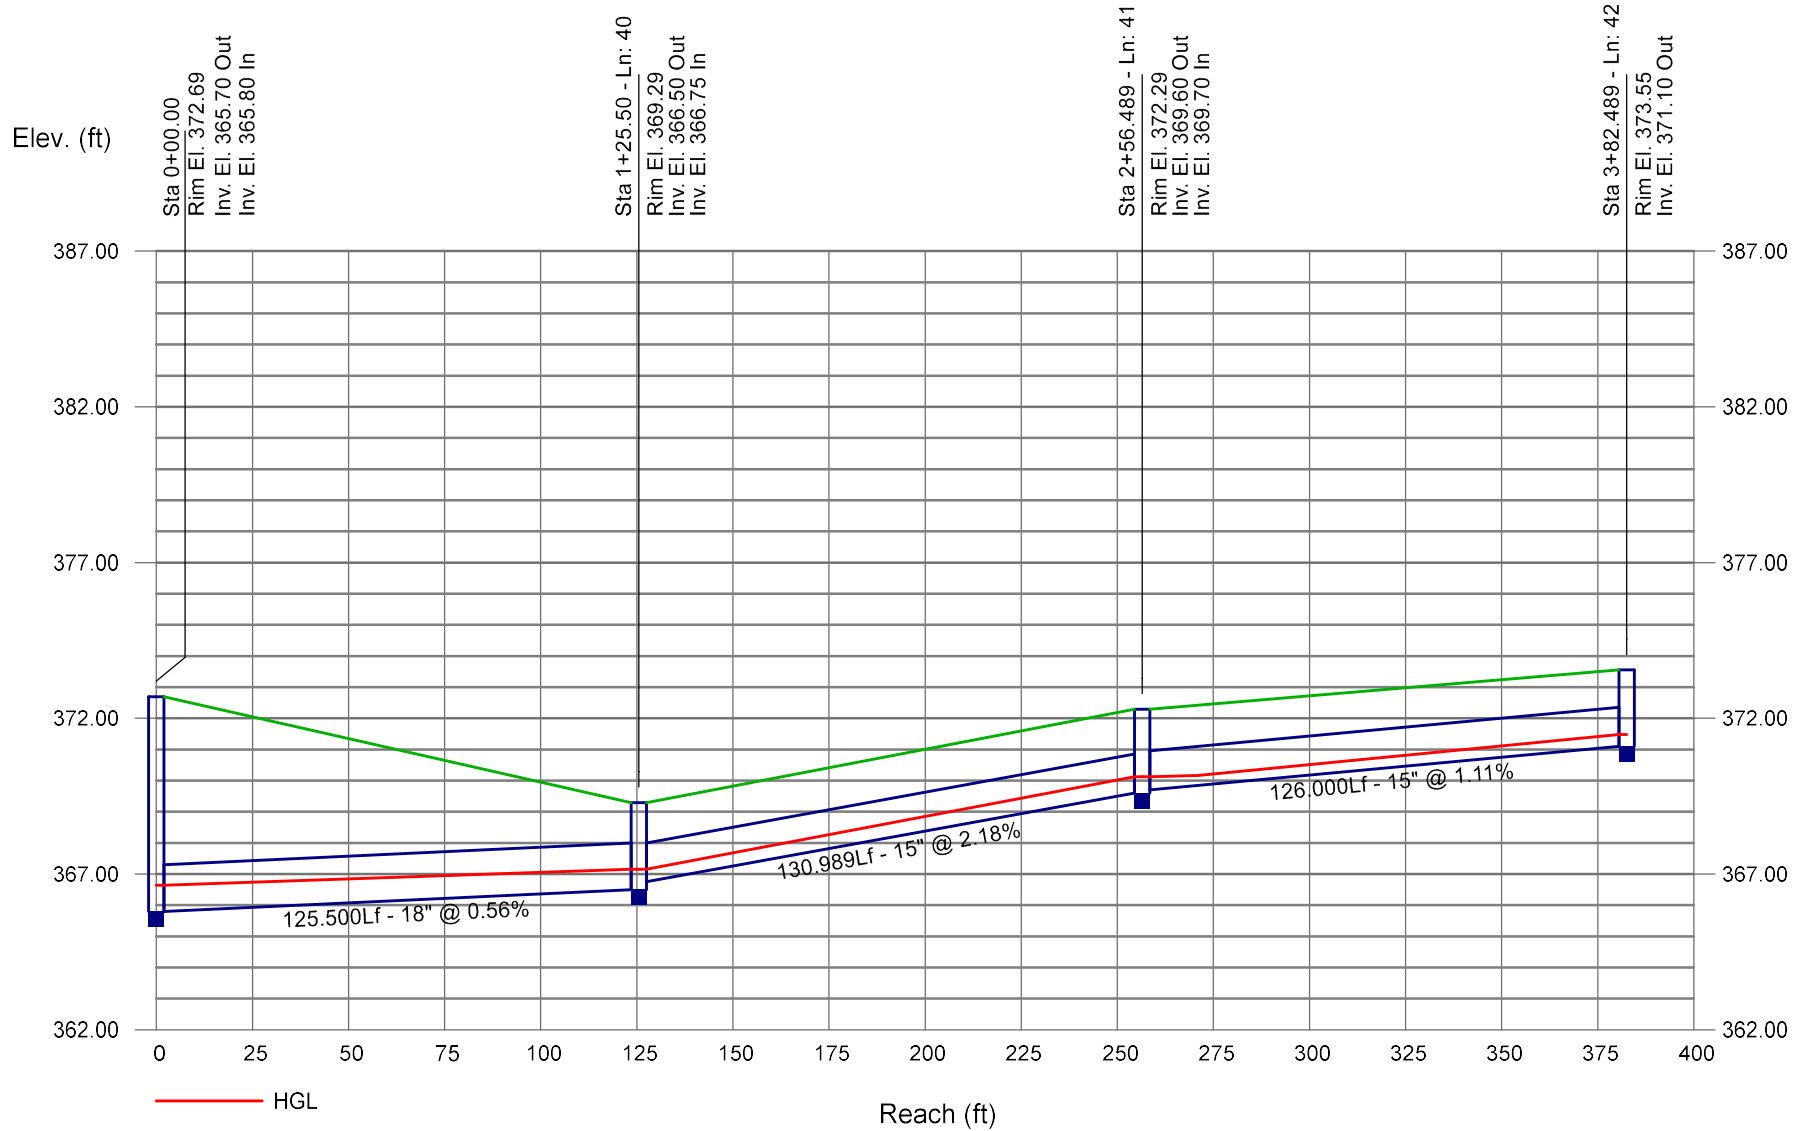


Storm Sewer Profile

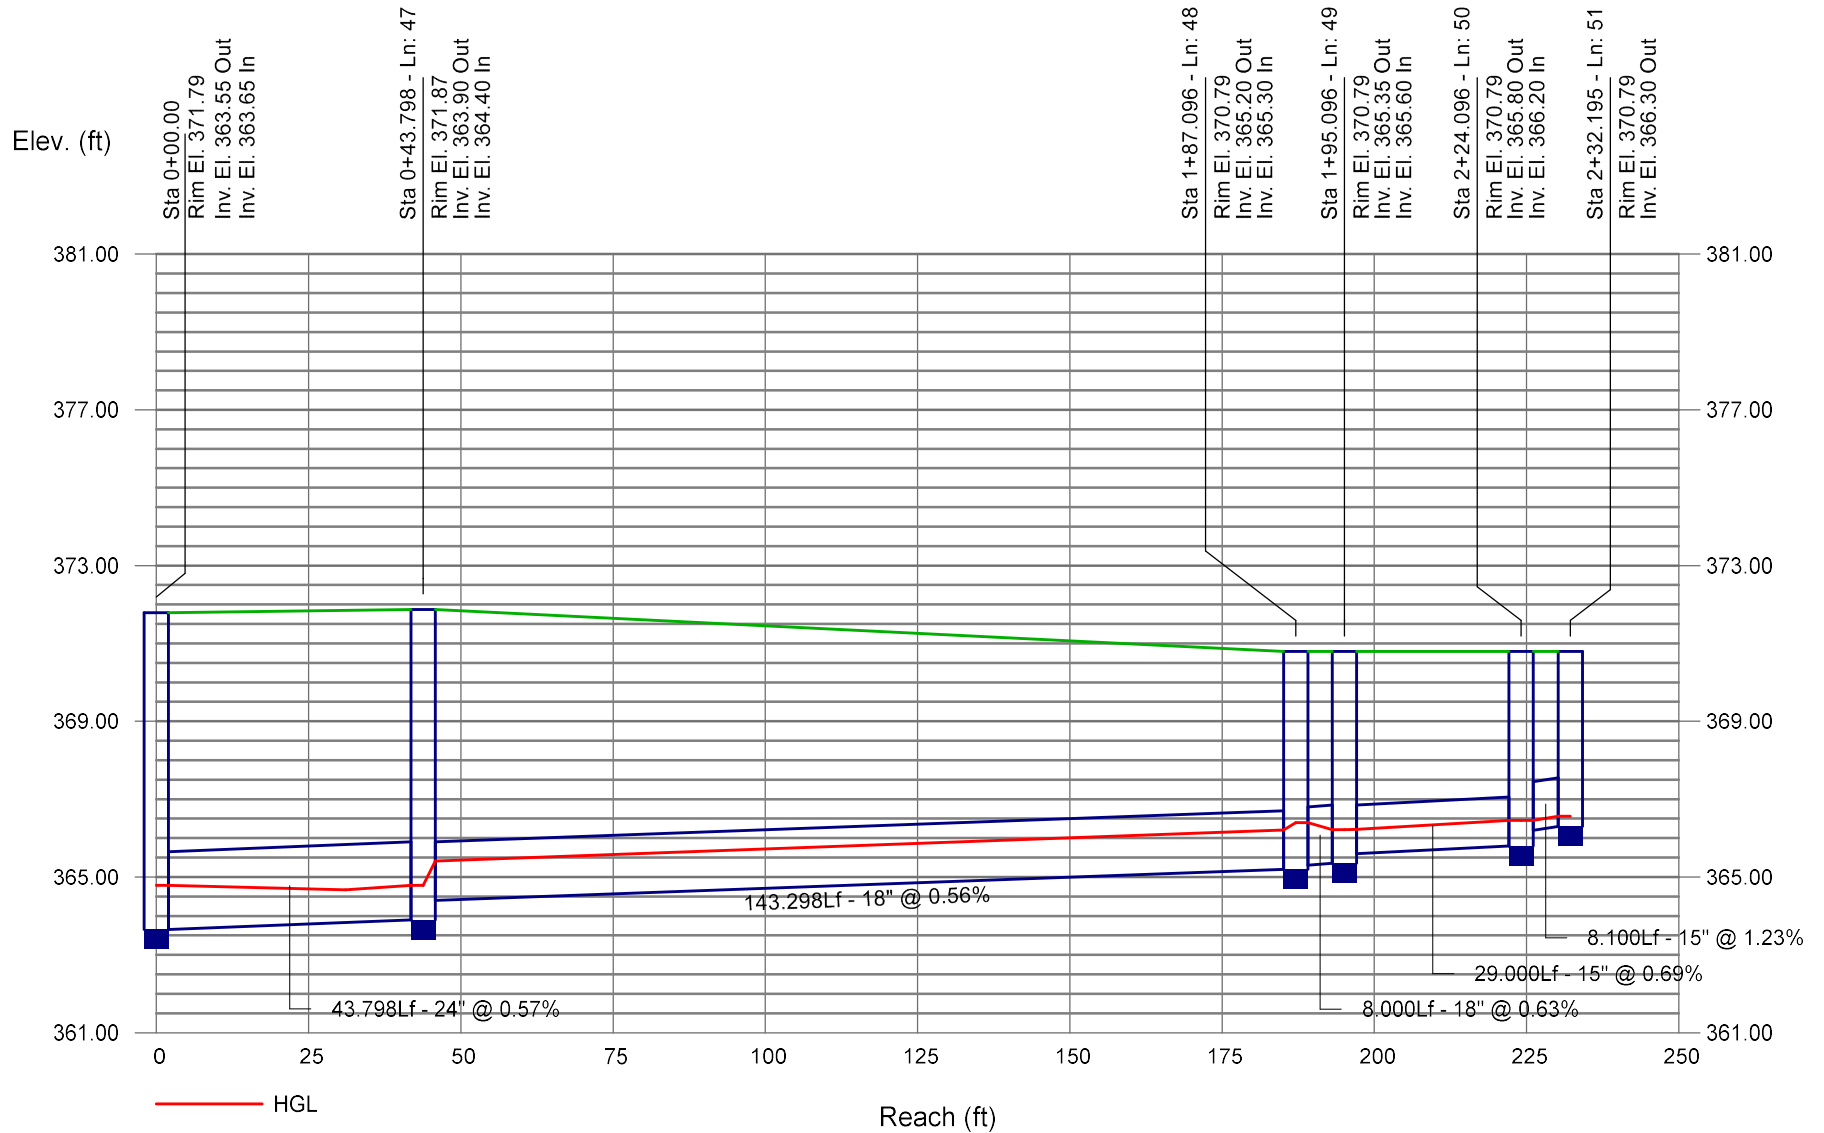

Storm Sewer Profile

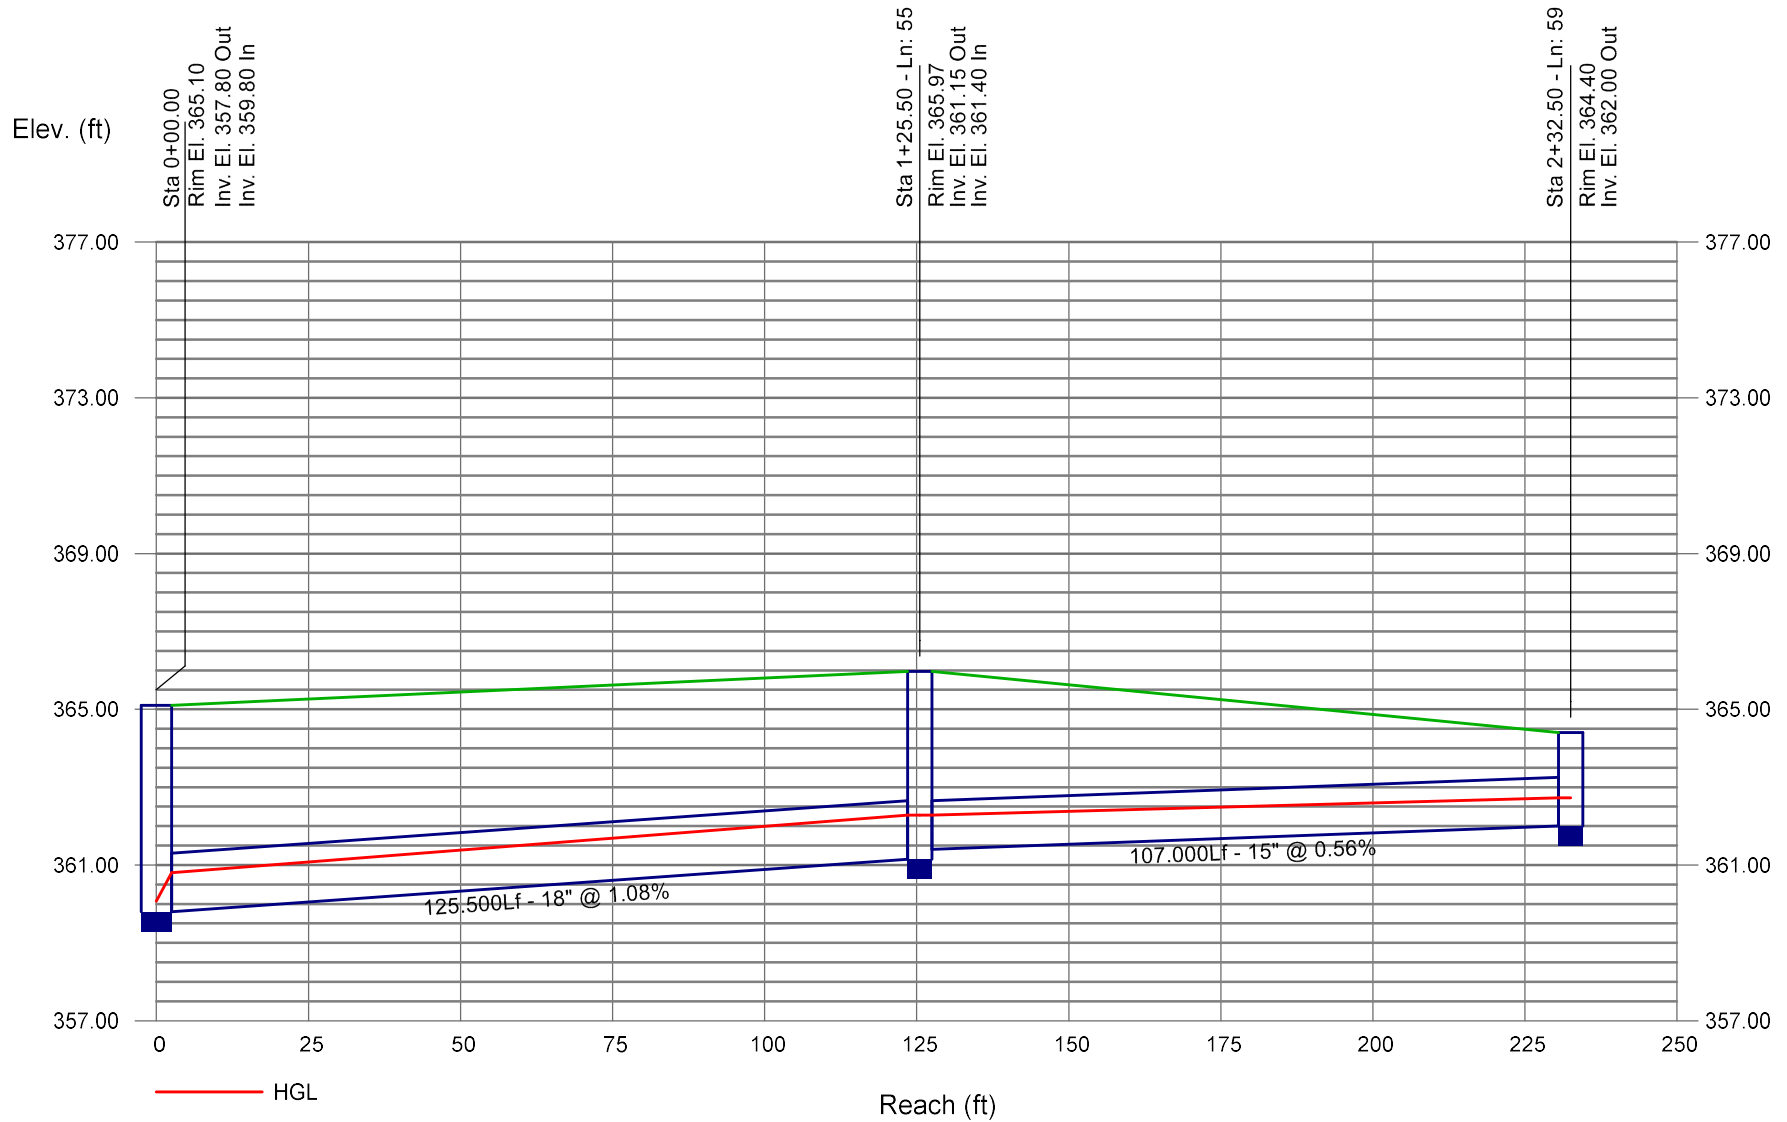

Storm Sewer Profile

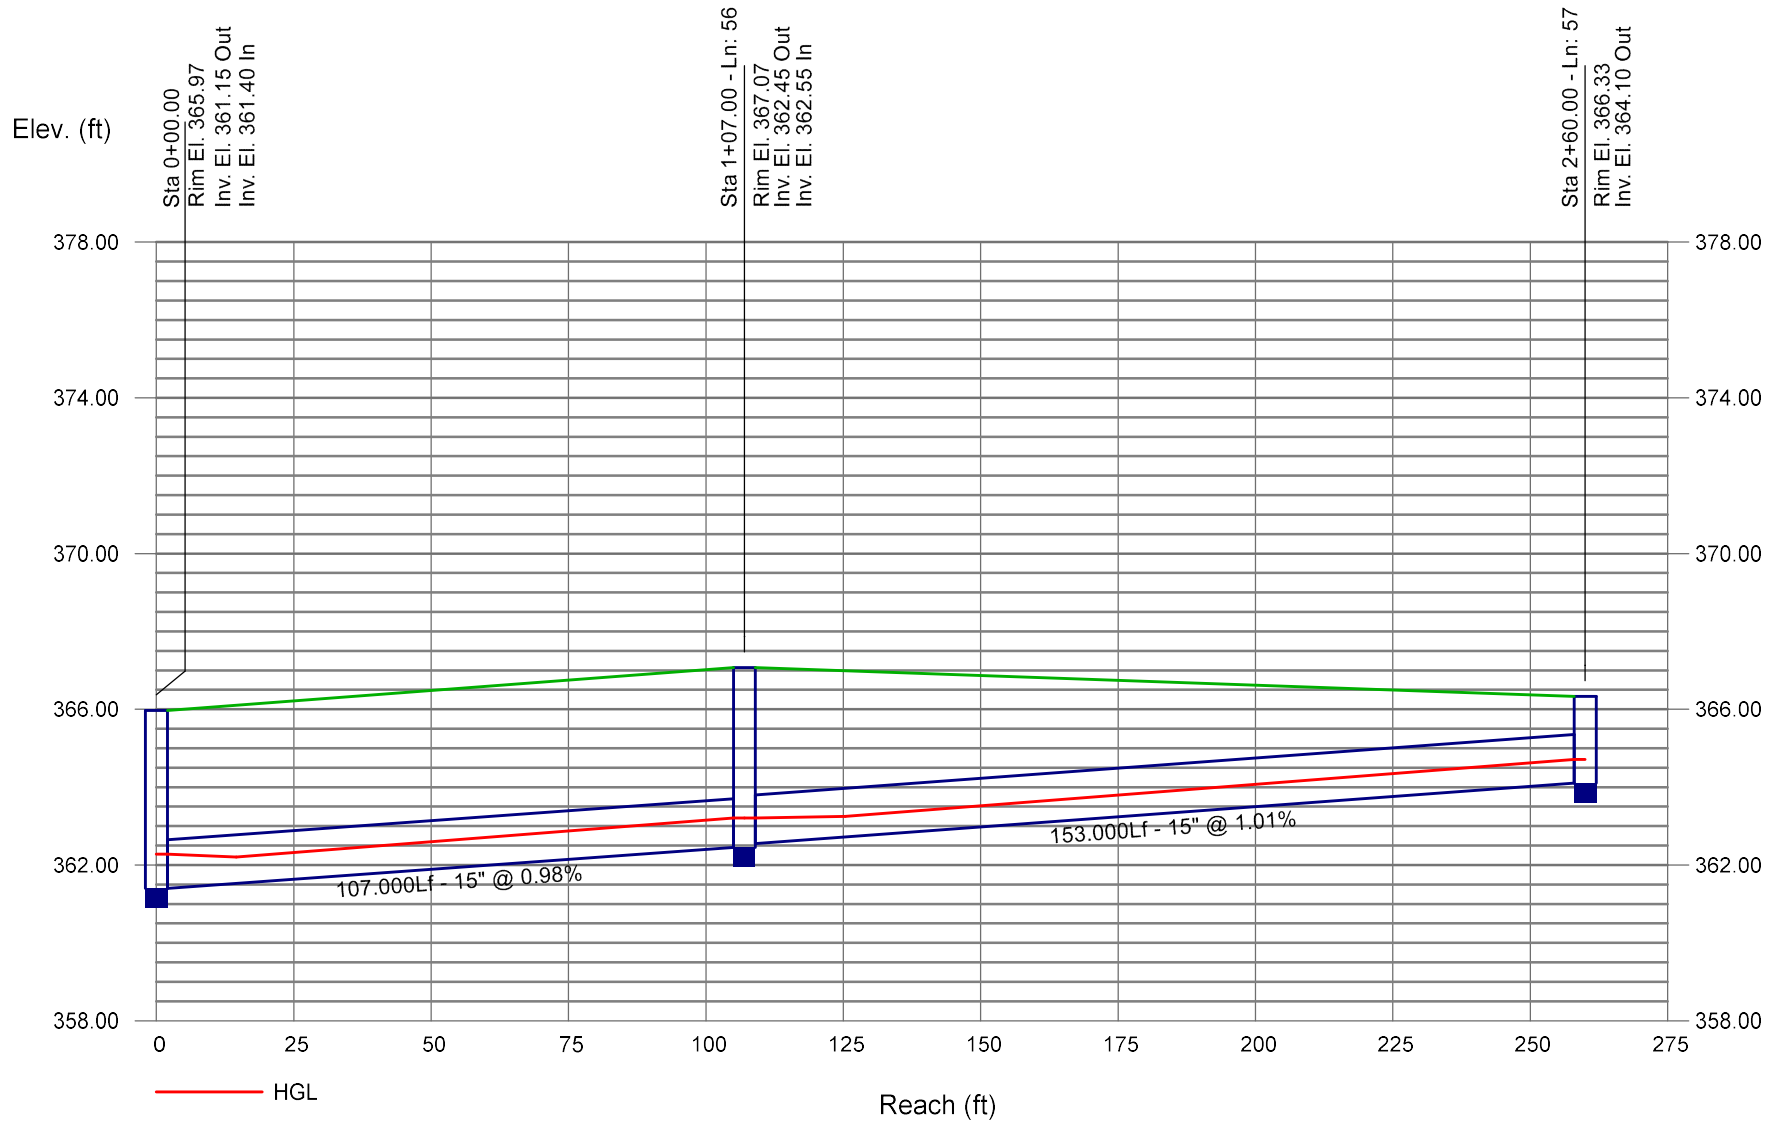

6. SCM 2: 4"/Hour Gutter Spread Chart

Spread

Line No.	Inlet ID	Junct Type	Byp Ln No	Drng Area (ac)	Inlet Time (min)	i Inlet (in/hr)	Runoff Coeff (C)	Incr Q (cfs)	Q Carry (cfs)	Q Capt (cfs)	Q Capt (cfs)	Gutter Spread (ft)
1	CB - 201	Comb.	Sag	0.38	5.0	4.00	0.60	0.91	0.15	1.06	1.06	2.54
2	CB - 202	Comb.	Sag	0.25	5.0	4.00	0.60	0.60	0.12	0.72	0.72	2.00
3	CB - 203	Comb.	2	0.33	5.0	4.00	0.60	0.79	0.01	0.68	0.68	5.18
4	CB - 204	Comb.	3	0.12	5.0	4.00	0.60	0.29	0.02	0.30	0.30	3.19
5	CB - 205	Comb.	4	0.16	5.0	4.00	0.60	0.38	0.02	0.38	0.38	3.68
6	CB - 206	Comb.	5	0.15	5.0	4.00	0.60	0.36	0.01	0.35	0.35	3.51
7	CB - 207	Comb.	6	0.12	5.0	4.00	0.60	0.29	0.02	0.30	0.30	3.17
8	CB - 208	Comb.	7	0.05	5.0	4.00	0.60	0.12	0.26	0.36	0.36	3.56
9	CB - 209	Comb.	Sag	0.32	5.0	4.00	0.60	0.77	0.12	0.89	0.89	2.00
10	CB - 210	Comb.	Sag	0.15	5.0	4.00	0.60	0.36	0.14	0.50	0.50	1.73
11	CB - 211	Comb.	10	0.13	5.0	4.00	0.60	0.31	0.16	0.44	0.44	4.02
12	CB - 212	Comb.	11	0.37	5.0	4.00	0.60	0.89	0.03	0.76	0.76	5.52
13	CB - 213	Comb.	12	0.17	5.0	4.00	0.60	0.41	0.07	0.44	0.44	4.02
14	CB - 214	Comb.	13	0.17	5.0	4.00	0.60	0.41	0.20	0.54	0.54	4.55
15	CB - 215	Comb.	14	0.43	5.0	4.00	0.60	1.03	0.00	0.83	0.83	5.80
16	CB - 216	Comb.	22	0.28	5.0	4.00	0.60	0.67	0.00	0.59	0.59	4.84
17	CB - 217	Comb.	Offsite	0.43	5.0	4.00	0.60	1.03	0.00	0.83	0.83	5.89
18	CB - 218	Comb.	17	0.06	5.0	4.00	0.60	0.14	0.00	0.14	0.14	1.67
19	CB - 219	Comb.	18	0.05	5.0	4.00	0.60	0.12	0.00	0.12	0.12	1.56
20	DI - 220	Dp-Grate	Sag	0.32	5.0	4.00	0.60	0.77	0.00	0.77	0.77	10.04
21	DI - 221	Dp-Grate	20	0.41	5.0	4.00	0.60	0.98	0.00	0.98	0.98	11.12
22	CB - 259	Comb.	9	0.30	5.0	4.00	0.60	0.72	0.08	0.68	0.68	5.19
23	DI - 252	Dp-Grate	45	0.04	5.0	4.00	0.60	0.10	0.36	0.42	0.42	7.81

Project File: SCM2.stm

Number of lines: 59

Date: 10/30/2024

NOTES: Intensity = 4.00 / (Inlet time + 0.10) ^ 0.00 -- Return period = 3 Yrs. ; ** Critical depth

Spread

Line No.	Inlet ID	Junct Type	Byp Ln No	Drng Area (ac)	Inlet Time (min)	i Inlet (in/hr)	Runoff Coeff (C)	Incr Q (cfs)	Q Carry (cfs)	Q Capt (cfs)	Q Capt (cfs)	Gutter Spread (ft)
24	DI - 253	Dp-Grate	23	0.49	5.0	4.00	0.60	1.18	0.47	1.29	1.29	13.52
25	DI - 254	Dp-Grate	24	0.65	5.0	4.00	0.60	1.56	0.41	1.50	1.50	14.48
26	DI - 255	Dp-Grate	25	0.74	5.0	4.00	0.60	1.78	0.00	1.36	1.36	13.52
27	CB - 246	Comb.	8	0.48	5.0	4.00	0.60	1.15	0.00	0.90	0.90	6.33
28	CB - 247	Comb.	10	0.31	5.0	4.00	0.60	0.74	0.00	0.63	0.63	5.21
29	CB - 248	Comb.	28	0.06	5.0	4.00	0.60	0.14	0.00	0.14	0.14	2.06
30	CB - 249	Comb.	29	0.06	5.0	4.00	0.60	0.14	0.00	0.14	0.14	1.75
31	CB - 250	Comb.	Sag	0.17	5.0	4.00	0.60	0.41	0.00	0.41	0.41	1.54
32	CB - 222	Comb.	2	0.08	5.0	4.00	0.60	0.19	0.01	0.20	0.20	2.38
33	CB - 223	Comb.	32	0.12	5.0	4.00	0.60	0.29	0.00	0.29	0.29	3.04
34	CB - 224	Comb.	33	0.11	5.0	4.00	0.60	0.26	0.00	0.26	0.26	2.88
35	CB - 225	Comb.	34	0.09	5.0	4.00	0.60	0.22	0.02	0.24	0.24	2.70
36	CB - 226	Comb.	35	0.05	5.0	4.00	0.70	0.14	0.29	0.40	0.40	3.76
37	CB - 227	Comb.	36	0.41	5.0	4.00	0.70	1.15	0.08	0.94	0.94	6.51
38	CB - 228	Comb.	Sag	0.15	5.0	4.00	0.70	0.42	0.15	0.57	0.57	1.84
39	CB - 229	Comb.	38	0.28	5.0	4.00	0.70	0.78	0.08	0.72	0.72	5.58
40	DI - 230	Dp-Grate	Sag	0.35	5.0	4.00	0.60	0.84	0.06	0.90	0.90	10.73
41	DI - 231	Dp-Grate	40	0.24	5.0	4.00	0.60	0.58	0.04	0.56	0.56	9.71
42	DI - 232	Dp-Grate	41	0.21	5.0	4.00	0.60	0.50	0.00	0.46	0.46	8.76
43	CB - 240	Comb.	39	0.27	5.0	4.00	0.60	0.65	0.00	0.57	0.57	4.89
44	CB - 241	Comb.	37	0.27	5.0	4.00	0.60	0.65	0.00	0.57	0.57	4.89
45	DI - 256	Dp-Grate	Sag	0.95	5.0	4.00	0.60	2.28	0.11	2.39	2.39	16.89
46	DI - 257	Dp-Grate	45	0.30	5.0	4.00	0.60	0.72	0.00	0.64	0.64	10.67

Project File: SCM2.stm

Number of lines: 59

Date: 10/30/2024

NOTES: Intensity = 4.00 / (Inlet time + 0.10) ^ 0.00 -- Return period = 3 Yrs. ; ** Critical depth

Line No.	Inlet ID	Junct Type	Byp Ln No	Drng Area (ac)	Inlet Time (min)	i Inlet (in/hr)	Runoff Coeff (C)	Incr Q (cfs)	Q Carry (cfs)	Q Capt (cfs)	Q Capt (cfs)	Gutter Spread (ft)
47	CB - 235	Comb.	48	0.03	5.0	4.00	0.70	0.08	0.00	0.08	0.08	1.66
48	CB - 236	Comb.	Sag	0.24	5.0	4.00	0.70	0.67	0.35	1.02	1.02	2.37
49	CB - 237	Comb.	48	0.49	5.0	4.00	0.70	1.37	0.00	1.03	1.03	6.82
50	CB - 238	Comb.	51	0.44	5.0	4.00	0.70	1.23	0.00	0.94	0.94	6.51
51	CB - 239	Comb.	Sag	0.09	5.0	4.00	0.70	0.25	0.29	0.54	0.54	1.79
52	CB - 234	Comb.	54	0.15	5.0	4.00	0.70	0.42	0.00	0.40	0.40	3.73
53	CB - 258	Comb.	58	0.14	5.0	4.00	0.60	0.34	0.00	0.33	0.33	3.35
54	CB - 233	Comb.	1	0.33	5.0	4.00	0.60	0.79	0.02	0.69	0.69	5.16
55	DI - 242	Dp-Grate	Sag	0.51	5.0	4.00	0.60	1.22	0.10	1.32	1.32	12.69
56	DI - 243	Dp-Grate	55	0.32	5.0	4.00	0.60	0.77	0.00	0.67	0.67	9.71
57	DI - 244	Dp-Grate	Sag	0.54	5.0	4.00	0.60	1.30	0.00	1.30	1.30	12.56
58	CB - 260	Comb.	1	0.17	5.0	4.00	0.60	0.41	0.01	0.40	0.40	3.77
59	DI - 245	Dp-Grate	Sag	0.74	5.0	4.00	0.60	1.78	0.00	1.78	1.78	14.56

Project File: SCM2.stm	Number of lines: 59	Date: 10/30/2024
------------------------	---------------------	------------------

NOTES: Intensity = 4.00 / (Inlet time + 0.10) ^ 0.00 -- Return period = 3 Yrs. ; ** Critical depth

7. SCM 3: 10-YR Storm Drainage Chart

Pipes

Line No.	Junct Type	Inlet ID	DnStm Ln No	Drng Area (ac)	Tc (min)	i Sys (in/hr)	Runoff Coeff (C)	Total Runoff (cfs)	Capac Full (cfs)	Line Length (ft)	Line Size (in)	n-val Pipe	Line Slope (%)	Invert Up (ft)	Invert Dn (ft)	Gnd/Rim El Up (ft)	Gnd/Rim El Dn (ft)	HGL Up (ft)	HGL Dn (ft)
1	Dp-Grate	DI - 301	Outfall	0.24	14.3	5.32	0.60	21.32	92.31	65.143	30	0.013	5.07	358.30	355.00	366.95	358.29	359.87 j	357.53
2	Dp-Grate	DI - 302	1	0.05	13.8	5.39	0.60	20.83	63.17	130.682	30	0.013	2.37	361.50	358.40	369.98	366.95	363.05	359.87
3	Dp-Grate	DI - 303	2	0.04	13.6	5.42	0.60	20.79	30.24	55.180	30	0.013	0.54	361.90	361.60	369.61	369.98	363.45	363.12
4	Comb.	CB - 304	3	0.09	13.2	5.49	0.60	20.90	32.20	113.591	30	0.013	0.62	362.70	362.00	371.54	369.61	364.25	363.47
5	Comb.	CB - 305	4	0.11	12.6	5.58	0.60	19.98	30.02	149.355	30	0.013	0.54	363.60	362.80	373.10	371.54	365.12	364.29
6	Comb.	CB - 306	5	0.17	12.0	5.68	0.60	12.45	30.13	169.000	24	0.013	1.78	367.10	364.10	374.80	373.10	368.37	365.12
7	Comb.	CB - 307	6	0.09	11.5	5.76	0.60	10.86	30.34	105.608	24	0.013	1.80	369.10	367.20	375.86	374.80	370.28	368.37
8	Comb.	CB - 308	7	0.43	11.3	5.80	0.60	10.61	18.81	43.355	24	0.013	0.69	369.50	369.20	376.49	375.86	370.67	370.28
9	Comb.	CB - 309	8	0.43	11.2	5.83	0.60	9.16	18.78	29.000	24	0.013	0.69	369.80	369.60	376.49	376.49	370.88	370.67
10	Comb.	CB - 310	9	0.19	10.9	5.87	0.60	7.72	18.82	43.328	24	0.013	0.69	370.20	369.90	376.76	376.49	371.19	370.88
11	Comb.	CB - 311	10	0.22	10.0	6.04	0.60	6.49	17.77	121.542	24	0.013	0.62	371.05	370.30	377.98	376.76	371.95	371.19
12	Comb.	CB - 312	11	0.14	8.3	6.39	0.60	3.87	24.26	134.782	24	0.013	1.15	372.70	371.15	379.34	377.98	373.39 j	371.95
13	Comb.	CB - 313	12	0.14	7.0	6.70	0.60	3.50	18.18	92.839	24	0.013	0.65	373.40	372.80	380.34	379.34	374.05	373.39
14	Comb.	CB - 314	13	0.29	6.8	6.77	0.60	2.96	9.75	29.020	18	0.013	0.86	374.15	373.90	380.34	380.34	374.80	374.47
15	Comb.	CB - 315	14	0.33	6.2	6.90	0.60	1.82	4.93	47.957	15	0.013	0.58	374.68	374.40	380.05	380.34	375.22	374.93
16	Comb.	CB - 316	15	0.11	5.0	7.25	0.60	0.48	5.62	29.001	15	0.013	0.76	375.00	374.78	380.05	380.05	375.27 j	375.22
17	Comb.	CB - 317	5	0.28	9.3	6.18	0.60	8.20	15.10	29.000	18	0.013	2.07	365.20	364.60	373.10	373.10	366.31	365.39
18	Dp-Grate	DI - 318	17	0.28	8.8	6.29	0.60	7.28	14.96	128.098	18	0.013	2.03	367.90	365.30	371.34	373.10	368.94	366.31
19	Dp-Grate	DI - 319	18	0.38	8.4	6.38	0.60	6.31	11.81	86.997	18	0.013	1.26	369.10	368.00	372.11	371.34	370.07	368.94
20	Dp-Grate	DI - 320	19	0.35	7.7	6.54	0.60	4.98	10.37	123.000	18	0.013	0.98	370.40	369.20	373.34	372.11	371.26 j	370.07
21	Dp-Grate	DI - 321	20	0.34	7.1	6.69	0.60	3.70	6.51	123.000	15	0.013	1.02	371.90	370.65	374.58	373.34	372.68	371.32
22	Dp-Grate	DI - 322	21	0.21	6.0	6.96	0.60	2.42	6.38	123.000	15	0.013	0.98	373.20	372.00	375.81	374.58	373.82 j	372.68
23	Dp-Grate	DI - 323	22	0.37	5.0	7.25	0.60	1.61	6.50	82.000	15	0.013	1.01	374.13	373.30	376.59	375.81	374.63 j	373.82

Project File: SCM3 CHECK.stm

Number of lines: 42

Date: 10/30/2024

NOTES: Intensity = 86.72 / (Inlet time + 15.30) ^ 0.82 -- Return period = 10 Yrs. ; ** Critical depth

Pipes

Line No.	Junct Type	Inlet ID	DnStm Ln No	Drng Area (ac)	Tc (min)	i Sys (in/hr)	Runoff Coeff (C)	Total Runoff (cfs)	Capac Full (cfs)	Line Length (ft)	Line Size (in)	n-val Pipe	Line Slope (%)	Invert Up (ft)	Invert Dn (ft)	Gnd/Rim El Up (ft)	Gnd/Rim El Dn (ft)	HGL Up (ft)	HGL Dn (ft)
24	Comb.	CB - 326	11	0.34	5.0	7.25	0.60	1.48	6.03	31.016	15	0.013	0.87	373.07	372.80	378.09	377.98	373.55	373.22
25	Dp-Grate	DI - 327	11	0.22	5.0	7.25	0.60	0.96	5.27	73.500	15	0.013	0.67	372.39	371.90	374.73	377.98	372.77	372.26
26	Comb.	CB - 325	10	0.21	5.0	7.25	0.60	0.91	6.40	30.530	15	0.013	0.98	371.80	371.50	376.86	376.76	372.17	371.82
27	Comb.	CB - 324	6	0.34	5.0	7.25	0.60	1.48	6.00	29.000	15	0.013	0.86	369.75	369.50	374.80	374.80	370.23	369.92
28	Dp-Grate	DI - 351	Outfall	0.08	10.6	5.94	0.60	17.02	88.27	34.256	36	0.013	1.75	355.10	354.50	363.68	358.33	357.52	357.53
29	Dp-Grate	DI - 352	28	0.12	9.5	6.15	0.60	17.35	49.52	163.276	36	0.013	0.55	356.10	355.20	363.46	363.68	357.43	357.70
30	Comb.	CB - 353	29	0.28	8.5	6.36	0.60	17.47	49.48	145.371	36	0.013	0.55	357.00	356.20	364.32	363.46	358.34	357.43
31	Comb.	CB - 361	30	0.52	5.7	7.04	0.60	4.01	29.11	163.007	24	0.013	1.66	360.70	358.00	366.57	364.32	361.40	358.50
32	Comb.	CB - 328	4	0.29	5.0	7.25	0.60	1.26	6.56	38.780	15	0.013	1.03	366.50	366.10	370.35	371.54	366.94	366.47
33	Comb.	CB - 354	30	0.35	8.4	6.39	0.60	11.15	22.95	29.129	24	0.013	1.03	358.30	358.00	364.32	364.32	359.50	358.98
34	Comb.	CB - 355	33	0.21	8.3	6.40	0.60	9.83	21.93	10.636	24	0.013	0.94	358.50	358.40	364.30	364.32	359.62	359.50
35	Dp-Grate	DI - 356	34	0.48	7.6	6.57	0.60	9.26	16.67	128.929	24	0.013	0.54	359.30	358.60	362.45	364.30	360.39	359.67
36	Dp-Grate	DI - 357	35	0.39	7.2	6.67	0.60	5.20	6.69	107.000	15	0.013	1.07	361.10	359.95	363.67	362.45	362.02	360.78
37	Dp-Grate	DI - 358	36	0.38	6.4	6.87	0.60	3.75	8.09	153.000	15	0.013	1.57	363.60	361.20	366.09	363.67	364.38 j	362.02
38	Dp-Grate	DI - 359	37	0.53	5.0	7.25	0.60	2.31	8.09	153.000	15	0.013	1.57	366.10	363.70	368.51	366.09	366.71 j	364.38
39	Comb.	CB - 365	35	0.04	5.4	7.14	0.60	2.44	21.65	82.327	18	0.013	4.25	363.30	359.80	368.90	362.45	363.89	360.39
40	Comb.	CB - 366	39	0.53	5.0	7.25	0.60	2.31	9.85	30.675	18	0.013	0.88	363.67	363.40	369.13	368.90	364.24	363.89
41	Comb.	CB - 364	31	0.43	5.0	7.25	0.60	1.87	10.53	45.728	18	0.013	1.01	361.66	361.20	367.13	366.57	362.17	361.63
42	Comb.	CB - 360	30	0.44	5.0	7.25	0.60	1.91	6.30	10.502	15	0.013	0.95	359.80	359.70	364.30	364.32	360.35	360.17

Project File: SCM3 CHECK.stm


Number of lines: 42

Date: 10/30/2024

NOTES: Intensity = 86.72 / (Inlet time + 15.30) ^ 0.82 -- Return period = 10 Yrs. ; ** Critical depth

8. SCM 3: 10-YR HGL Profiles

Hydraflow Storm Sewers Extension for Autodesk® Civil 3D® Plan

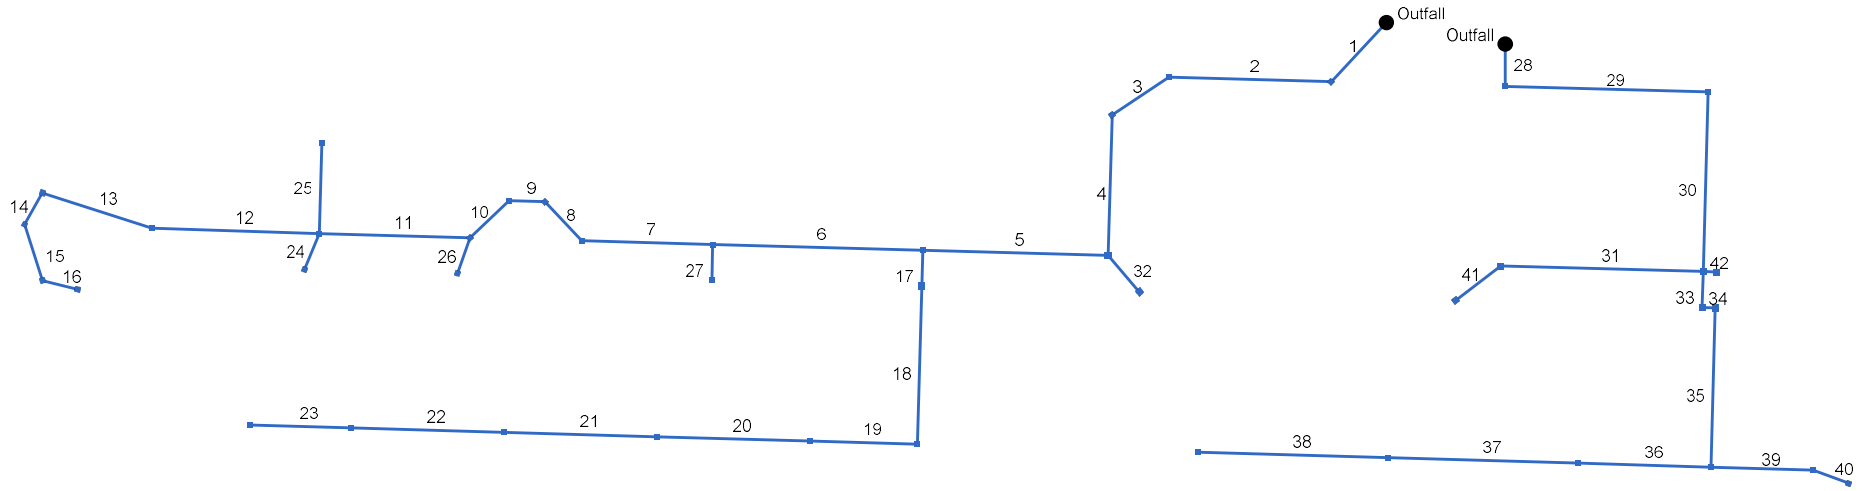


Project File: SCM3 CHECK.stm


Number of lines: 42

Date: 10/30/2024


Storm Sewer Profile

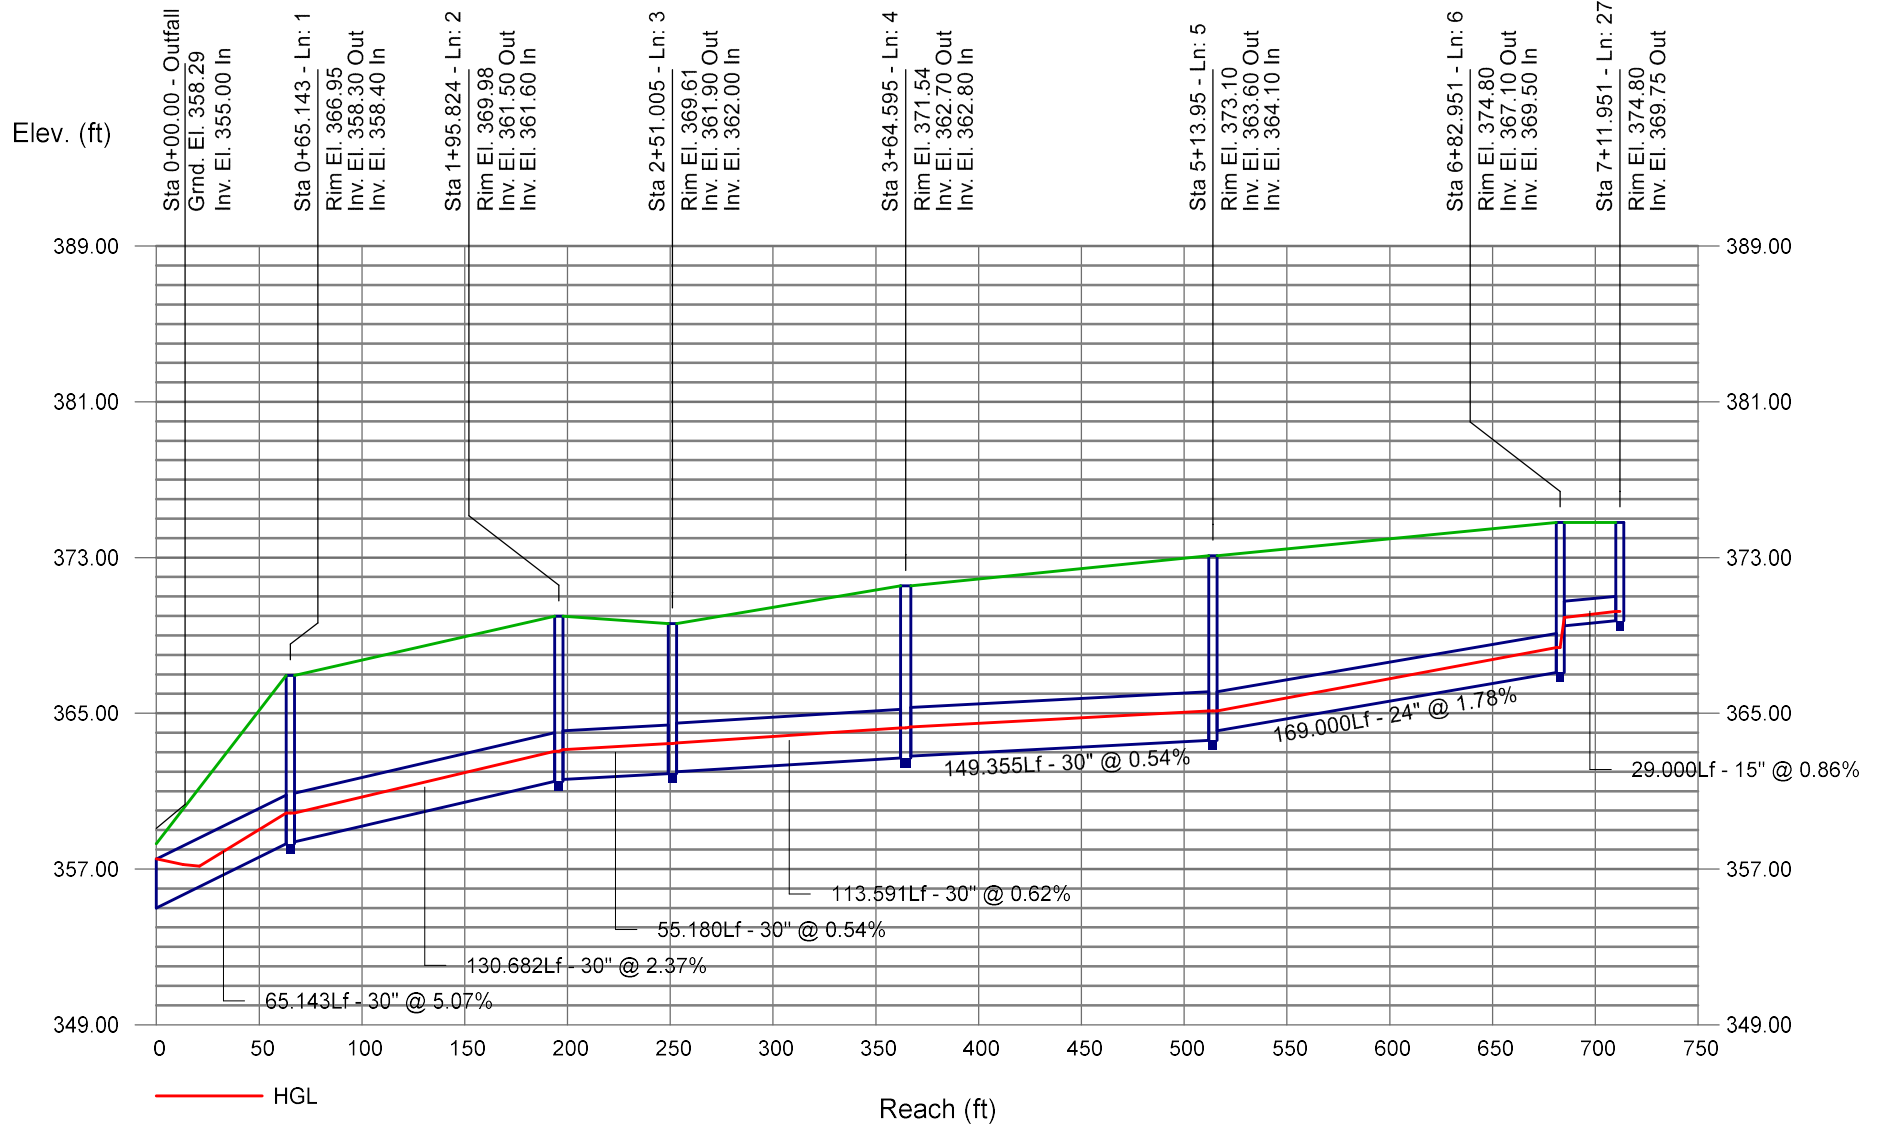


Storm Sewer Profile

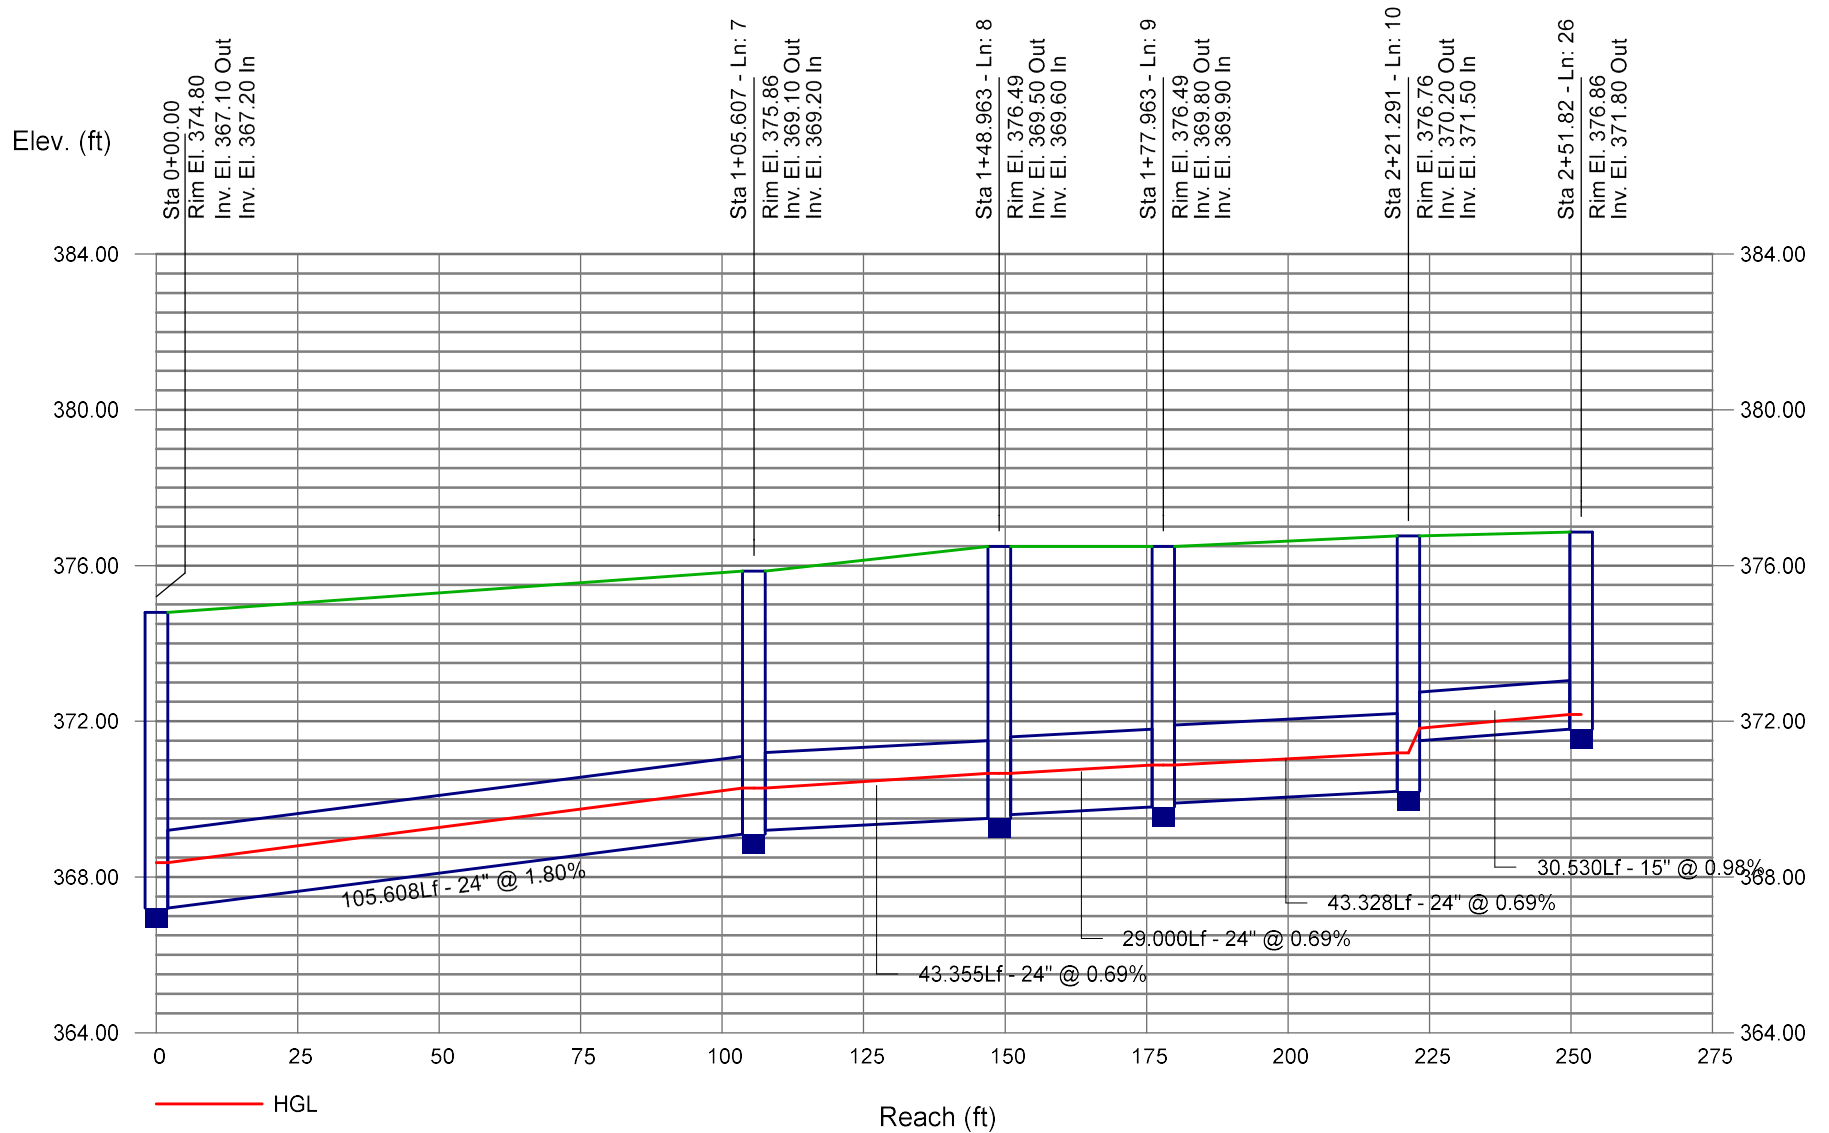


Storm Sewer Profile

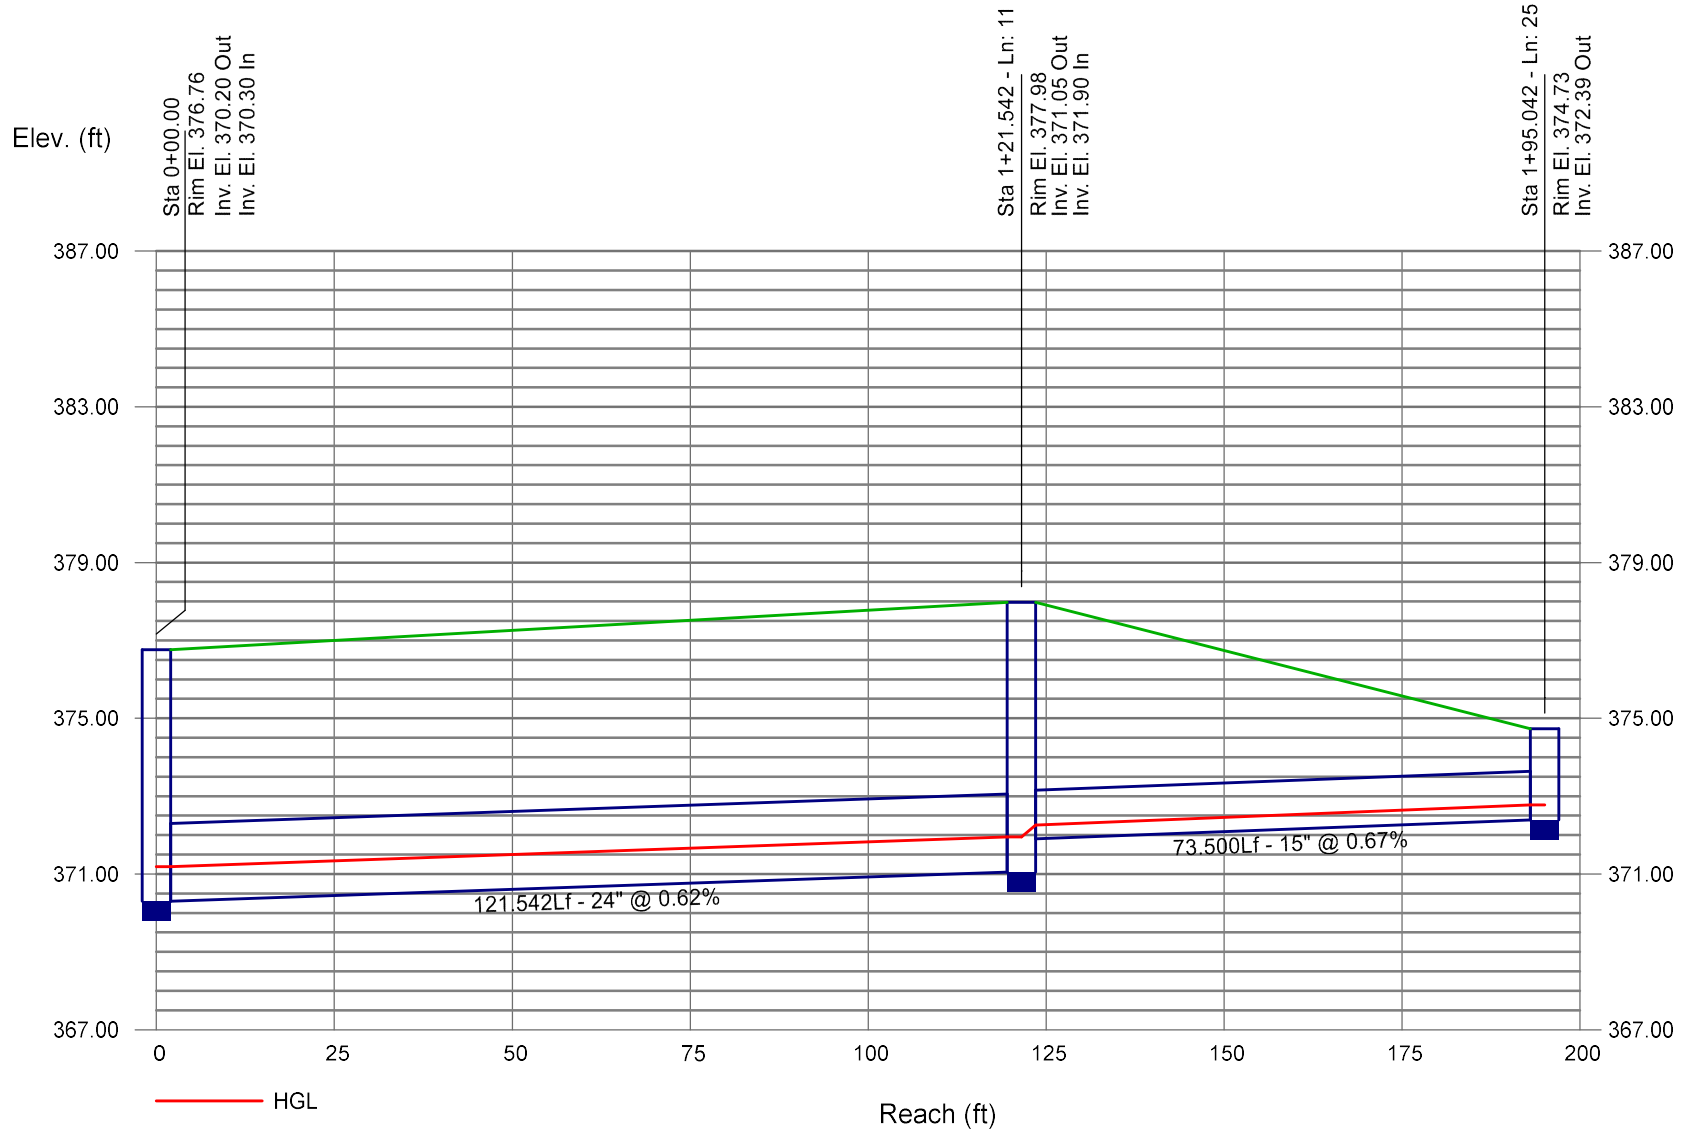


Storm Sewer Profile

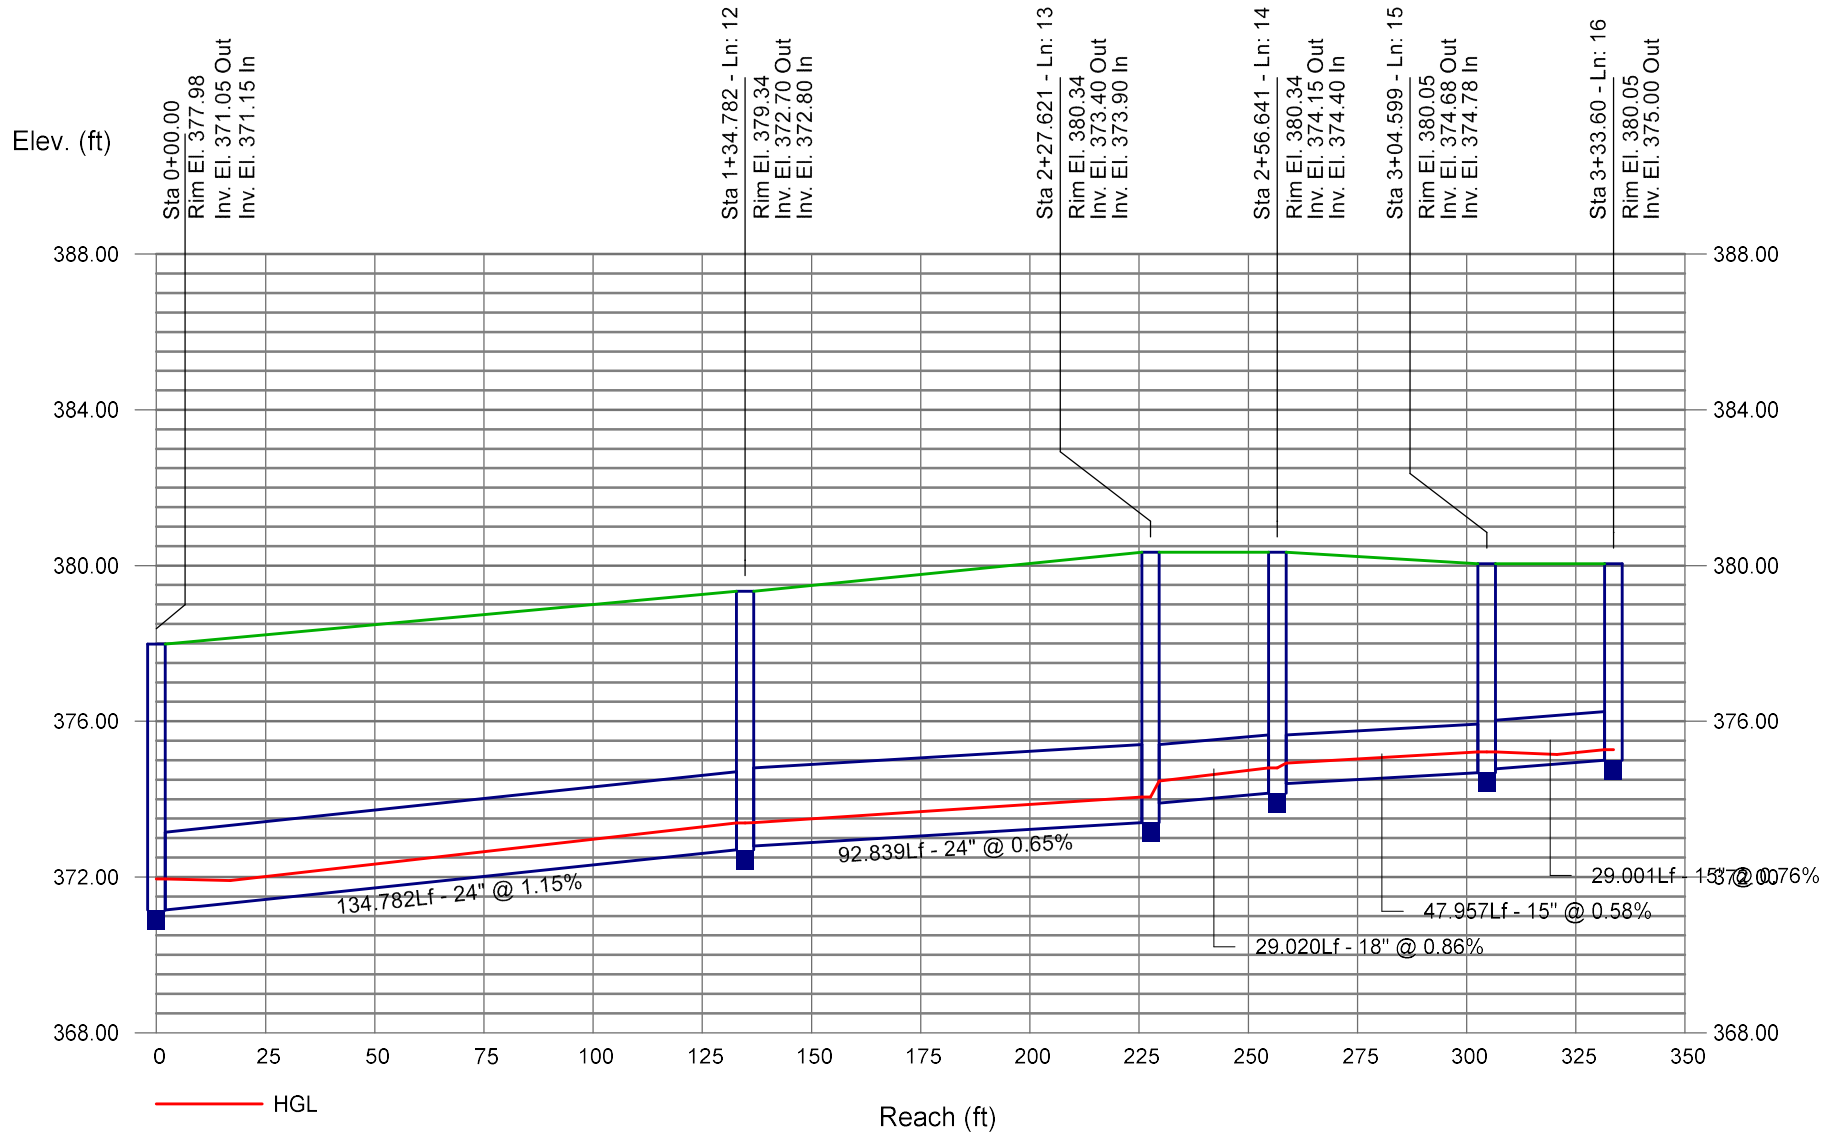


Storm Sewer Profile

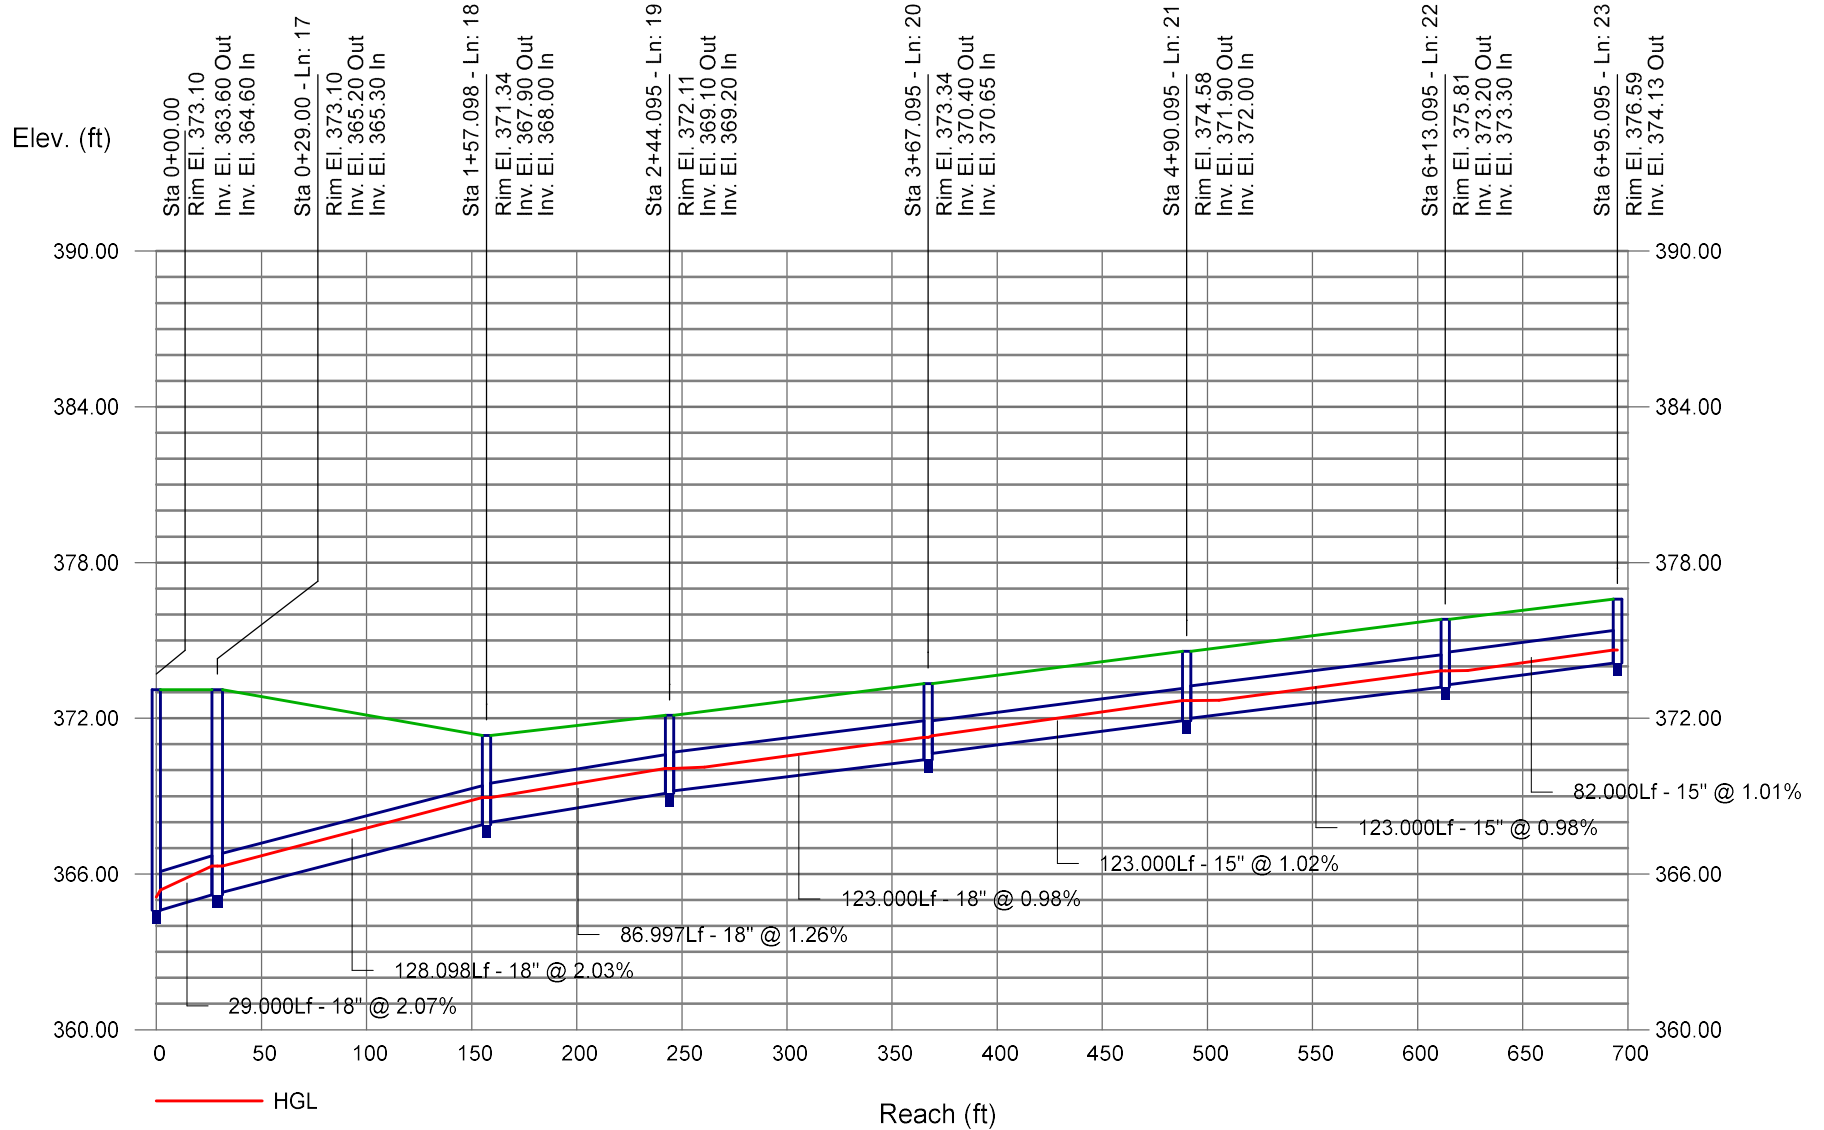


Storm Sewer Profile

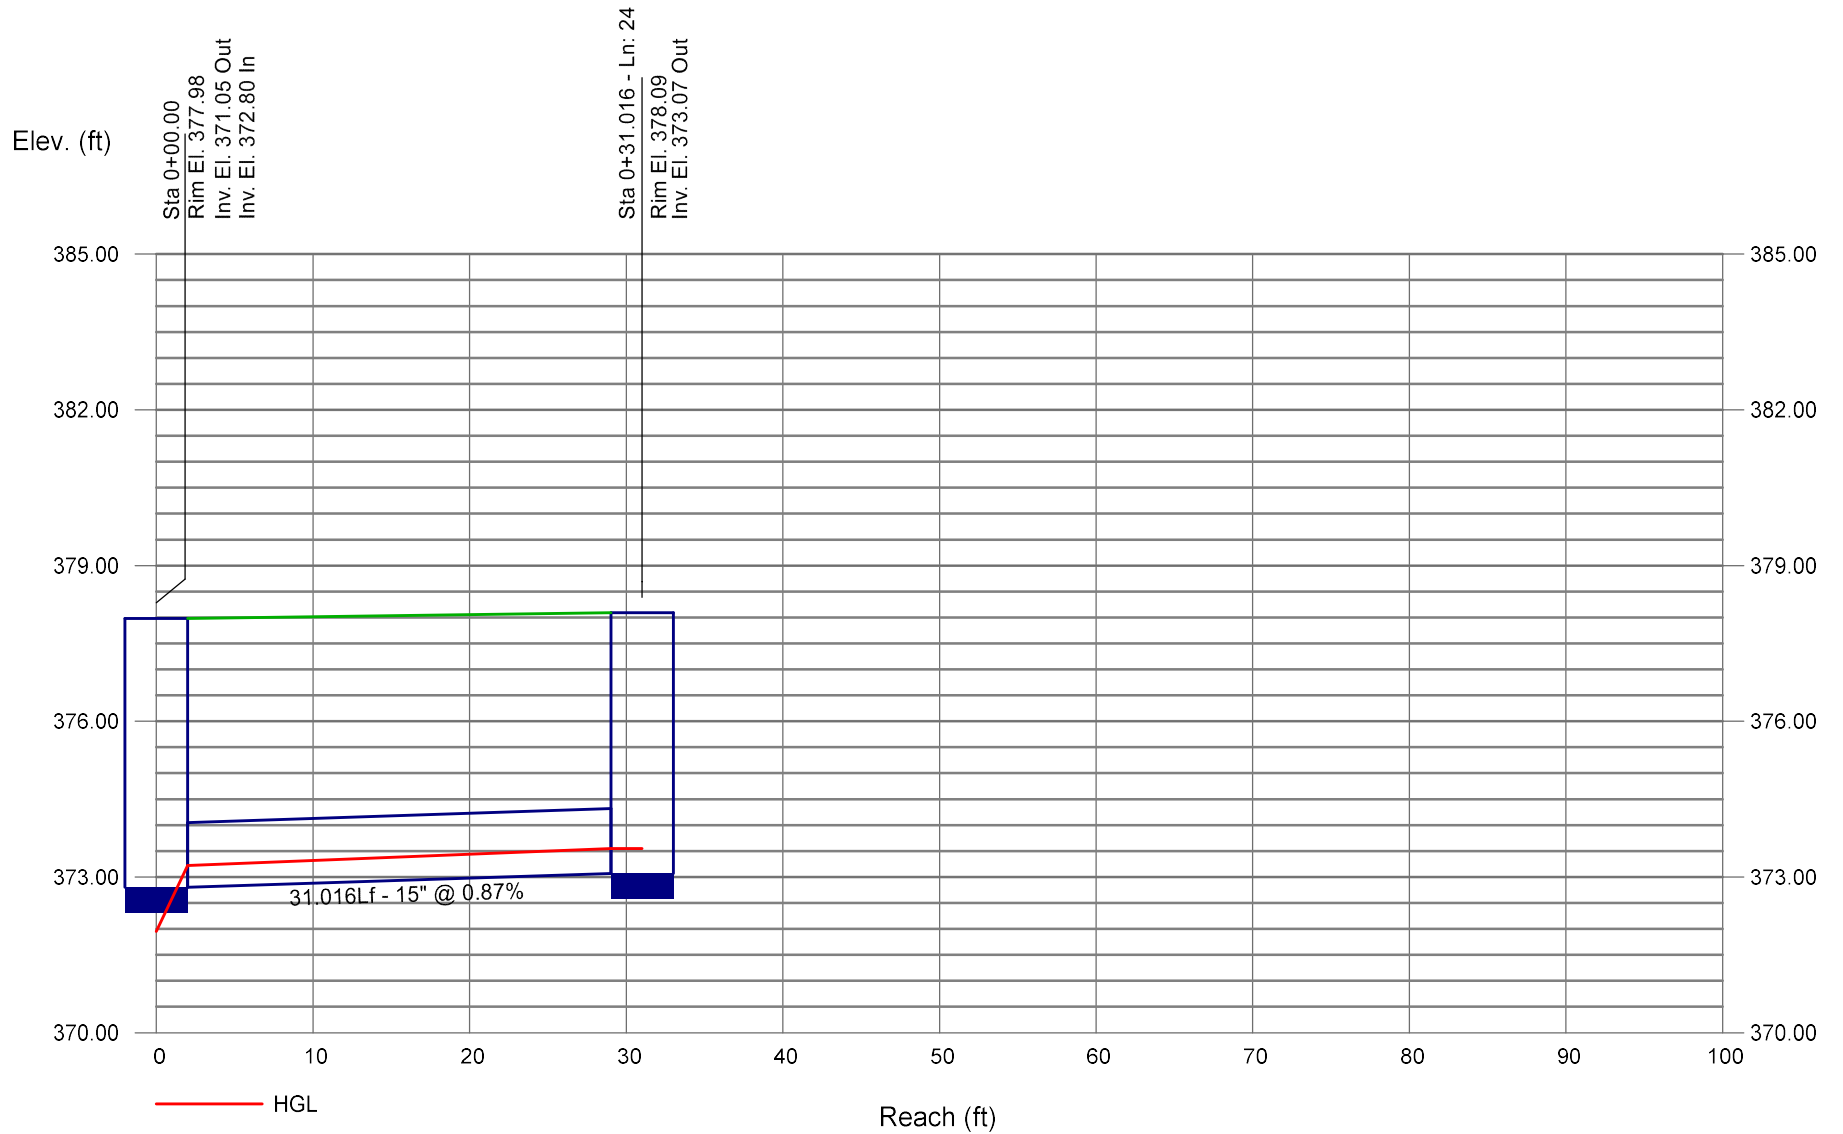


Storm Sewer Profile

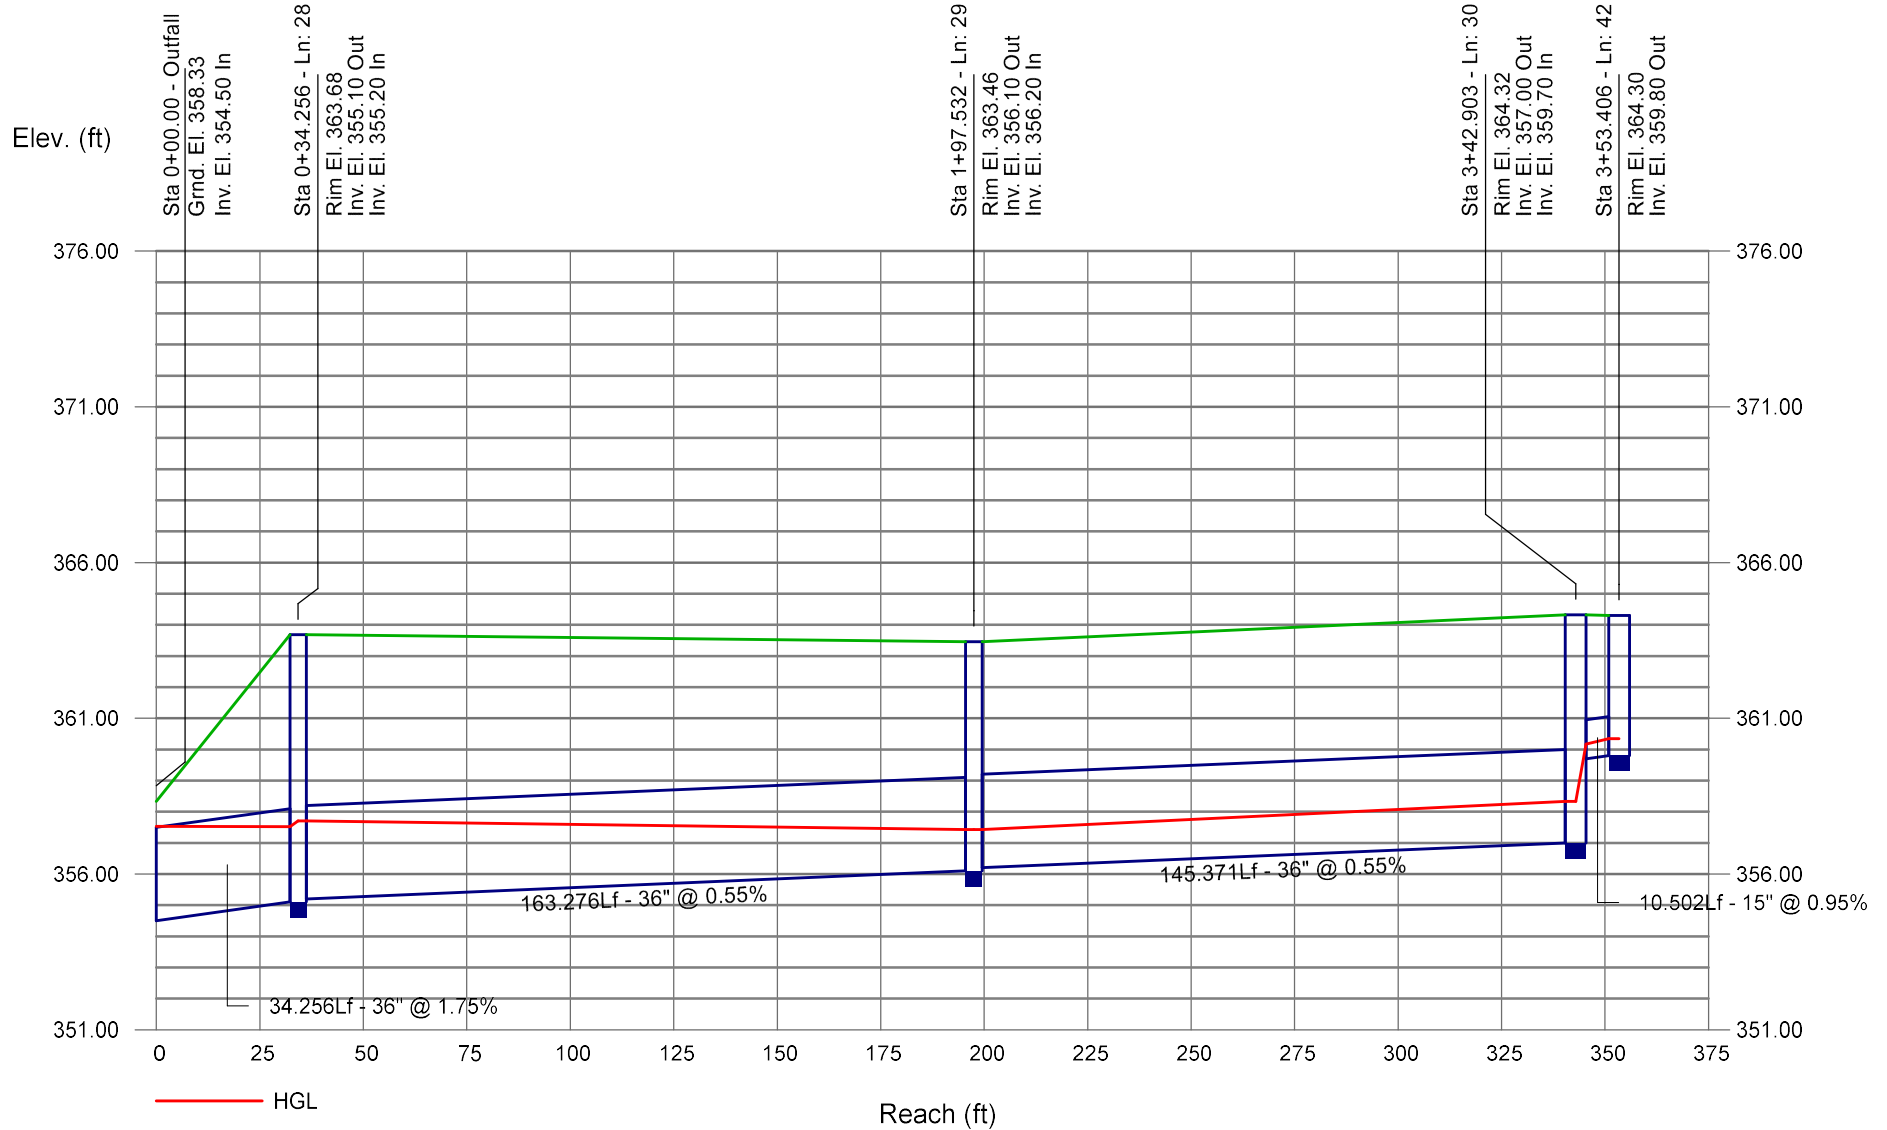


Storm Sewer Profile

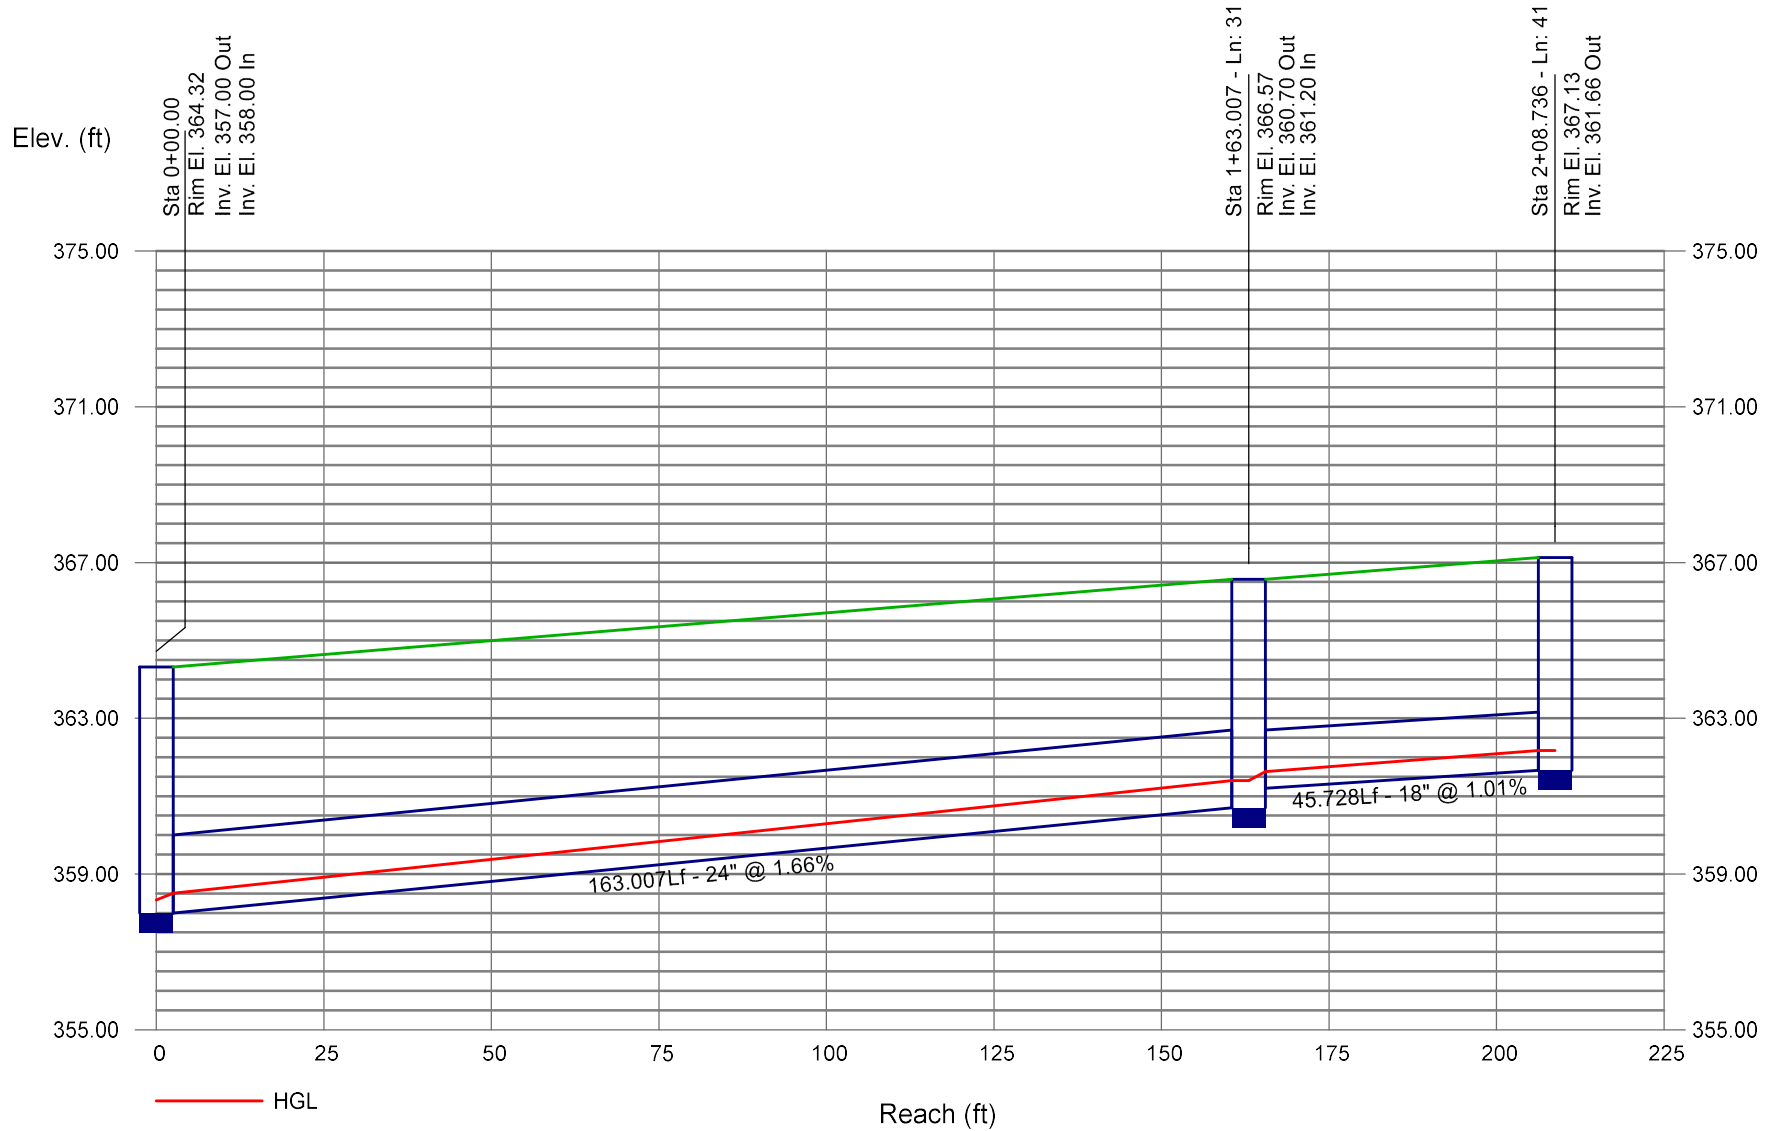


Storm Sewer Profile

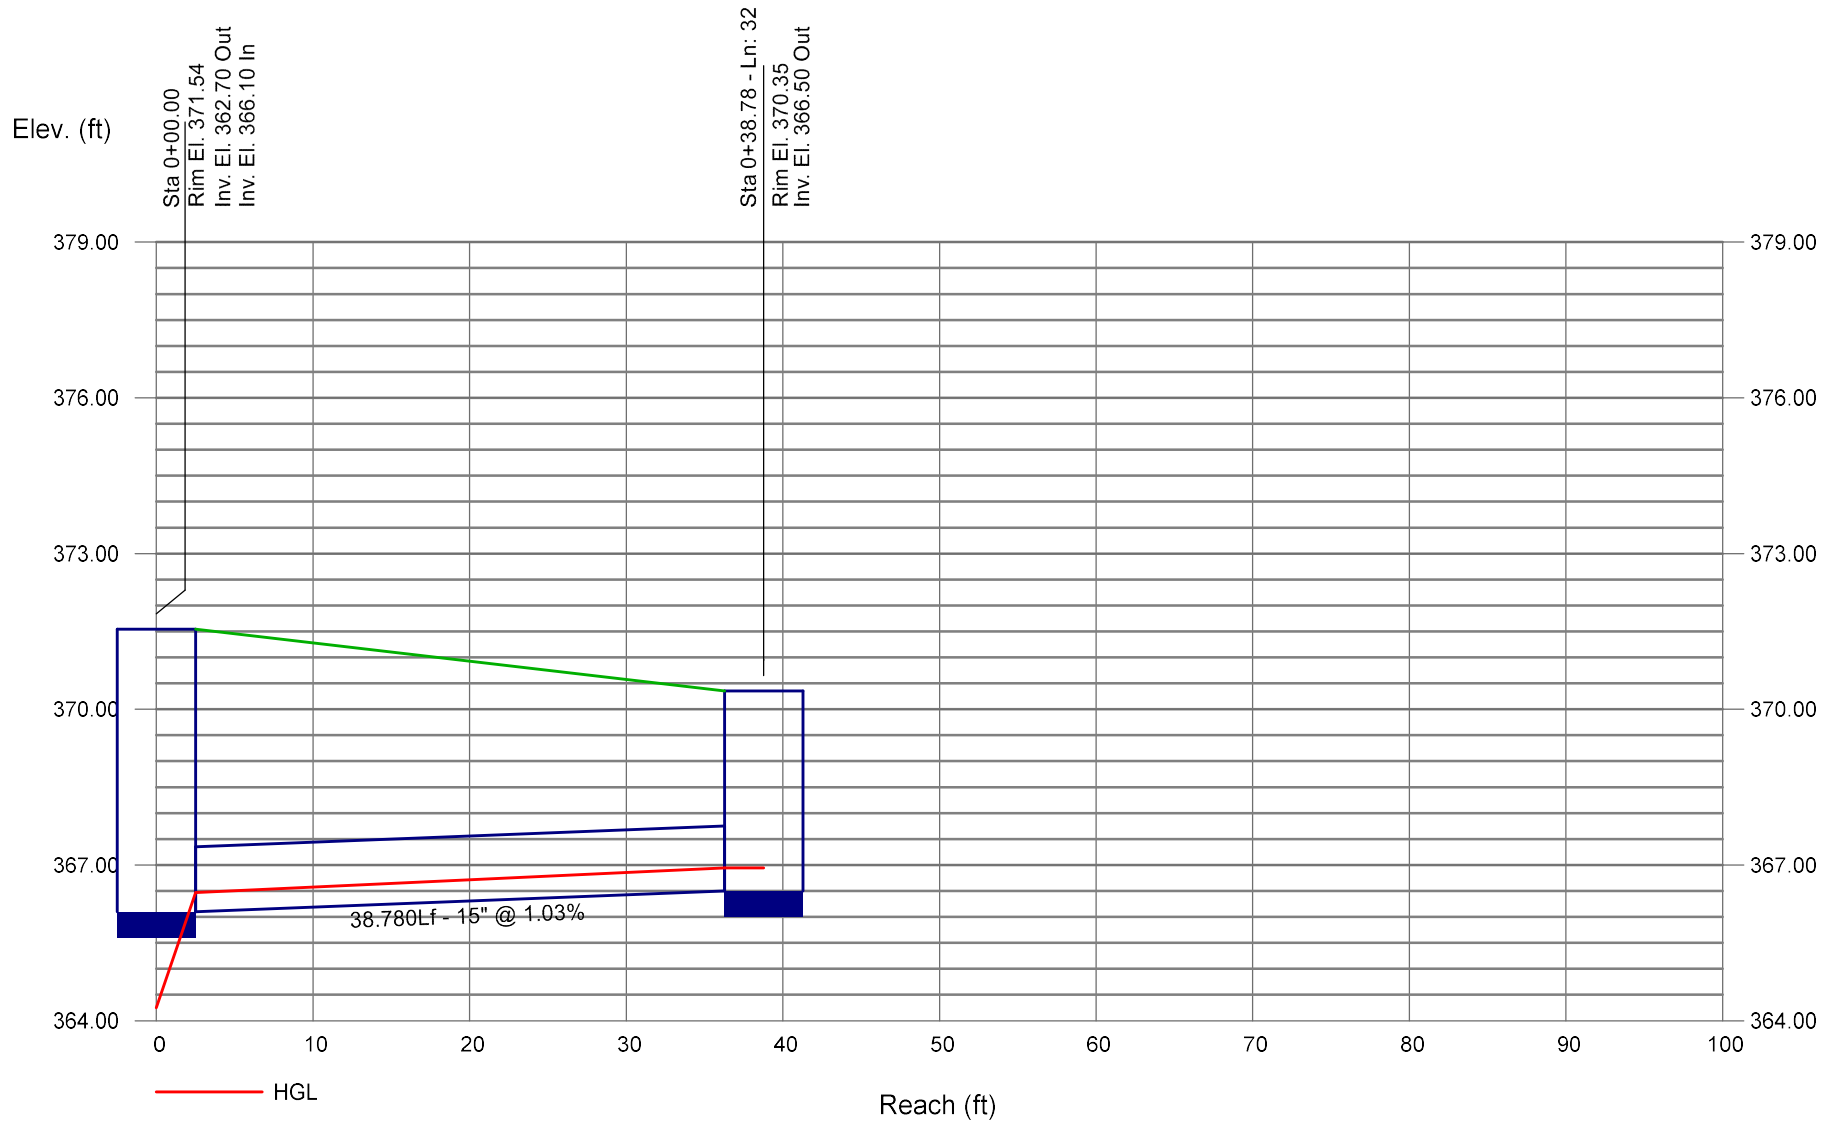

Storm Sewer Profile

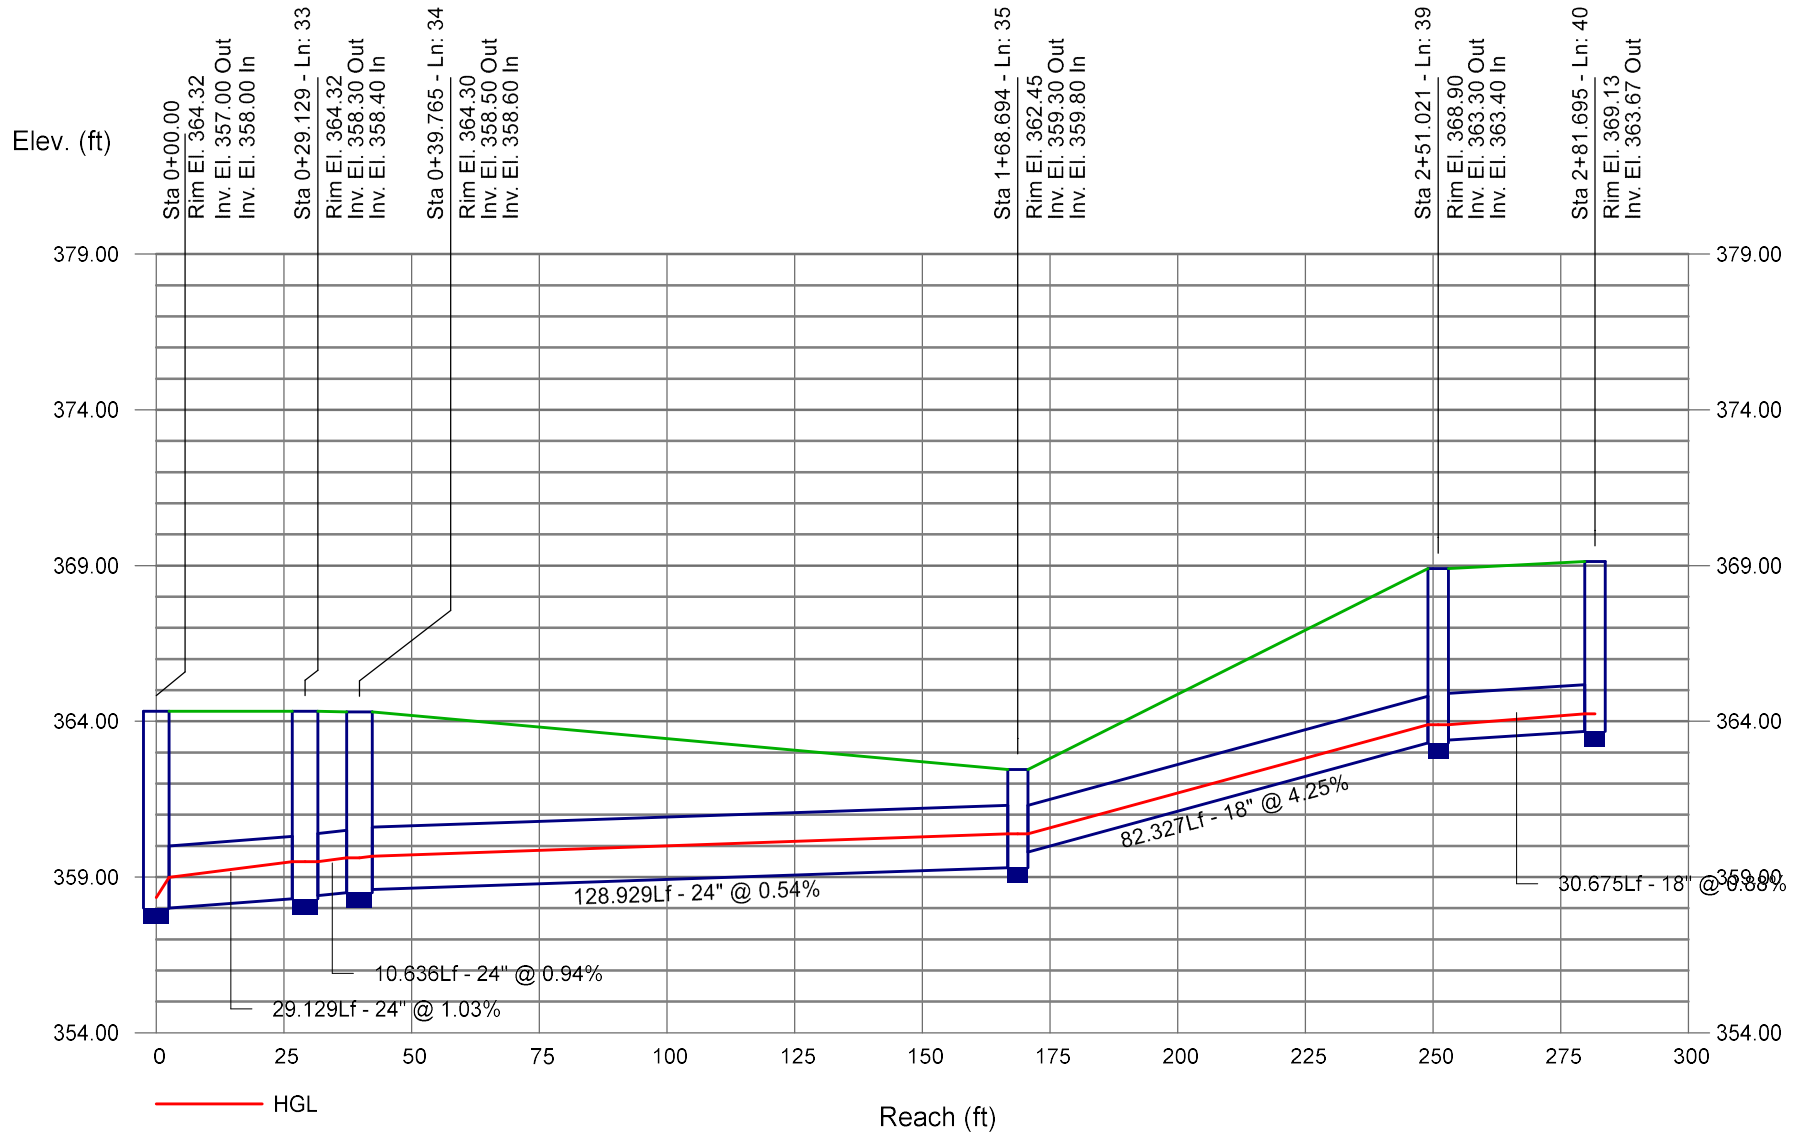

Storm Sewer Profile

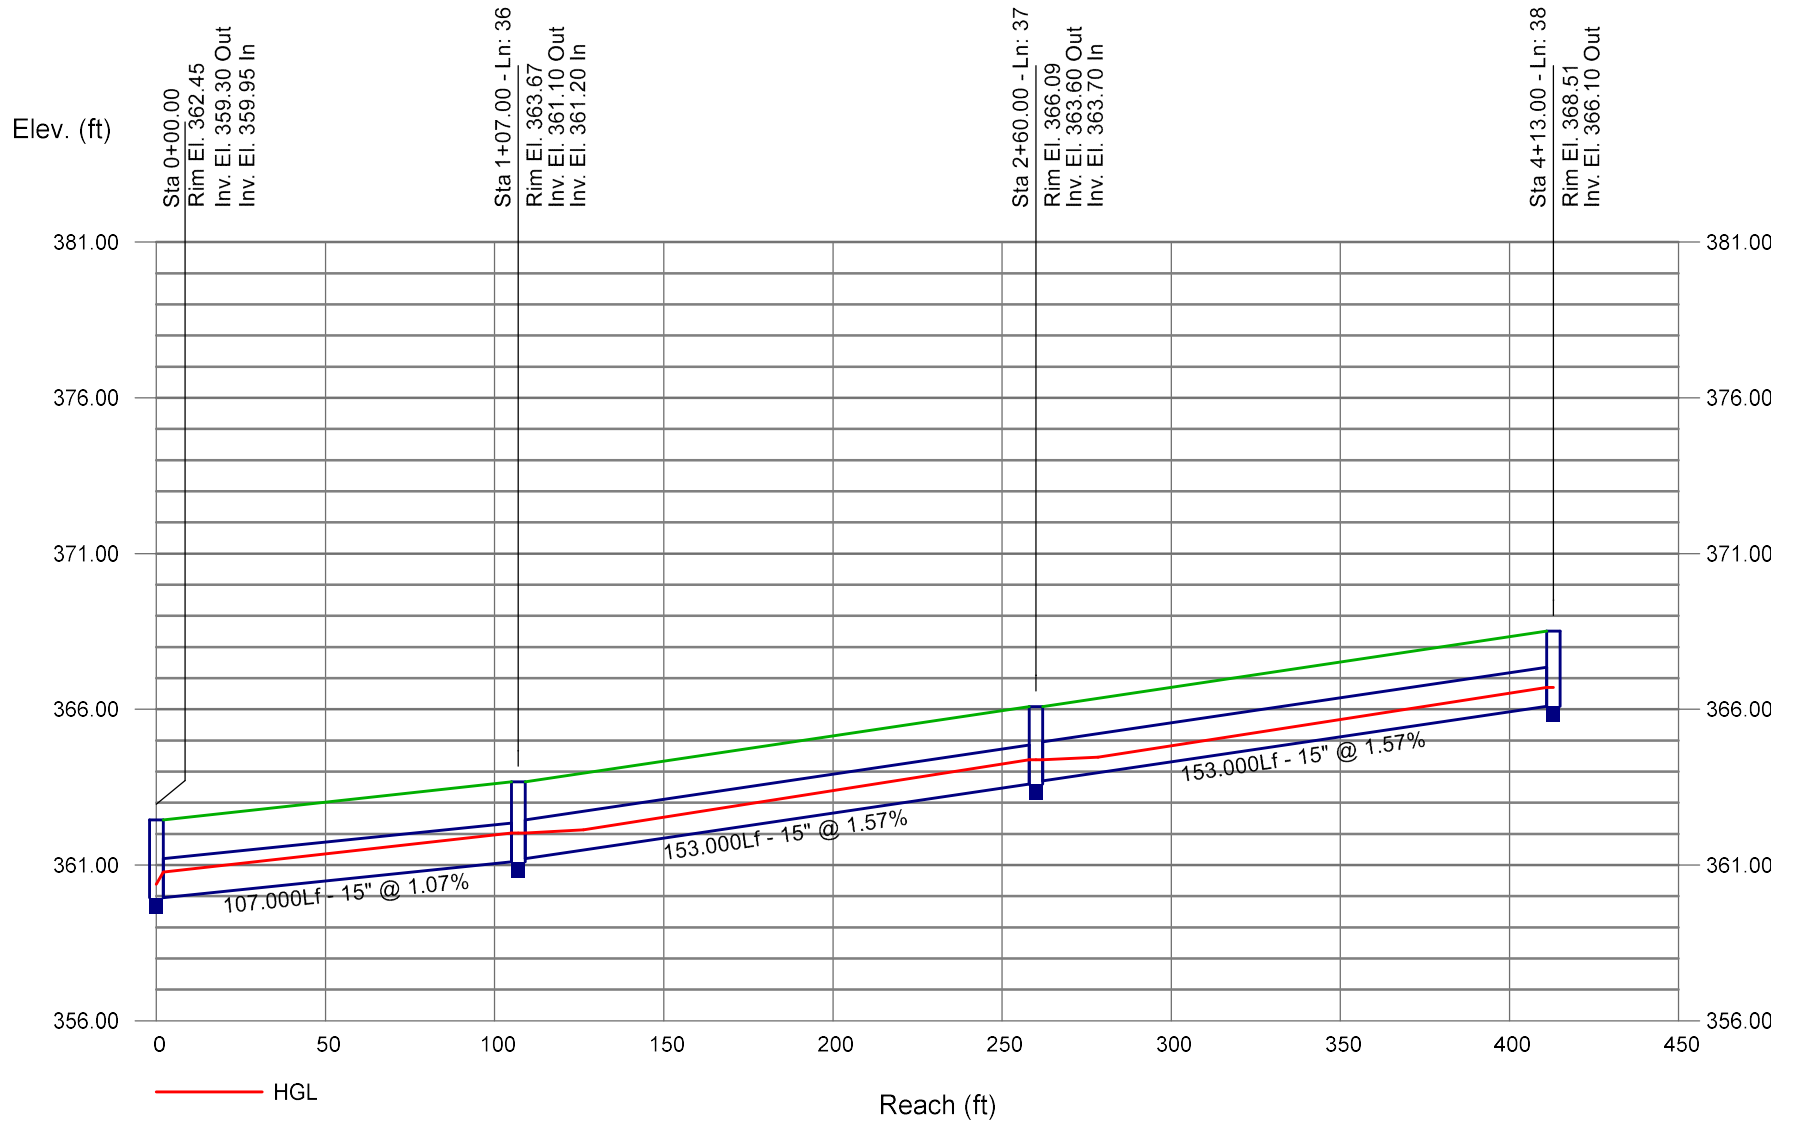

9. SCM 3: 4"/Hour Gutter Spread Chart

Spread

Line No.	Inlet ID	Junct Type	Byp Ln No	Drng Area (ac)	Inlet Time (min)	i Inlet (in/hr)	Runoff Coeff (C)	Incr Q (cfs)	Q Carry (cfs)	Q Capt (cfs)	Q Capt (cfs)	Gutter Spread (ft)
1	DI - 301	Dp-Grate	Offsite	0.24	5.0	4.00	0.60	0.58	0.00	0.52	0.52	8.76
2	DI - 302	Dp-Grate	Offsite	0.05	5.0	4.00	0.60	0.12	0.00	0.12	0.12	4.95
3	DI - 303	Dp-Grate	Offsite	0.04	5.0	4.00	0.60	0.10	0.00	0.10	0.10	4.95
4	CB - 304	Comb.	31	0.09	5.0	4.00	0.60	0.22	0.01	0.22	0.22	2.41
5	CB - 305	Comb.	4	0.11	5.0	4.00	0.60	0.26	0.00	0.26	0.26	3.06
6	CB - 306	Comb.	Offsite	0.17	5.0	4.00	0.60	0.41	0.03	0.40	0.40	4.01
7	CB - 307	Comb.	6	0.09	5.0	4.00	0.60	0.22	0.20	0.39	0.39	3.92
8	CB - 308	Comb.	7	0.43	5.0	4.00	0.60	1.03	0.00	0.83	0.83	5.69
9	CB - 309	Comb.	Sag	0.43	5.0	4.00	0.60	1.03	0.03	1.07	1.07	2.57
10	CB - 310	Comb.	9	0.19	5.0	4.00	0.60	0.46	0.00	0.42	0.42	4.12
11	CB - 311	Comb.	Offsite	0.22	5.0	4.00	0.60	0.53	0.02	0.49	0.49	4.49
12	CB - 312	Comb.	11	0.14	5.0	4.00	0.60	0.34	0.01	0.33	0.33	3.59
13	CB - 313	Comb.	12	0.14	5.0	4.00	0.60	0.34	0.00	0.32	0.32	3.51
14	CB - 314	Comb.	Sag	0.29	5.0	4.00	0.60	0.70	0.00	0.70	0.70	2.00
15	CB - 315	Comb.	Sag	0.33	5.0	4.00	0.60	0.79	0.00	0.79	0.79	2.00
16	CB - 316	Comb.	24	0.11	5.0	4.00	0.60	0.26	0.00	0.26	0.26	3.06
17	CB - 317	Comb.	32	0.28	5.0	4.00	0.60	0.67	0.16	0.71	0.71	4.99
18	DI - 318	Dp-Grate	Sag	0.28	5.0	4.00	0.60	0.67	0.17	0.84	0.84	10.41
19	DI - 319	Dp-Grate	18	0.38	5.0	4.00	0.60	0.91	0.14	0.88	0.88	11.62
20	DI - 320	Dp-Grate	19	0.35	5.0	4.00	0.60	0.84	0.13	0.83	0.83	11.62
21	DI - 321	Dp-Grate	20	0.34	5.0	4.00	0.60	0.82	0.07	0.76	0.76	10.67
22	DI - 322	Dp-Grate	21	0.21	5.0	4.00	0.60	0.50	0.13	0.57	0.57	9.71
23	DI - 323	Dp-Grate	22	0.37	5.0	4.00	0.60	0.89	0.00	0.76	0.76	10.67

Project File: SCM3 CHECK.stm	Number of lines: 42	Date: 10/30/2024
------------------------------	---------------------	------------------

NOTES: Intensity = 4.00 / (Inlet time + 0.10) ^ 0.00 -- Return period = 3 Yrs. ; ** Critical depth

Spread

Line No.	Inlet ID	Junct Type	Byp Ln No	Drng Area (ac)	Inlet Time (min)	i Inlet (in/hr)	Runoff Coeff (C)	Incr Q (cfs)	Q Carry (cfs)	Q Capt (cfs)	Q Capt (cfs)	Gutter Spread (ft)
24	CB - 326	Comb.	26	0.34	5.0	4.00	0.60	0.82	0.01	0.69	0.69	5.45
25	DI - 327	Dp-Grate	Sag	0.22	5.0	4.00	0.60	0.53	0.00	0.53	0.53	8.70
26	CB - 325	Comb.	27	0.21	5.0	4.00	0.60	0.50	0.13	0.56	0.56	4.85
27	CB - 324	Comb.	17	0.34	5.0	4.00	0.60	0.82	0.08	0.74	0.74	5.66
28	DI - 351	Dp-Grate	Offsite	0.08	5.0	4.00	0.60	0.19	0.00	0.19	0.19	5.90
29	DI - 352	Dp-Grate	Sag	0.12	5.0	4.00	0.60	0.29	0.00	0.29	0.29	7.14
30	CB - 353	Comb.	42	0.28	5.0	4.00	0.60	0.67	0.27	0.76	0.76	5.79
31	CB - 361	Comb.	30	0.52	5.0	4.00	0.60	1.25	0.00	0.98	0.98	5.91
32	CB - 328	Comb.	41	0.29	5.0	4.00	0.60	0.70	0.12	0.70	0.70	4.88
33	CB - 354	Comb.	34	0.35	5.0	4.00	0.60	0.84	0.23	0.85	0.85	6.12
34	CB - 355	Comb.	Sag	0.21	5.0	4.00	0.60	0.50	0.22	0.73	0.73	2.00
35	DI - 356	Dp-Grate	Sag	0.48	5.0	4.00	0.60	1.15	0.20	1.36	1.36	12.83
36	DI - 357	Dp-Grate	35	0.39	5.0	4.00	0.60	0.94	0.22	0.95	0.95	11.62
37	DI - 358	Dp-Grate	36	0.38	5.0	4.00	0.60	0.91	0.26	0.95	0.95	10.67
38	DI - 359	Dp-Grate	37	0.53	5.0	4.00	0.60	1.27	0.00	1.01	1.01	10.67
39	CB - 365	Comb.	34	0.04	5.0	4.00	0.60	0.10	0.00	0.10	0.10	1.49
40	CB - 366	Comb.	42	0.53	5.0	4.00	0.60	1.27	0.00	1.02	1.02	5.50
41	CB - 364	Comb.	33	0.43	5.0	4.00	0.60	1.03	0.11	0.92	0.92	5.70
42	CB - 360	Comb.	Sag	0.44	5.0	4.00	0.60	1.06	0.42	1.48	1.48	4.16

Project File: SCM3 CHECK.stm	Number of lines: 42	Date: 10/30/2024
------------------------------	---------------------	------------------

NOTES: Intensity = 4.00 / (Inlet time + 0.10) ^ 0.00 -- Return period = 3 Yrs. ; ** Critical depth

10. SCM 4: 10-YR Storm Drainage Chart

Pipes

Line No.	Junct Type	Inlet ID	DnStm Ln No	Drng Area (ac)	Tc (min)	i Sys (in/hr)	Runoff Coeff (C)	Total Runoff (cfs)	Capac Full (cfs)	Line Length (ft)	Line Size (in)	n-val Pipe	Line Slope (%)	Invert Up (ft)	Invert Dn (ft)	Gnd/Rim El Up (ft)	Gnd/Rim El Dn (ft)	HGL Up (ft)	HGL Dn (ft)
1	Dp-Grate	DI - 401	Outfall	0.18	16.8	4.97	0.70	15.28	32.60	167.197	30	0.012	0.54	363.40	362.50	373.33	365.79	365.34	365.20
2	Dp-Grate	DI - 402	1	0.13	14.0	5.35	0.70	9.63	18.26	171.000	24	0.012	0.56	364.85	363.90	374.46	373.33	365.96 j	365.68
3	Dp-Grate	DI - 403	2	0.16	13.2	5.48	0.70	9.36	17.73	171.801	24	0.012	0.52	365.85	364.95	374.27	374.46	366.94	365.98
4	Comb.	CB - 404	3	0.08	12.6	5.57	0.70	8.90	16.78	118.130	24	0.013	0.55	366.60	365.95	372.28	374.27	367.66	366.99
5	Comb.	CB - 419	4	0.03	12.3	5.63	0.70	5.91	9.15	85.609	18	0.013	0.76	367.75	367.10	374.68	372.28	368.69	367.98
6	Comb.	CB - 420	5	0.39	12.0	5.68	0.70	5.53	8.48	61.313	18	0.013	0.65	368.25	367.85	374.86	374.68	369.16	368.73
7	Comb.	CB - 421	6	0.32	11.9	5.70	0.70	3.99	6.57	29.000	15	0.013	1.03	368.80	368.50	374.86	374.86	369.61	369.20
8	Comb.	CB - 422	7	0.26	11.7	5.74	0.70	2.73	4.97	33.758	15	0.013	0.59	369.10	368.90	374.99	374.86	369.76 j	369.61
9	Dp-Grate	DI - 423	8	0.33	10.6	5.92	0.70	1.74	5.34	103.022	15	0.012	0.58	369.80	369.20	372.23	374.99	370.32 j	369.76
10	Dp-Grate	DI - 415	9	0.09	5.0	7.25	0.70	0.46	9.56	125.935	15	0.012	1.87	372.25	369.90	374.75	372.23	372.51 j	370.32
11	Dp-Grate	DI - 451	Outfall	0.73	11.7	5.72	0.70	11.46	51.82	38.884	36	0.012	0.51	362.70	362.50	369.53	366.33	363.77	365.20
12	Comb.	CB - 452	11	0.12	9.1	6.22	0.70	9.28	50.95	222.786	36	0.013	0.58	364.10	362.80	371.48	369.53	365.06 j	363.77
13	Comb.	CB - 458	12	0.06	5.7	7.06	0.70	1.19	8.51	204.596	15	0.013	1.74	369.40	365.85	374.67	371.48	369.83	366.17
14	Comb.	CB - 459	13	0.18	5.0	7.25	0.70	0.91	6.52	29.435	15	0.013	1.02	369.80	369.50	374.76	374.67	370.17	369.83
15	Comb.	CB - 408	1	0.38	16.0	5.07	0.70	5.82	30.07	107.500	24	0.013	1.77	365.80	363.90	374.16	373.33	366.65 j	365.68
16	Comb.	CB - 409	15	0.04	15.4	5.15	0.70	4.54	19.39	68.000	24	0.013	0.74	366.40	365.90	373.48	374.16	367.15 j	366.65
17	Comb.	CB - 410	16	0.55	15.2	5.19	0.70	4.43	18.78	29.000	24	0.013	0.69	366.70	366.50	373.48	373.48	367.44	367.16
18	Comb.	CB - 411	17	0.12	14.8	5.25	0.70	2.46	7.90	44.196	18	0.013	0.57	367.45	367.20	373.03	373.48	368.04	367.78
19	Comb.	CB - 412	18	0.02	13.8	5.39	0.70	1.74	9.02	74.500	18	0.013	0.74	368.10	367.55	374.02	373.03	368.60	368.04
20	Comb.	CB - 417	19	0.04	10.5	5.95	0.70	0.29	15.50	39.005	18	0.013	2.18	369.05	368.20	374.54	374.02	369.25 j	368.60
21	Comb.	CB - 418	20	0.03	5.0	7.25	0.70	0.15	5.52	41.004	15	0.013	0.73	369.60	369.30	374.54	374.54	369.75	369.44
22	Comb.	CB - 424	5	0.08	5.0	7.25	0.70	0.41	10.64	66.281	15	0.013	2.72	371.00	369.20	375.68	374.68	371.25	369.37
23	Dp-Grate	DI - 413	19	0.21	11.1	5.84	0.70	1.51	13.69	17.657	18	0.013	1.70	368.50	368.20	371.35	374.02	368.96	368.60

Project File: SCM4.stm

Number of lines: 33

Date: 10/30/2024

NOTES: Intensity = 86.72 / (Inlet time + 15.30) ^ 0.82 -- Return period = 10 Yrs. ; ** Critical depth

Pipes


Line No.	Junct Type	Inlet ID	DnStm Ln No	Drng Area (ac)	Tc (min)	i Sys (in/hr)	Runoff Coeff (C)	Total Runoff (cfs)	Capac Full (cfs)	Line Length (ft)	Line Size (in)	n-val Pipe	Line Slope (%)	Invert Up (ft)	Invert Dn (ft)	Gnd/Rim El Up (ft)	Gnd/Rim El Dn (ft)	HGL Up (ft)	HGL Dn (ft)
24	Dp-Grate	DI - 414	23	0.16	5.0	7.25	0.70	0.81	13.72	168.344	18	0.012	1.46	371.05	368.60	373.64	371.35	371.39 j	368.96
25	Comb.	CB - 405	4	0.02	6.7	6.79	0.70	3.33	5.39	43.114	15	0.013	0.70	367.60	367.30	373.06	372.28	368.33	368.01
26	Comb.	CB - 406	25	0.30	6.2	6.91	0.70	3.29	5.26	75.320	15	0.013	0.66	368.20	367.70	373.27	373.06	368.93	368.42
27	Dp-Grate	DI - 407	26	0.38	5.0	7.25	0.70	1.93	5.03	115.500	15	0.013	0.61	369.00	368.30	371.71	373.27	369.55 j	368.93
28	Comb.	CB - 416	18	0.09	5.0	7.25	0.70	0.46	8.20	41.000	18	0.013	0.61	367.80	367.55	373.03	373.03	368.05 j	368.04
29	Comb.	CB - 453	12	0.13	7.8	6.51	0.70	8.07	19.54	13.394	24	0.013	0.75	365.20	365.10	371.48	371.48	366.21	366.00
30	Comb.	CB - 454	29	0.25	7.7	6.54	0.70	7.50	9.75	29.001	18	0.013	0.86	365.95	365.70	371.48	371.48	367.01	366.69
31	Comb.	CB - 455	30	0.36	7.7	6.54	0.70	6.37	11.74	8.000	18	0.013	1.25	366.15	366.05	371.47	371.48	367.13	367.01
32	Dp-Grate	DI - 456	31	0.69	6.9	6.73	0.70	4.85	7.78	127.500	18	0.013	0.55	366.95	366.25	369.65	371.47	367.80 j	367.13
33	Dp-Grate	DI - 457	32	0.34	5.0	7.25	0.70	1.73	8.49	162.929	15	0.012	1.47	369.70	367.30	372.17	369.65	370.22 j	368.31

Project File: SCM4.stm	Number of lines: 33	Date: 10/30/2024
------------------------	---------------------	------------------

NOTES: Intensity = 86.72 / (Inlet time + 15.30) ^ 0.82 -- Return period = 10 Yrs. ; ** Critical depth

11. SCM 4: 10-YR HGL Profiles

Hydraflow Storm Sewers Extension for Autodesk® Civil 3D® Plan

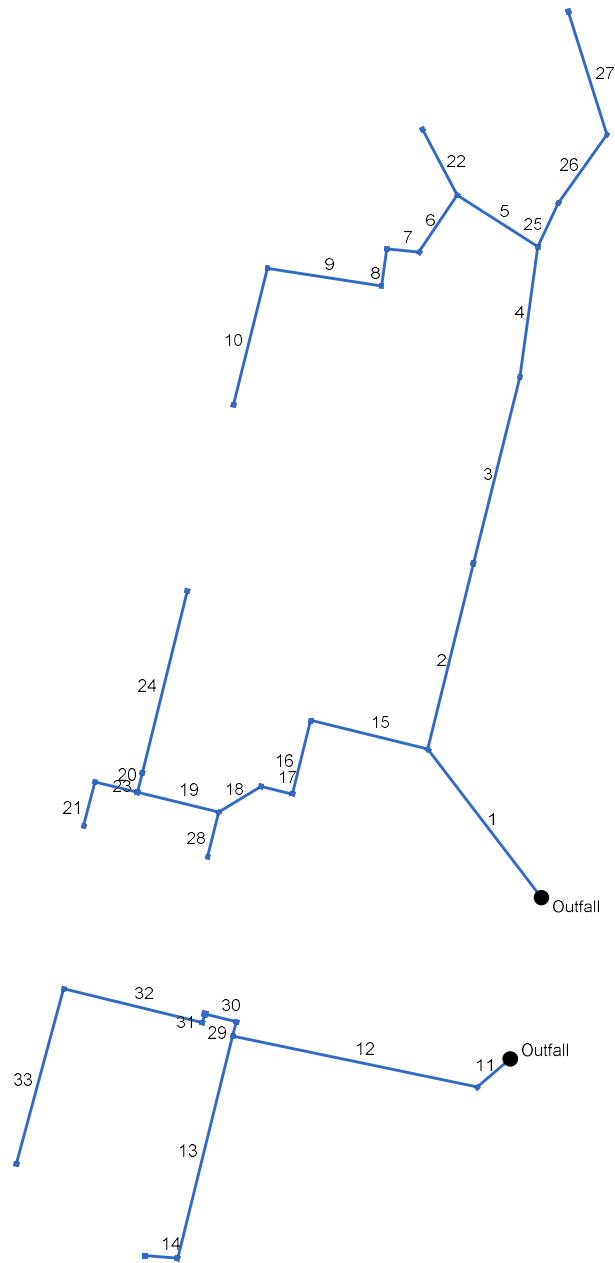


Project File: SCM4.stm


Number of lines: 33

Date: 10/30/2024


Storm Sewer Profile

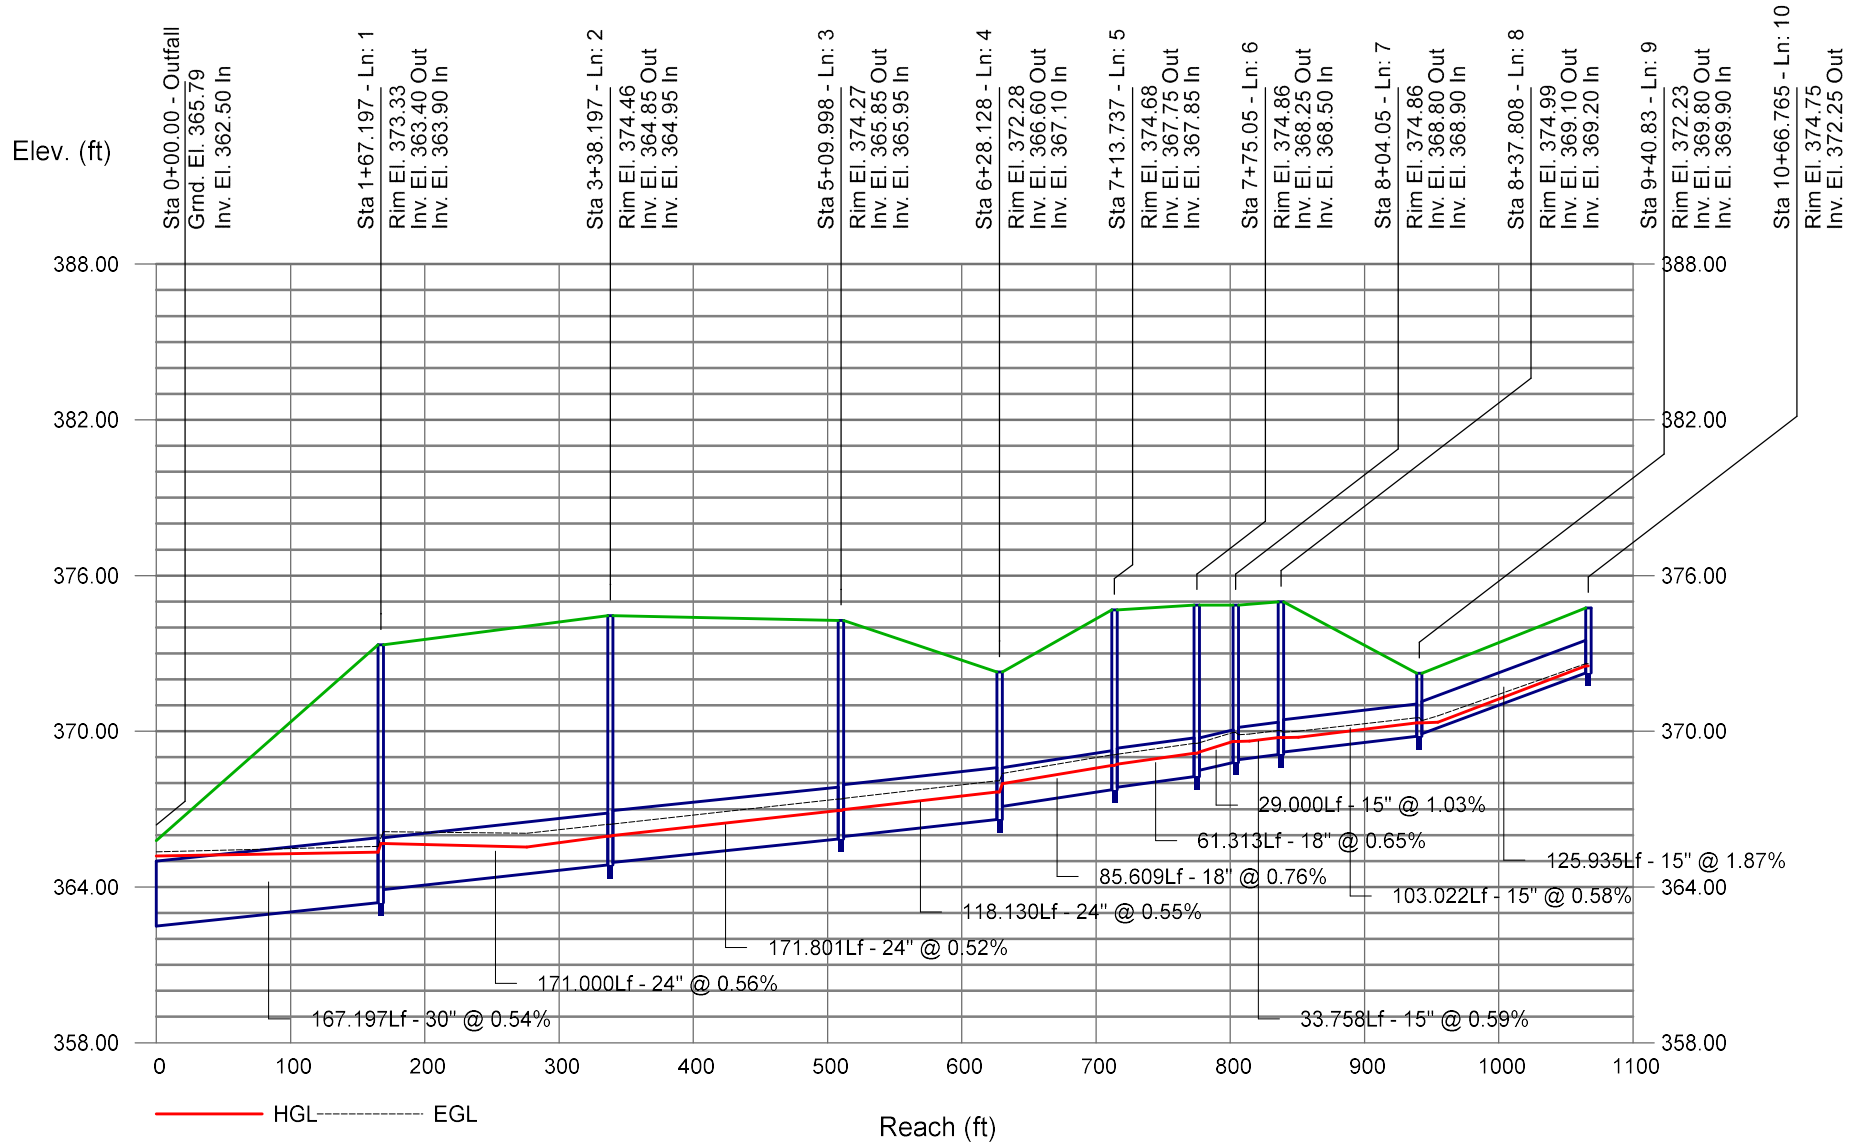


Storm Sewer Profile

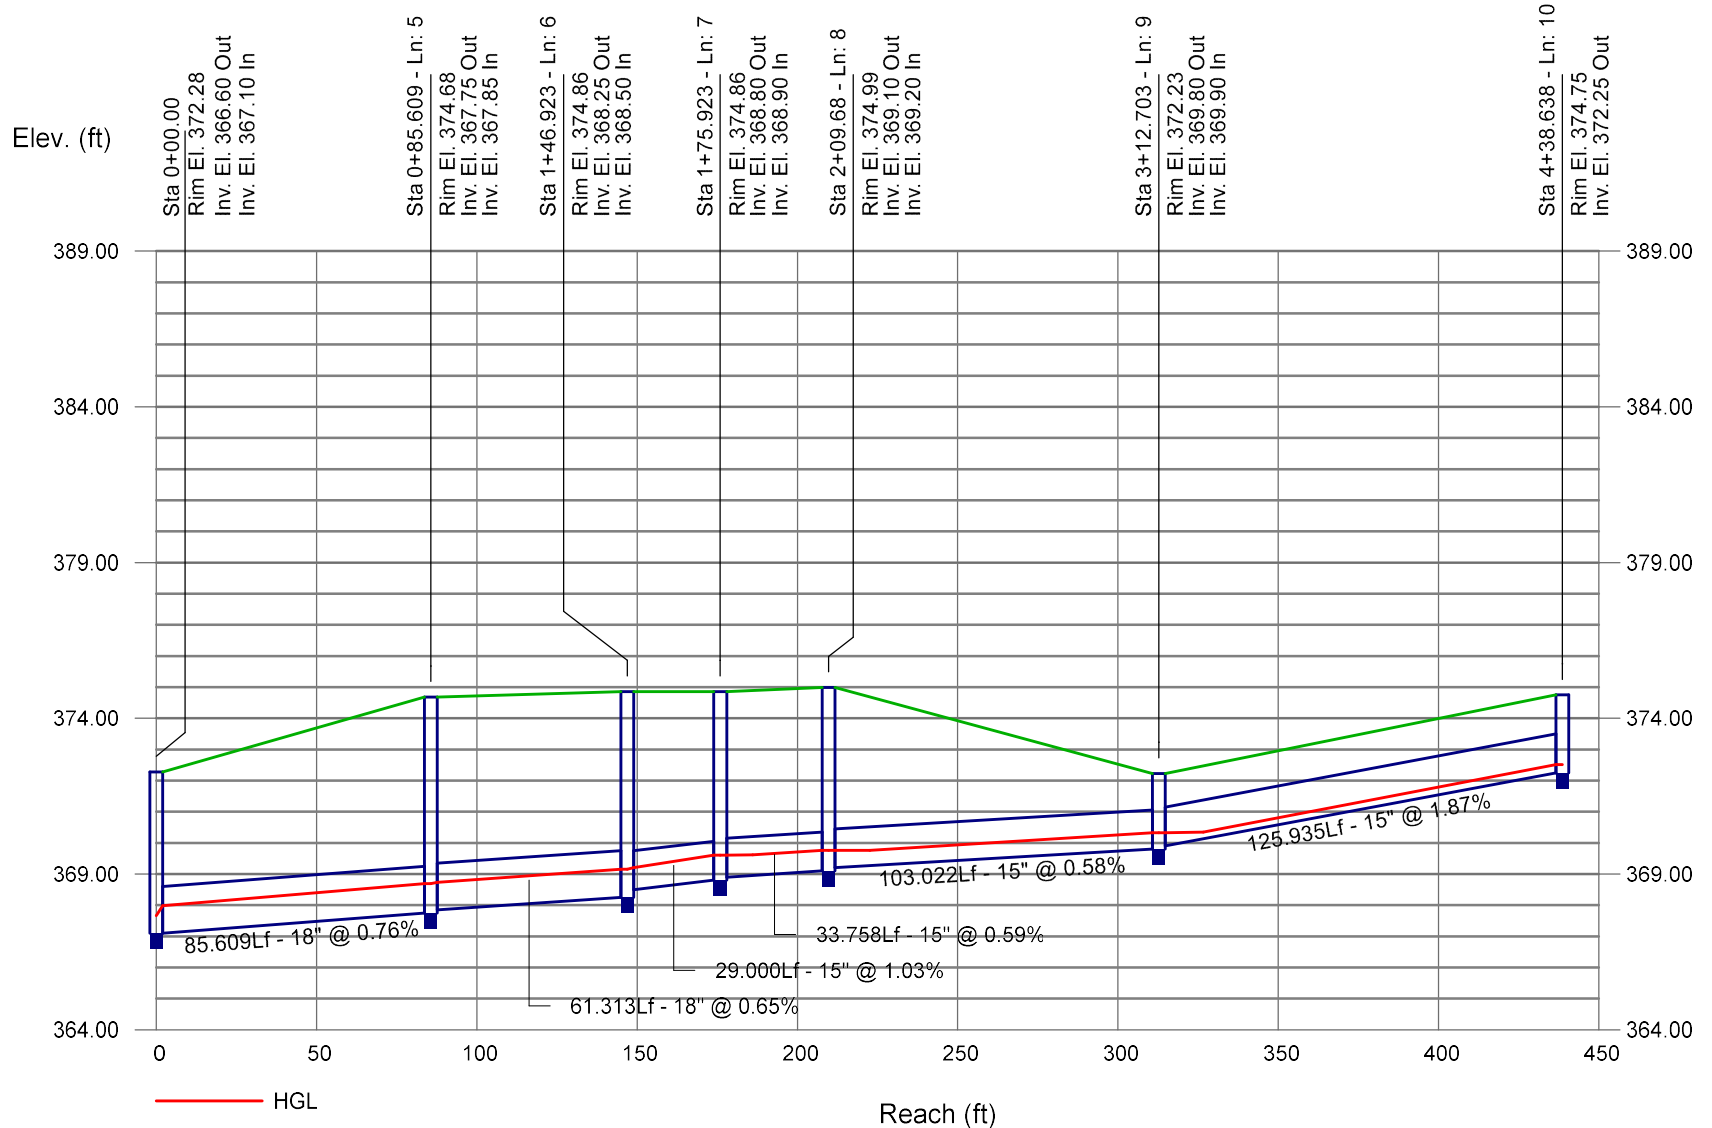


Storm Sewer Profile

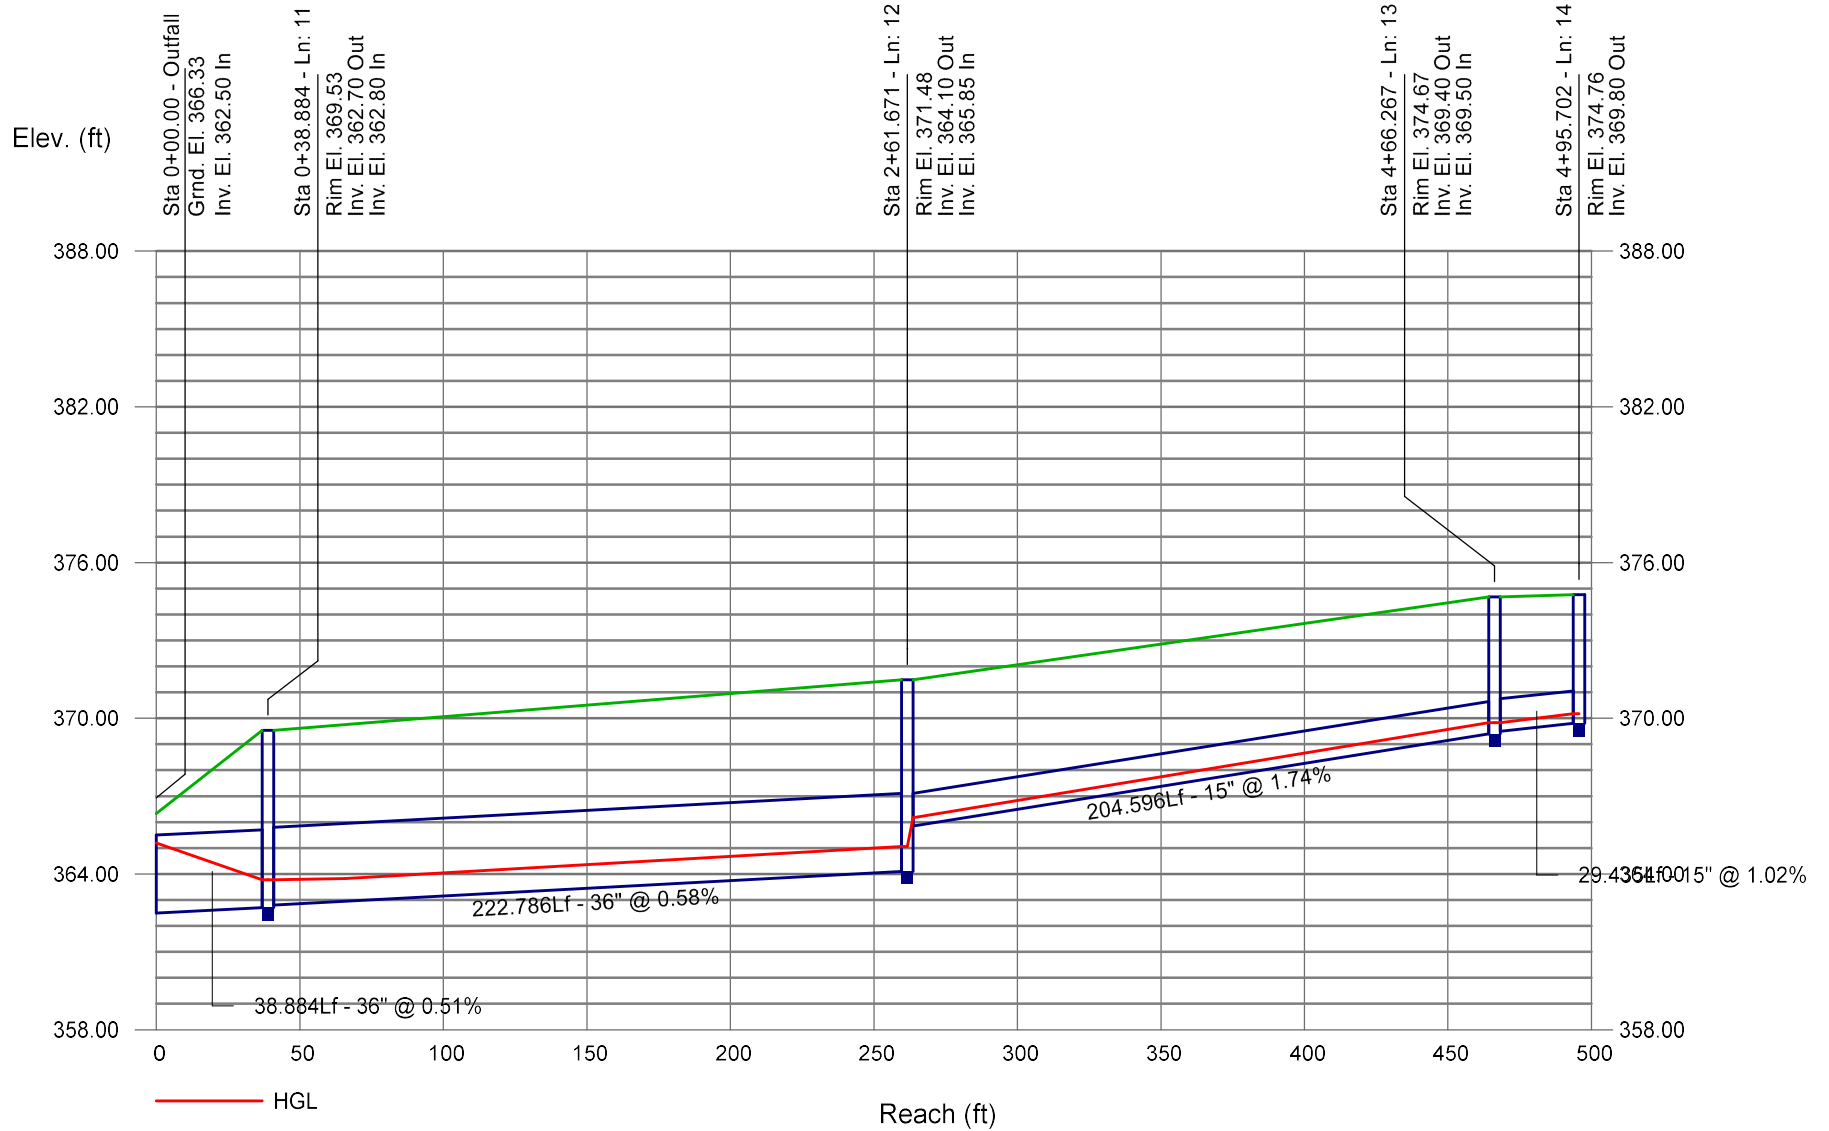


Storm Sewer Profile

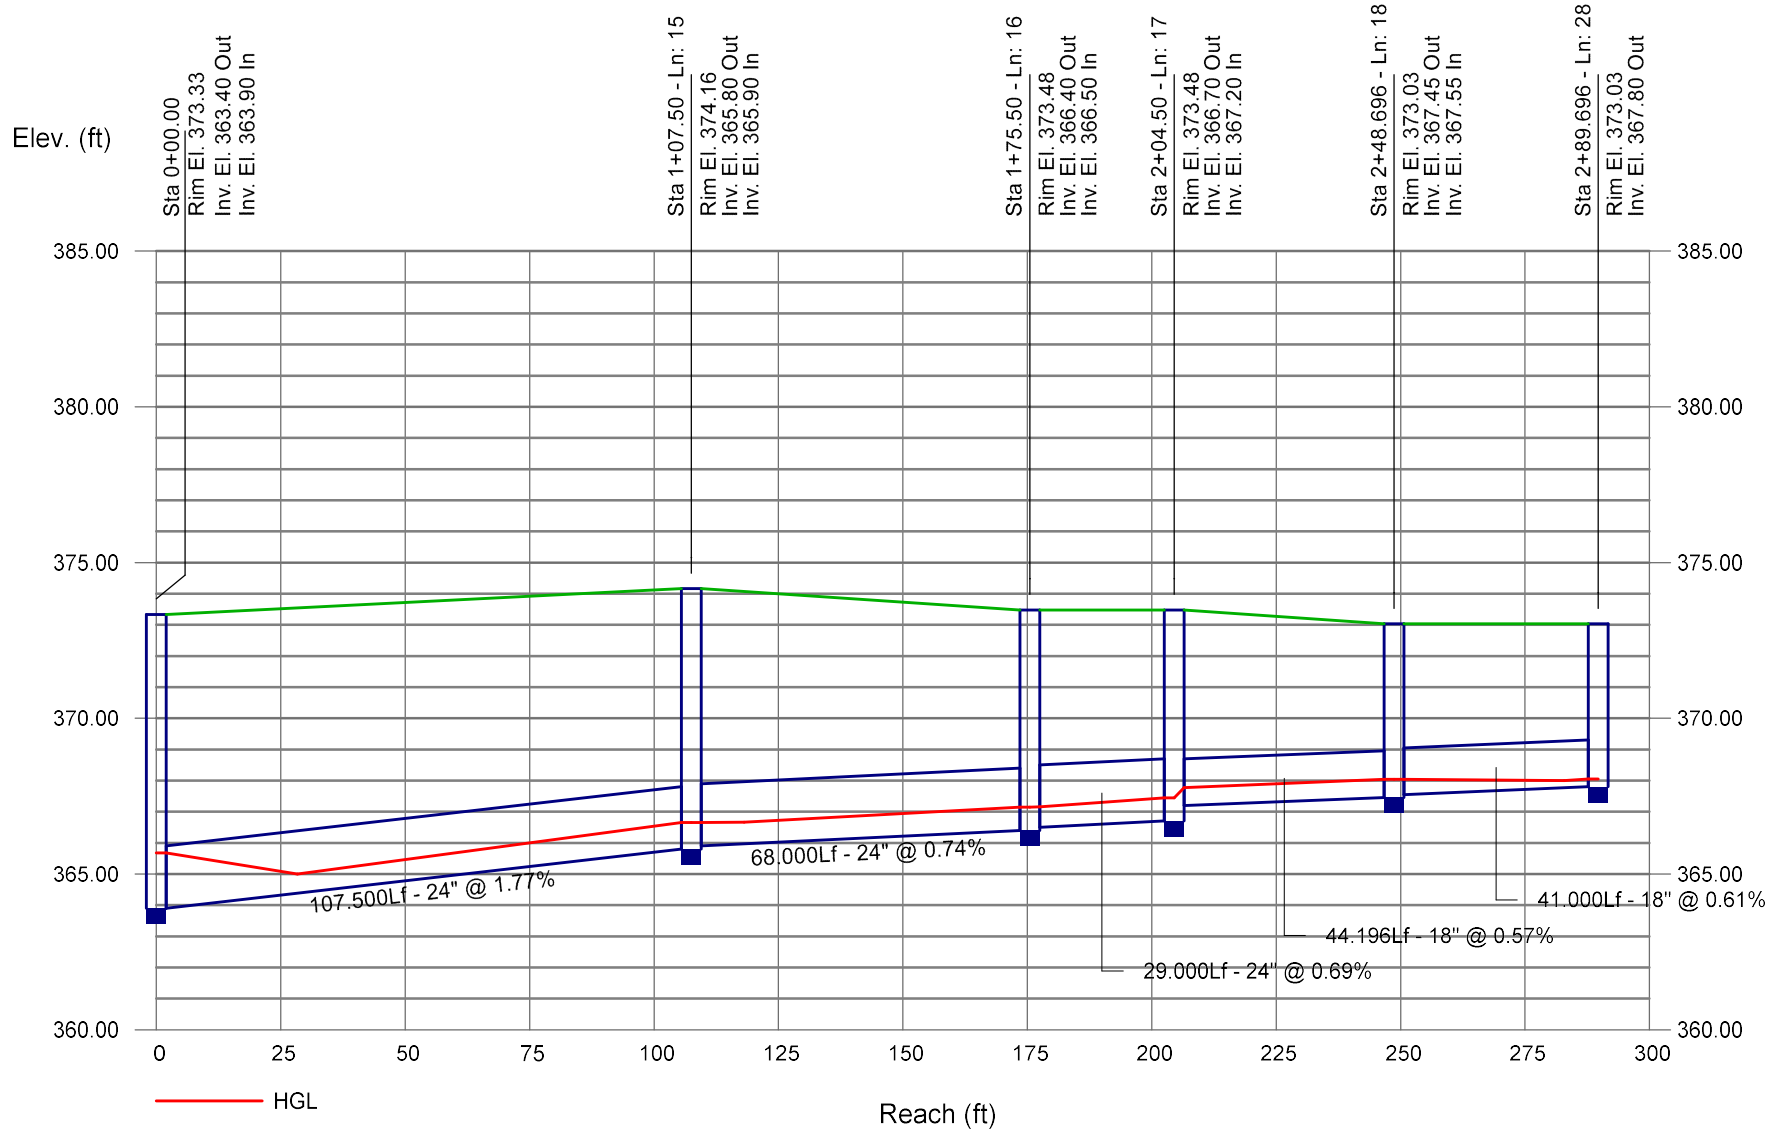


Storm Sewer Profile

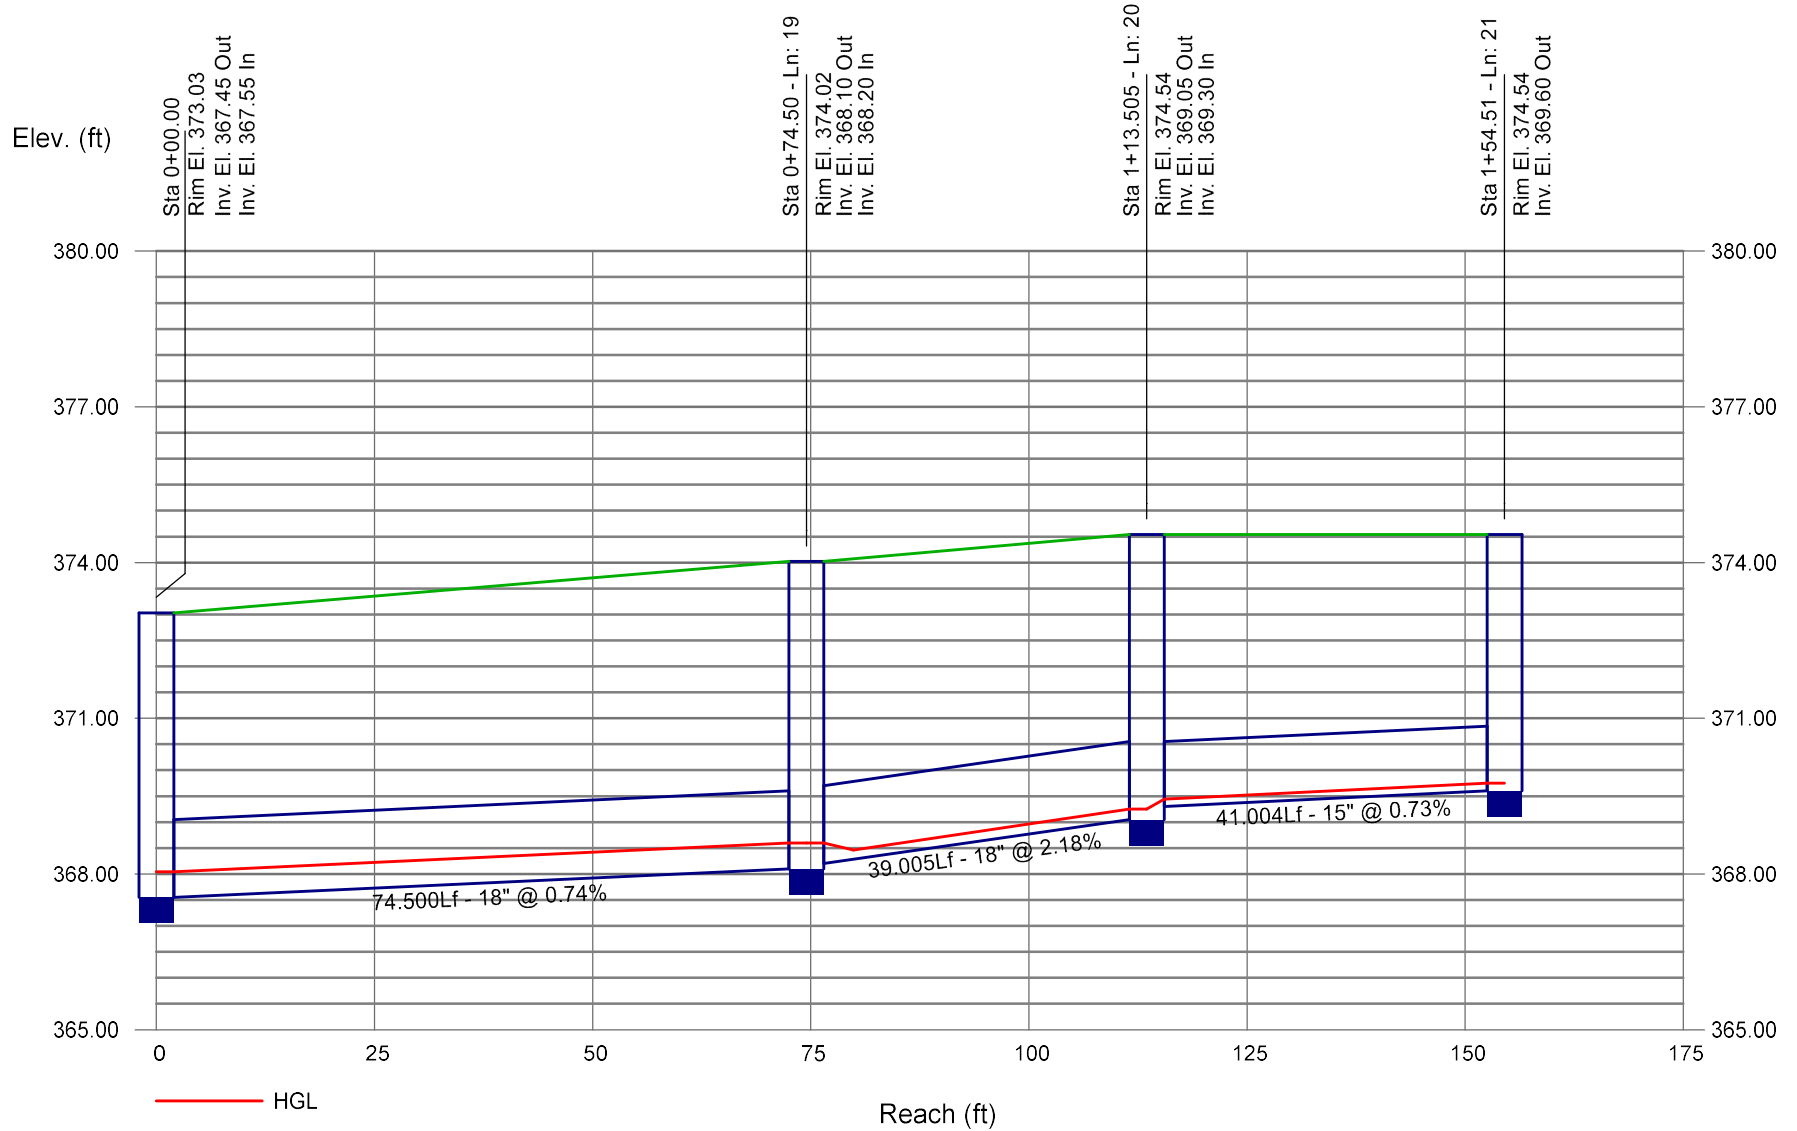


Storm Sewer Profile

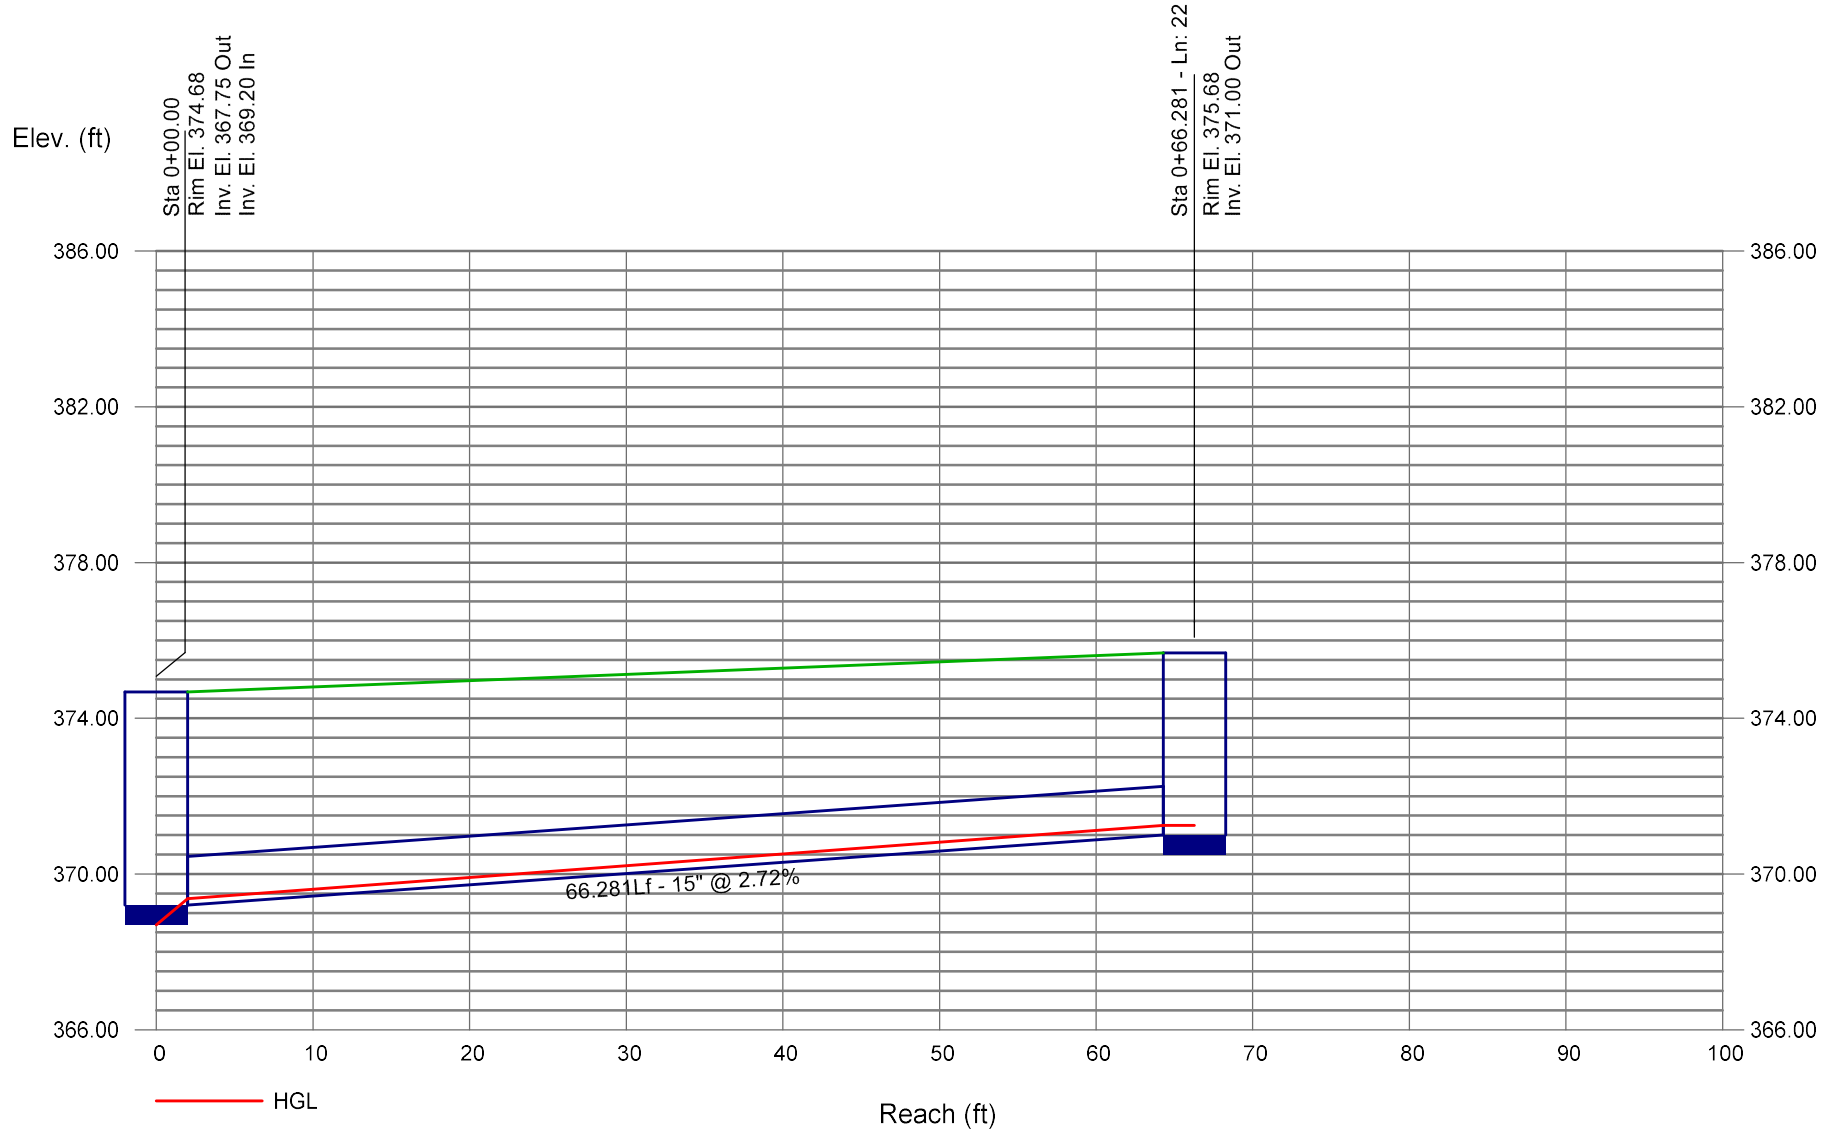

Storm Sewer Profile

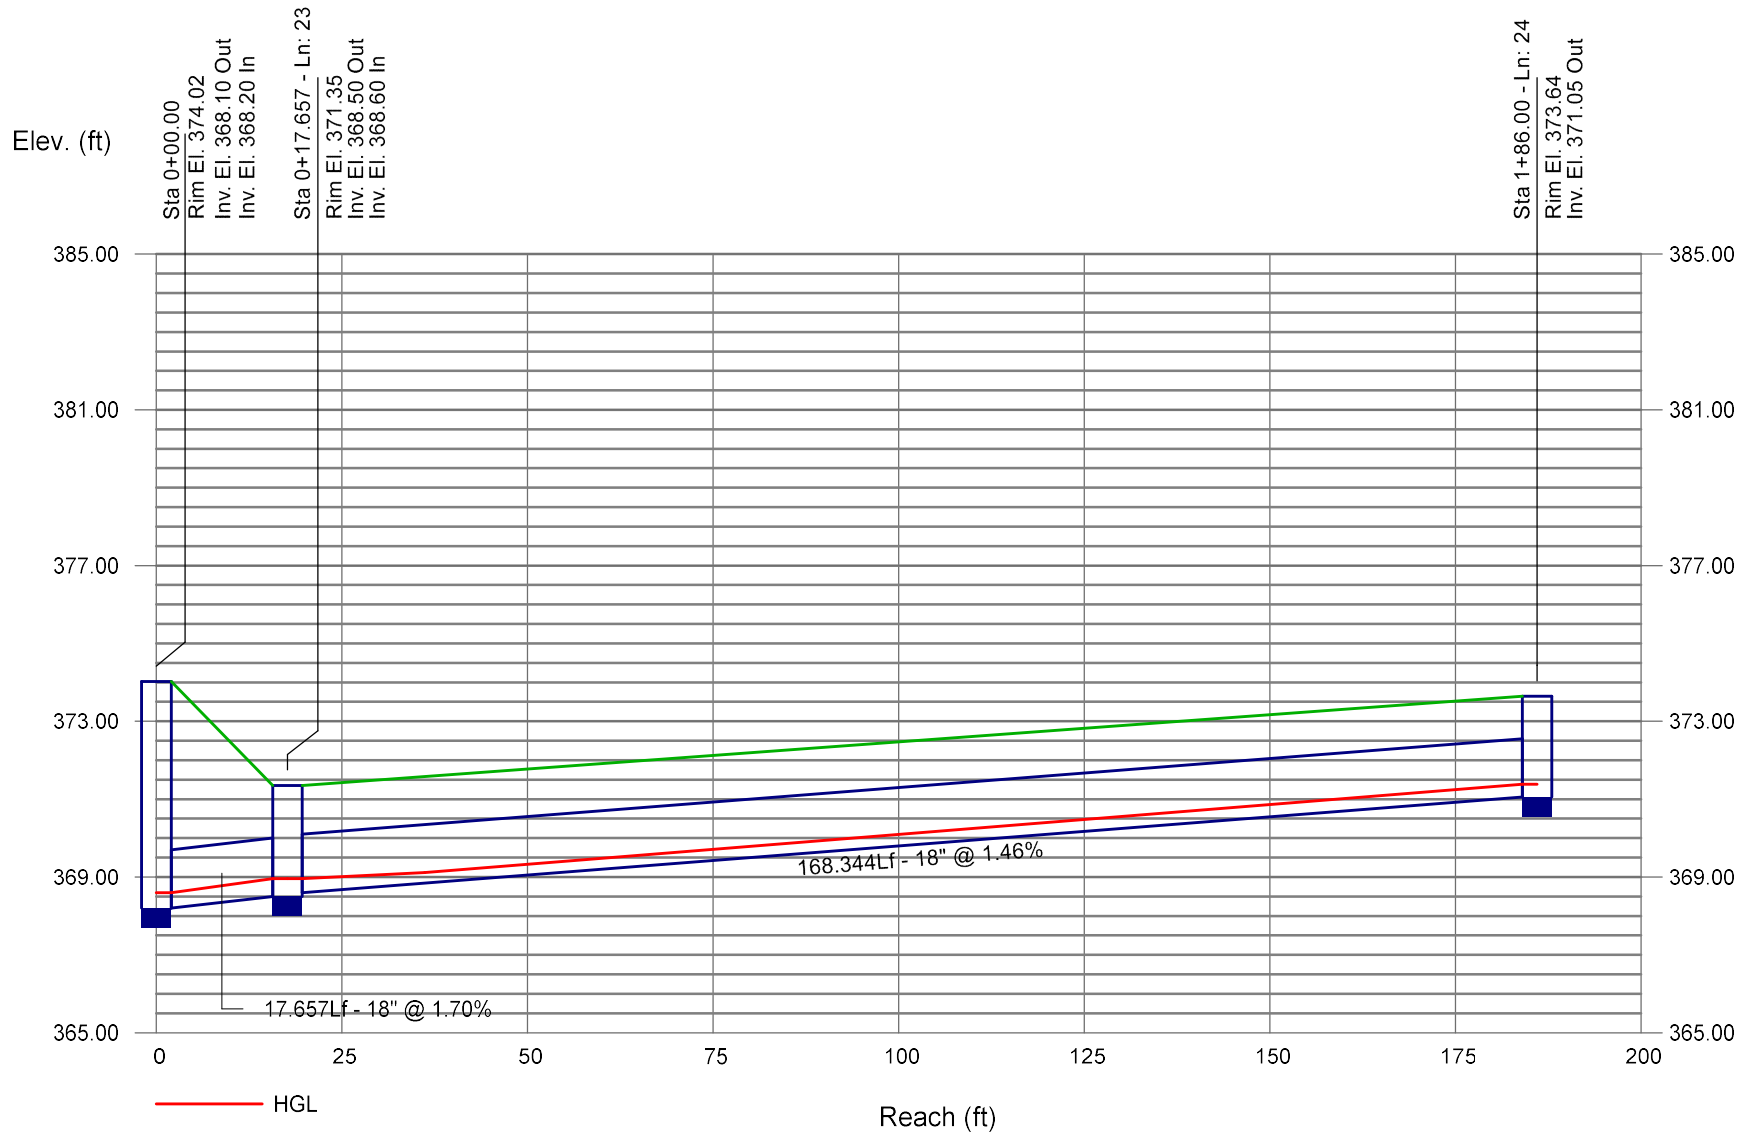

Storm Sewer Profile

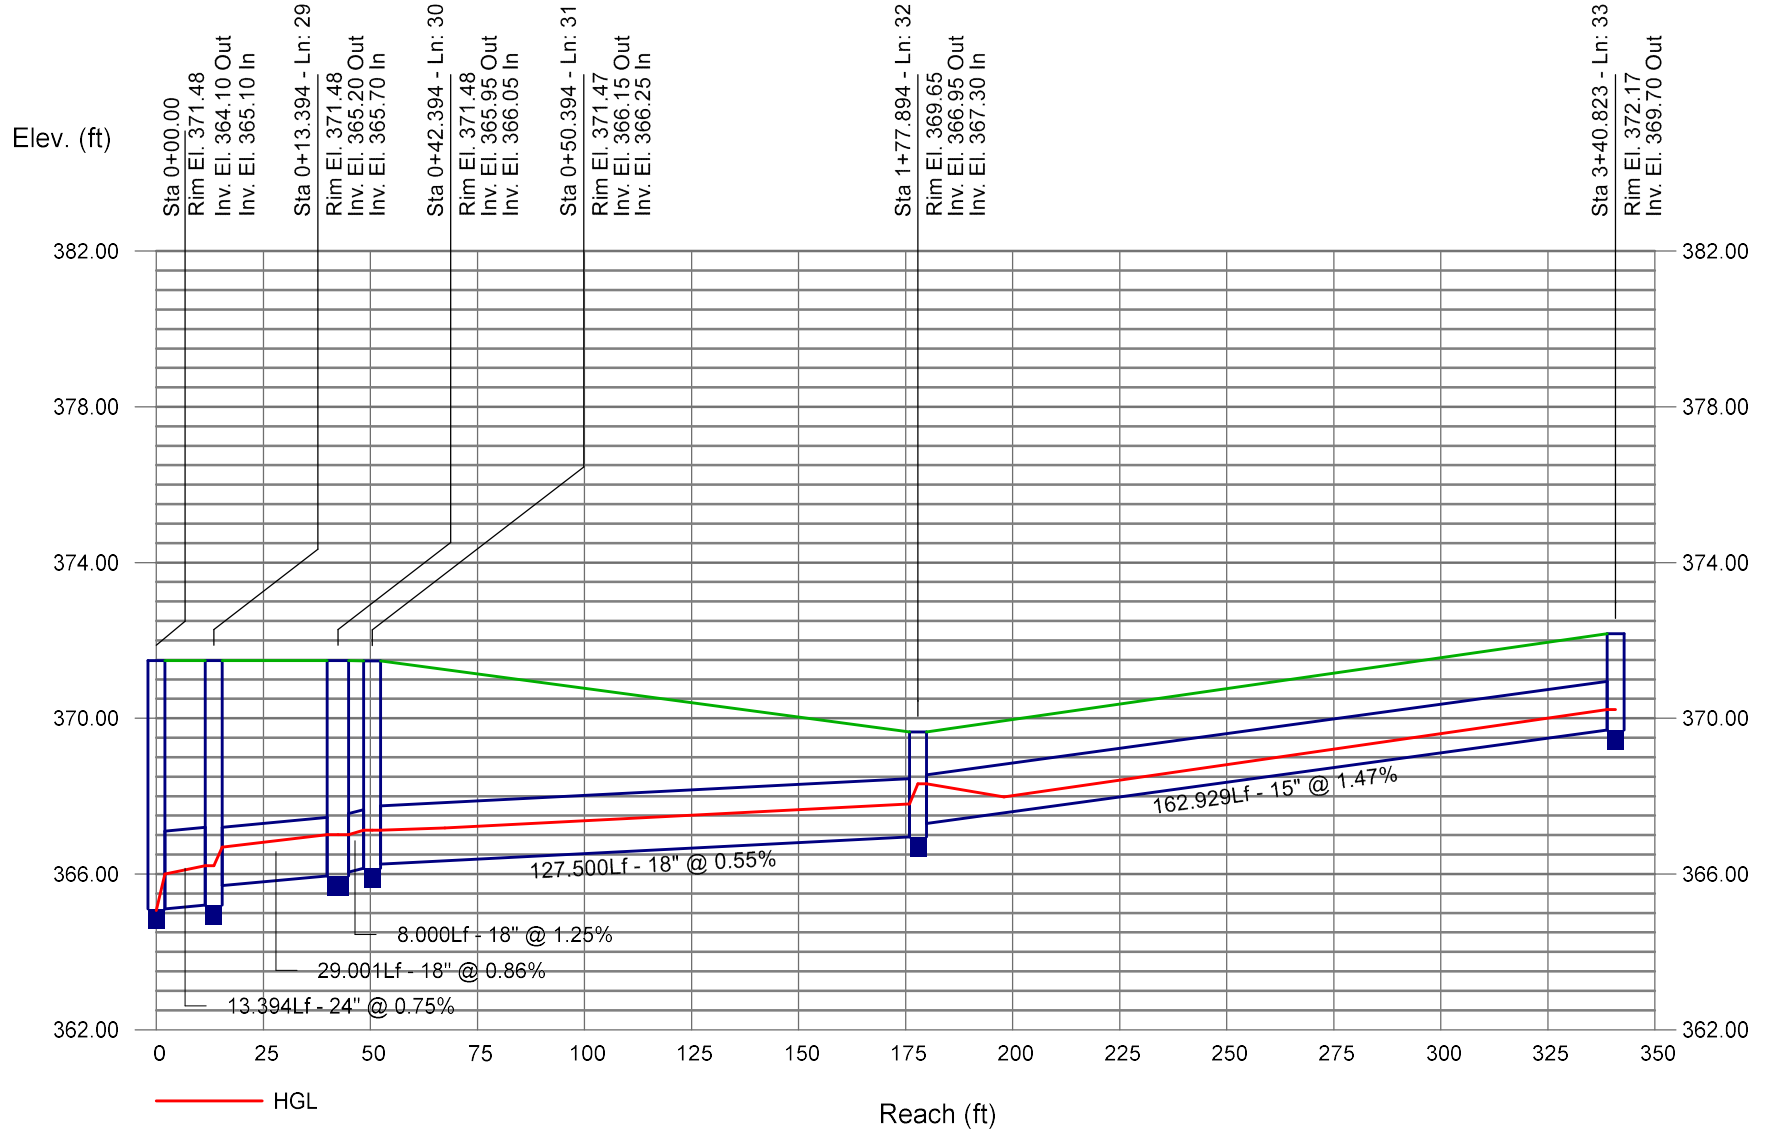

12. SCM 4: 4"/Hour Gutter Spread Chart

Spread

Line No.	Inlet ID	Junct Type	Byp Ln No	Drng Area (ac)	Inlet Time (min)	i Inlet (in/hr)	Runoff Coeff (C)	Incr Q (cfs)	Q Carry (cfs)	Q Capt (cfs)	Q Capt (cfs)	Gutter Spread (ft)
1	DI - 401	Dp-Grate	Offsite	0.18	5.0	4.00	0.70	0.50	0.02	0.48	0.48	8.76
2	DI - 402	Dp-Grate	1	0.13	5.0	4.00	0.70	0.36	0.00	0.34	0.34	7.81
3	DI - 403	Dp-Grate	Sag	0.16	5.0	4.00	0.70	0.45	0.00	0.45	0.45	8.22
4	CB - 404	Comb.	Offsite	0.08	5.0	4.00	0.70	0.22	0.00	0.22	0.22	1.89
5	CB - 419	Comb.	4	0.03	5.0	4.00	0.70	0.08	0.00	0.09	0.09	1.67
6	CB - 420	Comb.	Sag	0.39	5.0	4.00	0.70	1.09	0.00	1.09	1.09	2.67
7	CB - 421	Comb.	Sag	0.32	5.0	4.00	0.70	0.90	0.10	1.00	1.00	2.29
8	CB - 422	Comb.	7	0.26	5.0	4.00	0.70	0.73	0.00	0.62	0.62	5.16
9	DI - 423	Dp-Grate	Sag	0.33	5.0	4.00	0.70	0.92	0.01	0.93	0.93	10.86
10	DI - 415	Dp-Grate	9	0.09	5.0	4.00	0.70	0.25	0.00	0.25	0.25	6.86
11	DI - 451	Dp-Grate	Offsite	0.73	5.0	4.00	0.70	2.04	0.00	1.54	1.54	14.48
12	CB - 452	Comb.	Sag	0.12	5.0	4.00	0.70	0.34	0.02	0.36	0.36	1.43
13	CB - 458	Comb.	12	0.06	5.0	4.00	0.70	0.17	0.00	0.17	0.17	1.93
14	CB - 459	Comb.	31	0.18	5.0	4.00	0.70	0.50	0.00	0.47	0.47	3.73
15	CB - 408	Comb.	16	0.38	5.0	4.00	0.70	1.06	0.00	0.84	0.84	6.11
16	CB - 409	Comb.	29	0.04	5.0	4.00	0.70	0.11	0.22	0.32	0.32	3.50
17	CB - 410	Comb.	18	0.55	5.0	4.00	0.70	1.54	0.00	1.12	1.12	7.17
18	CB - 411	Comb.	Sag	0.12	5.0	4.00	0.70	0.34	0.42	0.76	0.76	2.00
19	CB - 412	Comb.	18	0.02	5.0	4.00	0.70	0.06	0.00	0.06	0.06	1.35
20	CB - 417	Comb.	19	0.04	5.0	4.00	0.70	0.11	0.00	0.11	0.11	1.75
21	CB - 418	Comb.	28	0.03	5.0	4.00	0.70	0.08	0.00	0.08	0.08	1.57
22	CB - 424	Comb.	5	0.08	5.0	4.00	0.70	0.22	0.00	0.22	0.22	2.78
23	DI - 413	Dp-Grate	Sag	0.21	5.0	4.00	0.70	0.59	0.03	0.62	0.62	9.24

Project File: SCM4.stm	Number of lines: 33	Date: 10/30/2024
------------------------	---------------------	------------------

NOTES: Intensity = 4.00 / (Inlet time + 0.10) ^ 0.00 -- Return period = 3 Yrs. ; ** Critical depth

Spread

Line No.	Inlet ID	Junct Type	Byp Ln No	Drng Area (ac)	Inlet Time (min)	i Inlet (in/hr)	Runoff Coeff (C)	Incr Q (cfs)	Q Carry (cfs)	Q Capt (cfs)	Q Capt (cfs)	Gutter Spread (ft)
24	DI - 414	Dp-Grate	23	0.16	5.0	4.00	0.70	0.45	0.00	0.42	0.42	8.76
25	CB - 405	Comb.	Offsite	0.02	5.0	4.00	0.70	0.06	0.00	0.06	0.06	1.13
26	CB - 406	Comb.	Offsite	0.30	5.0	4.00	0.70	0.84	0.00	0.70	0.70	5.50
27	DI - 407	Dp-Grate	Offsite	0.38	5.0	4.00	0.70	1.06	0.00	0.88	0.88	10.67
28	CB - 416	Comb.	30	0.09	5.0	4.00	0.70	0.25	0.00	0.25	0.25	2.73
29	CB - 453	Comb.	12	0.13	5.0	4.00	0.70	0.36	0.01	0.36	0.36	3.73
30	CB - 454	Comb.	31	0.25	5.0	4.00	0.70	0.70	0.00	0.61	0.61	5.07
31	CB - 455	Comb.	Sag	0.36	5.0	4.00	0.70	1.01	0.13	1.13	1.13	2.84
32	DI - 456	Dp-Grate	Sag	0.69	5.0	4.00	0.70	1.93	0.15	2.09	2.09	15.76
33	DI - 457	Dp-Grate	32	0.34	5.0	4.00	0.70	0.95	0.00	0.80	0.80	9.71

Project File: SCM4.stm

Number of lines: 33



Date: 10/30/2024

NOTES: Intensity = 4.00 / (Inlet time + 0.10) ^ 0.00 -- Return period = 3 Yrs. ; ** Critical depth

13. Storm Drainage Area Map



J:\2024\04\04_Plan_WithersRavenel\Assemblies\CAD\Tables\DA_Map\Drawings - DA_Map - 250x600.dwg, Wednesday, October 23, 2024 1:42:58 PM, T:\CDK

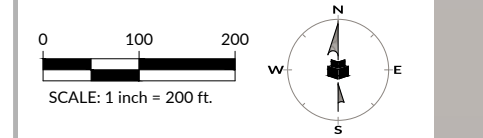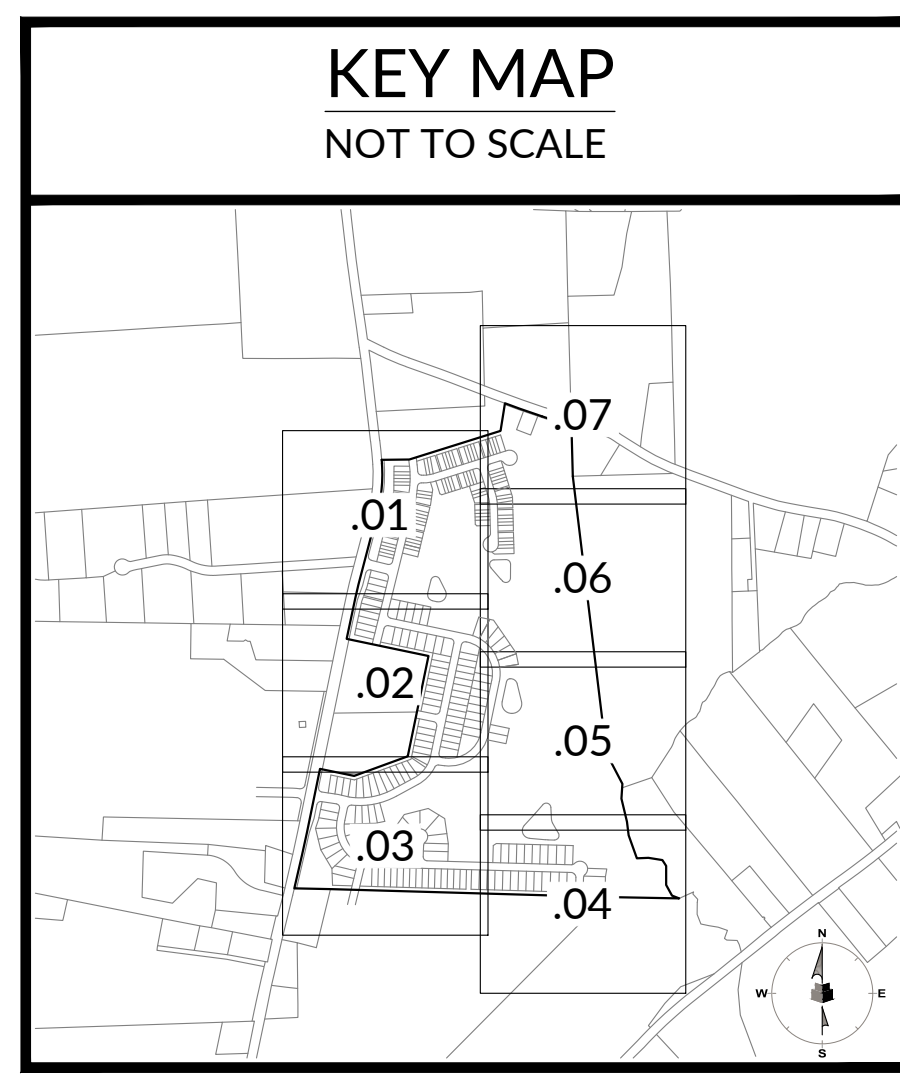

INITIAL PLAN DATE: 11/01/2024
 REVISIONS:

WR JOB NUMBER: 23-0045
 DRN: WR DGN: WR CKD: WR

INLET DRAINAGE AREA MAP

EX1